
PUMP TANK DESIGN David SAKALUK

ATTACHMENT TO PROPERTY DESCRIPTION # 25603

TAX MAP # 8R-A-1

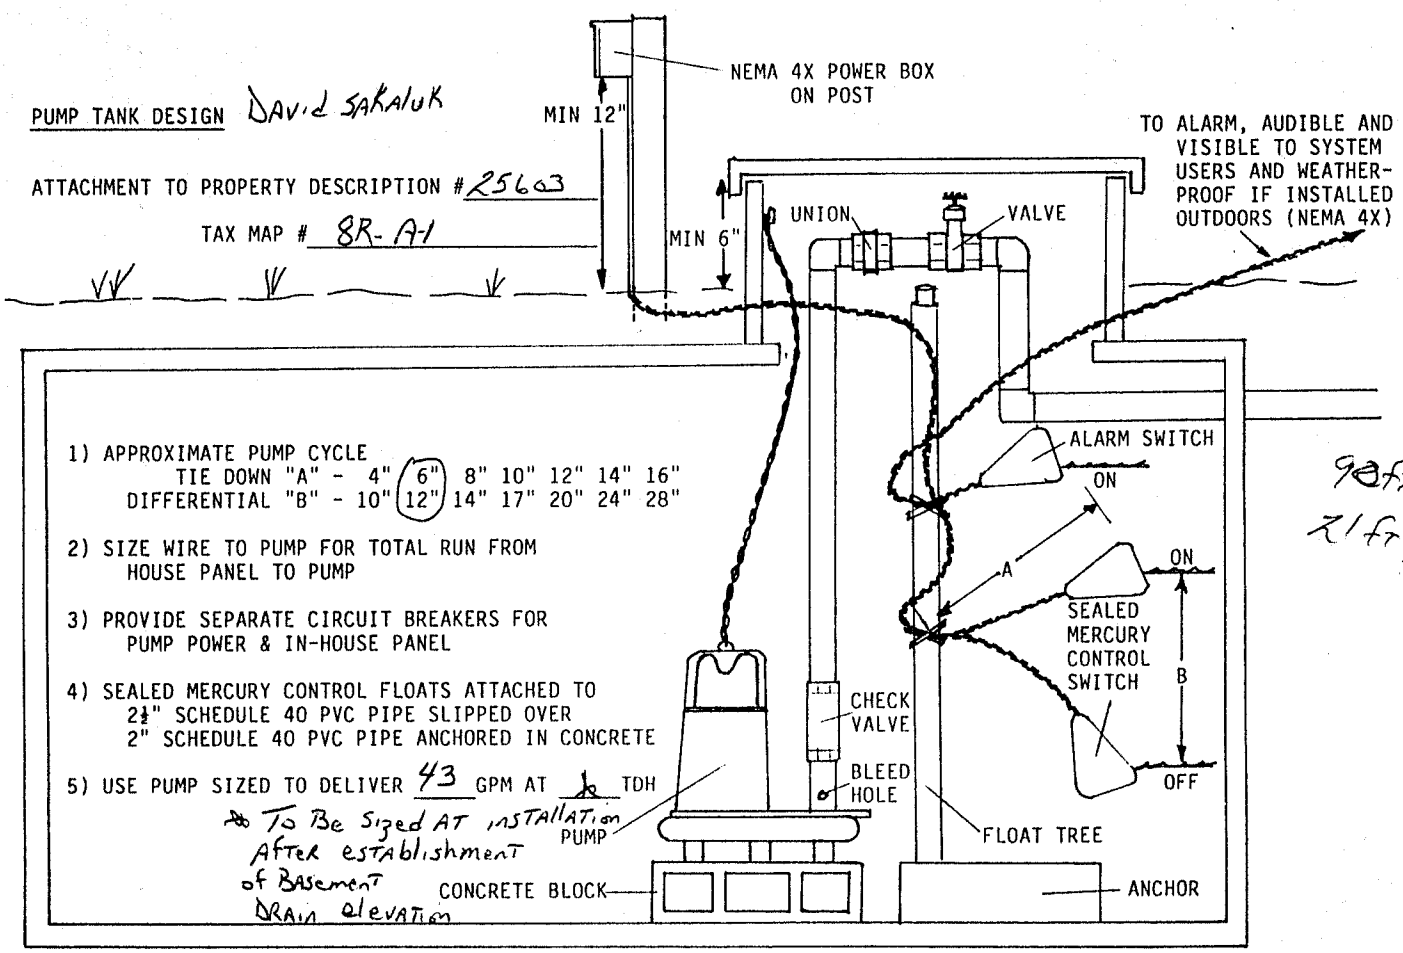

1) APPROXIMATE PUMP CYCLE
   TIE DOWN "A" - 4" (6") 8" 10" 12" 14" 16"
   DIFFERENTIAL "B" - 10" (12") 14" 17" 20" 24" 28"

2) SIZE WIRE TO PUMP FOR TOTAL RUN FROM HOUSE PANEL TO PUMP

3) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN-HOUSE PANEL

4) SEALED MERCURY CONTROL FLOATS ATTACHED TO 2½" SCHEDULE 40 PVC PIPE SLIPPED OVER 2" SCHEDULE 40 PVC PIPE ANCHORED IN CONCRETE

5) USE PUMP SIZED TO DELIVER 43 GPM AT ½ TDH

** To Be Sized AT INSTALLATION After establishment of Basement DRAIN elevation

98 ft
71 ft elev