4616806254

12466

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Clodfelter Bld. Co. DATE 4/12/91 PERMIT NO 2E-1-A-95

PHONE: Business 664-1812 Home

LOCATION Barber Loop (1458), 1100 TR 1177 (Chuckwood) at end TL Barber Loop (1458) 1/2 mile on R S. R. No. 1458

SUBDIVISION NAME CL&T Lake Norman LOT NO. 95 SECTION OR BLOCK NO. 7

House (✓) Mobile Home ( ) Business ( ) Other

No. Bedrooms 4 No. Bathrooms 3 1/2

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 20,000 FT²

Character & Porosity of Soil ps / silty clay - transition


Percolation Rate .3

Topography 8-10%

Depth to Water Table >48"

Rock or other impervious formations none observed

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

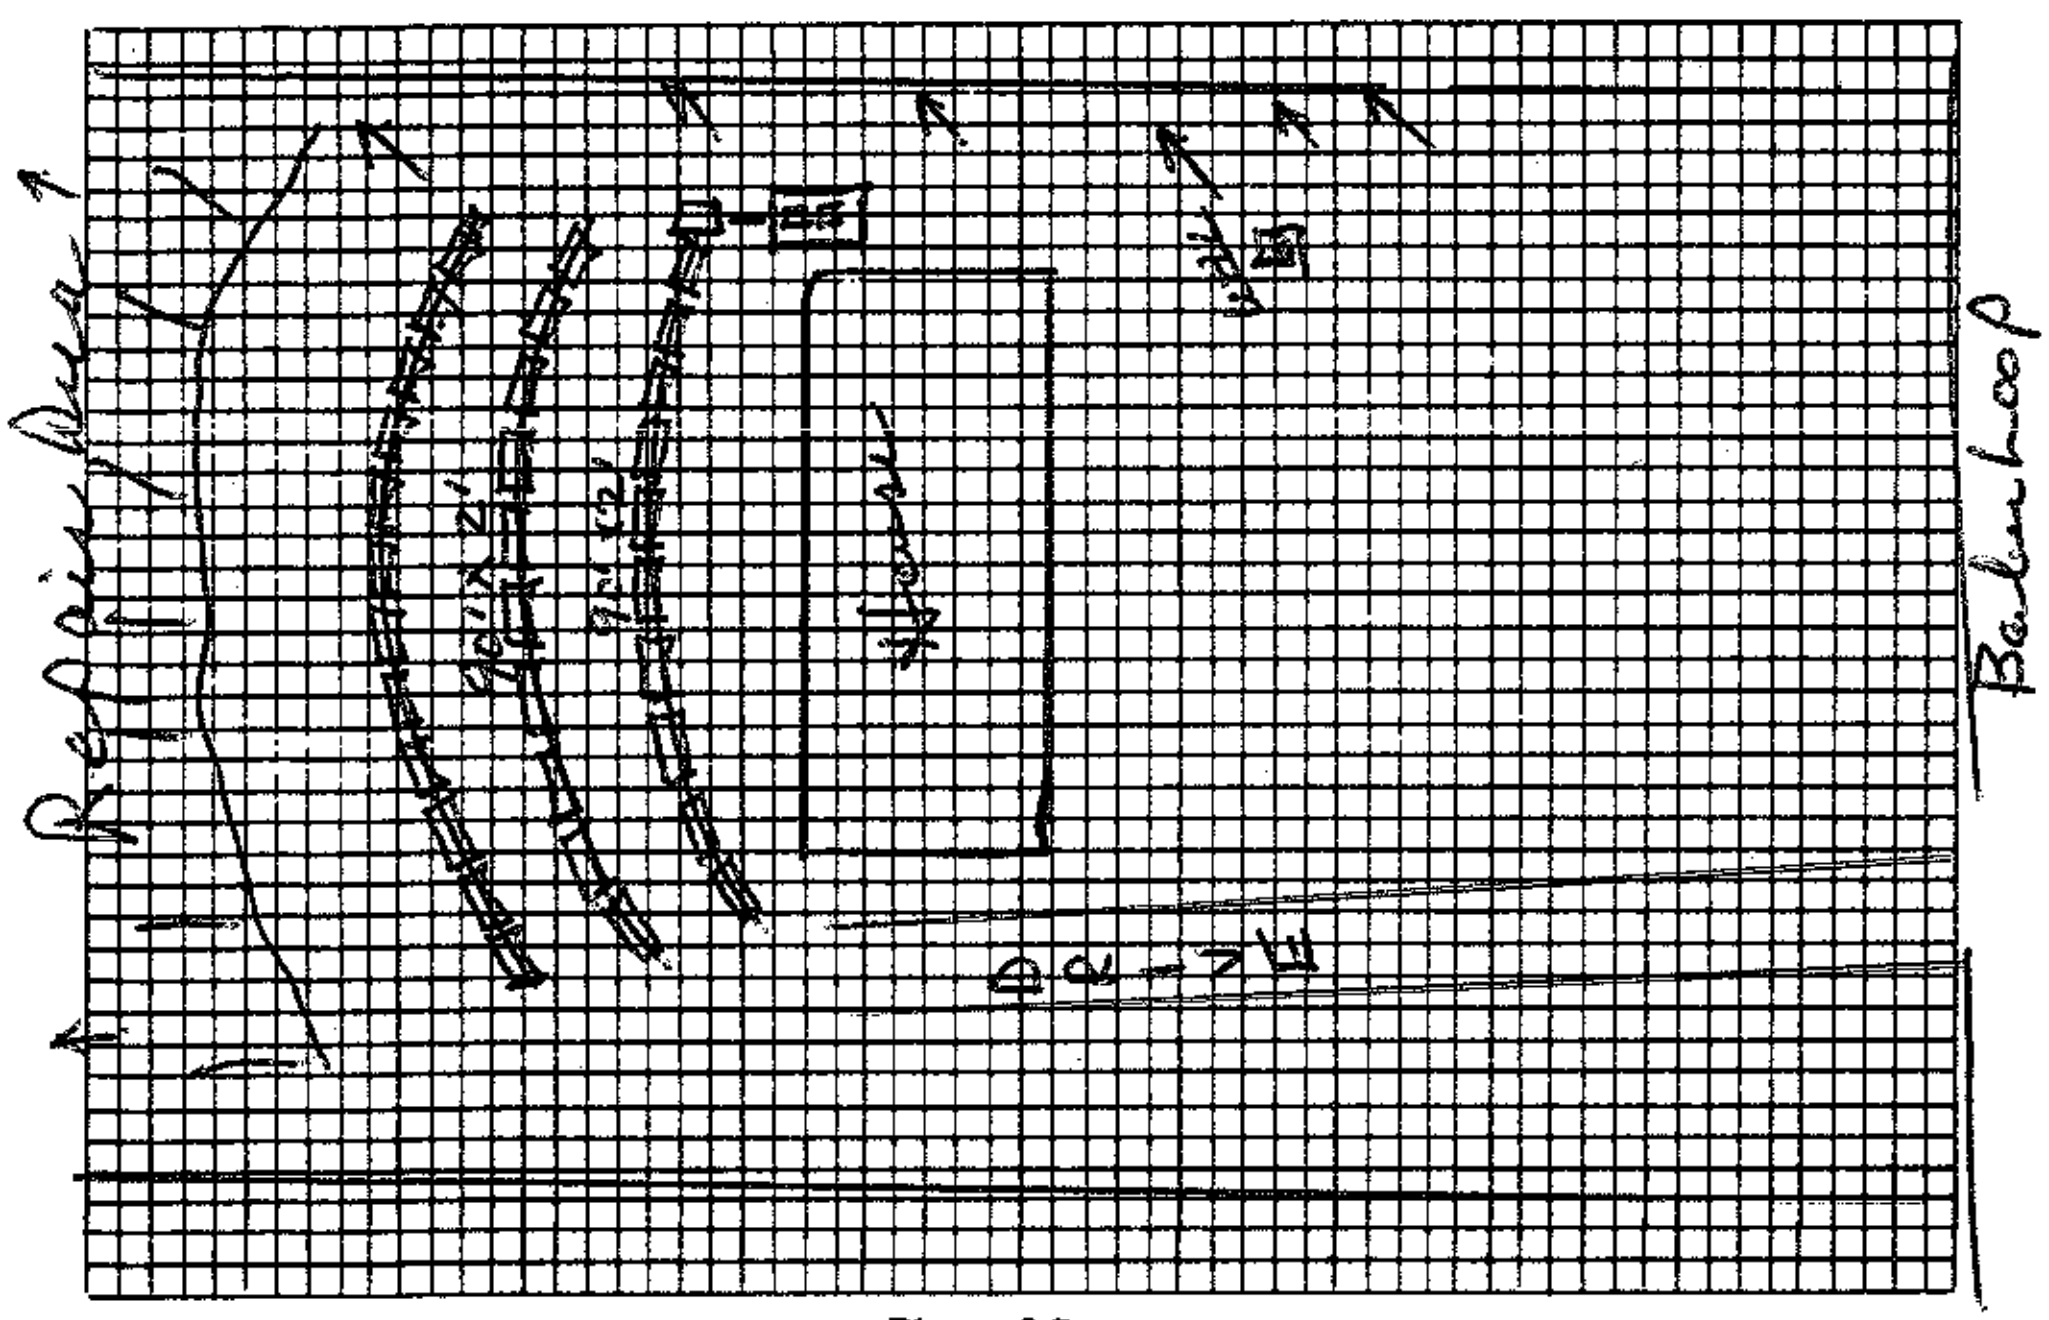

Plot of System

Size of Tank 1500 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 1620 Linear Ft. 270

Depth of Stone in Lines 16" APPBS

Water Supply: Individual (✓) Public ( ) Gravity Flow

Installed by Julian Bowles

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed:

IMPROVEMENTS PERMIT BY

COMMENTS:

CERTIFICATE OF COMPLETION BY Wesley Sparks RS. DATE 4/17/91

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold