Type 3

14908

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

OWNER OR CONTRACTOR Jeffrey & Teresa McMasters DATE July 13, '92 PERMIT NO. 2E-1-A-85

PHONE: Business ______ Home ______

LOCATION 1100 TR 1177 To END TR 1458 (Barber Loop) ~.4 mile TR Landover Lane to end on left S.R. No. ______

SUBDIVISION NAME Crescent / LAKE Norman LOT NO. 85 SECTION OR BLOCK NO. 7

House ☑ Mobile Home ☐ Business ☐ Other [unfinished Basement]

No. Bedrooms 3 No. Bathrooms 3½

Garbage Disposal Unit Yes ☑ No ☐

Auto. Dishwasher Yes ☑ No ☐

Auto. Wash. Machine Yes ☑ No ☐

Lot Area ~20,000 ft²

Soil Characteristics PS clay


Application Rate ~.3

Topography ~4%

Depth to Water Table >4'

Rock or other impervious formations NONE obs

✓ (Roughed in) Basement with Plumbing ______ Basement without Plumbing ______ No Basement ______ Crawl Space

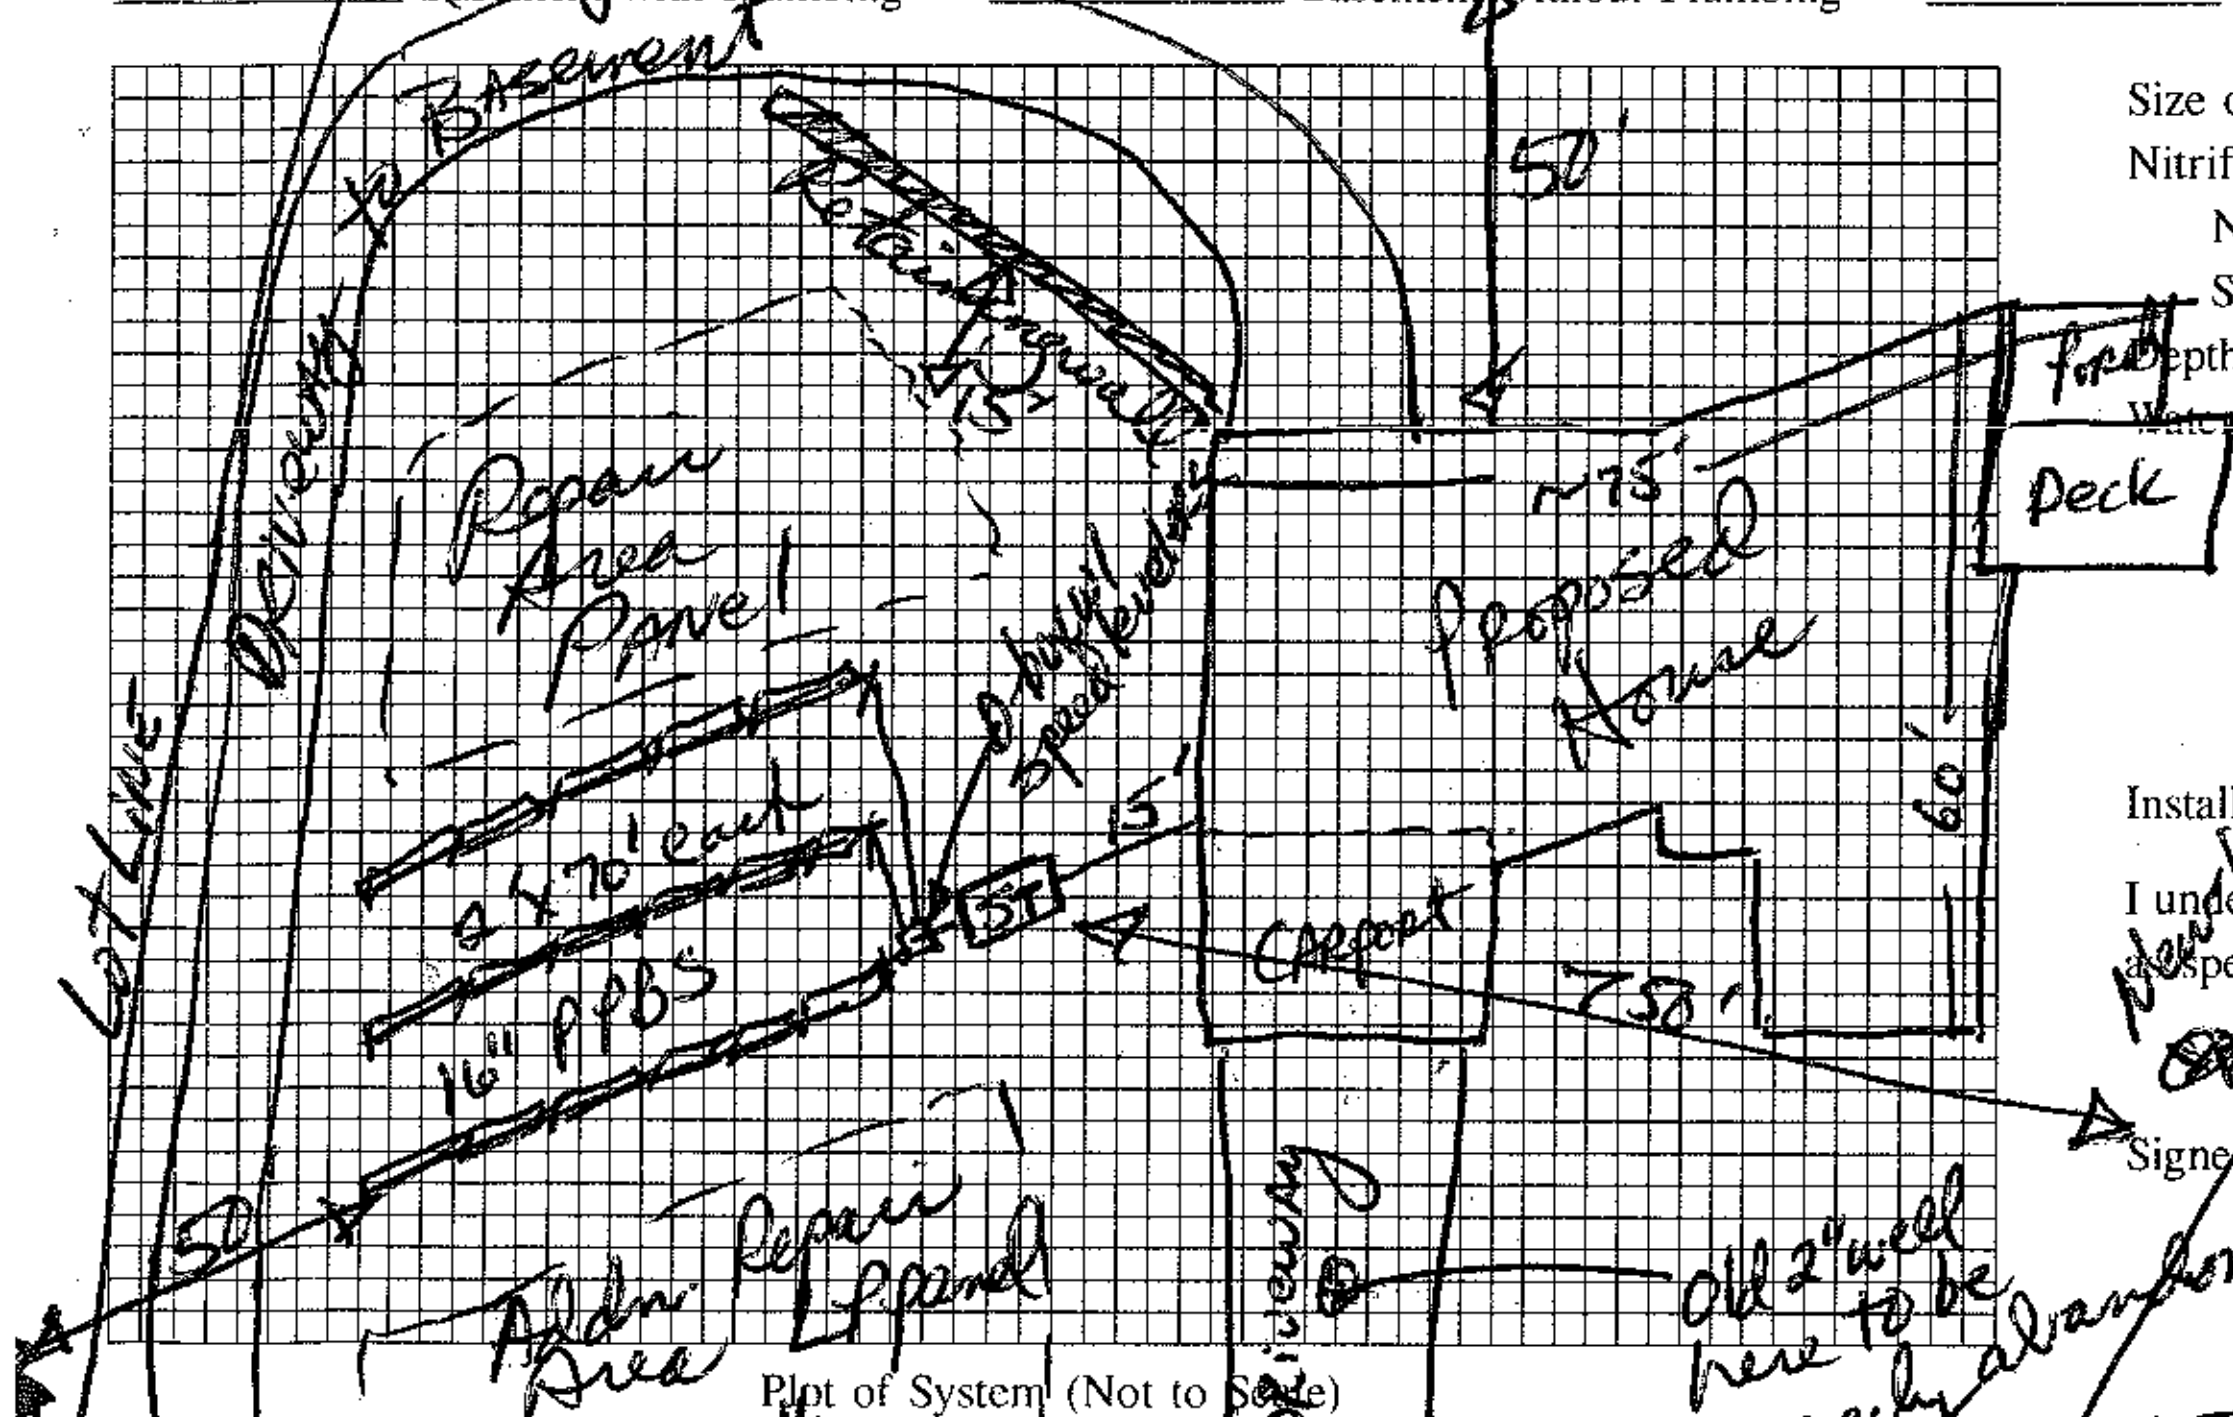

Size of Tank 1500 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. ______ Linear Ft. 210' of

Depth of Stone in Lines 16" PPBS

Water Supply: Individual ☑ New well to be drilled

Public ☐

Installed by ______

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: [signature]

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

Use sump pump for basement plumbing to main level plumbing.

IMPROVEMENT PERMIT BY [signature] Landover Lane

COMMENTS Larger TANK (1500 gal) to be set to accomodate 4th bedroom in basement if it is finished. Additional drainfield to be added if 4th bedroom added. Follow contour w/ drainfield. 36" MAX. trench bottom depth.

CERTIFICATE OF COMPLETION BY * H.D. representative to be on site at DATE ______

EXISTING SYSTEM CHECKED BY time old well is abandoned. DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold