DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM 40x40 BED

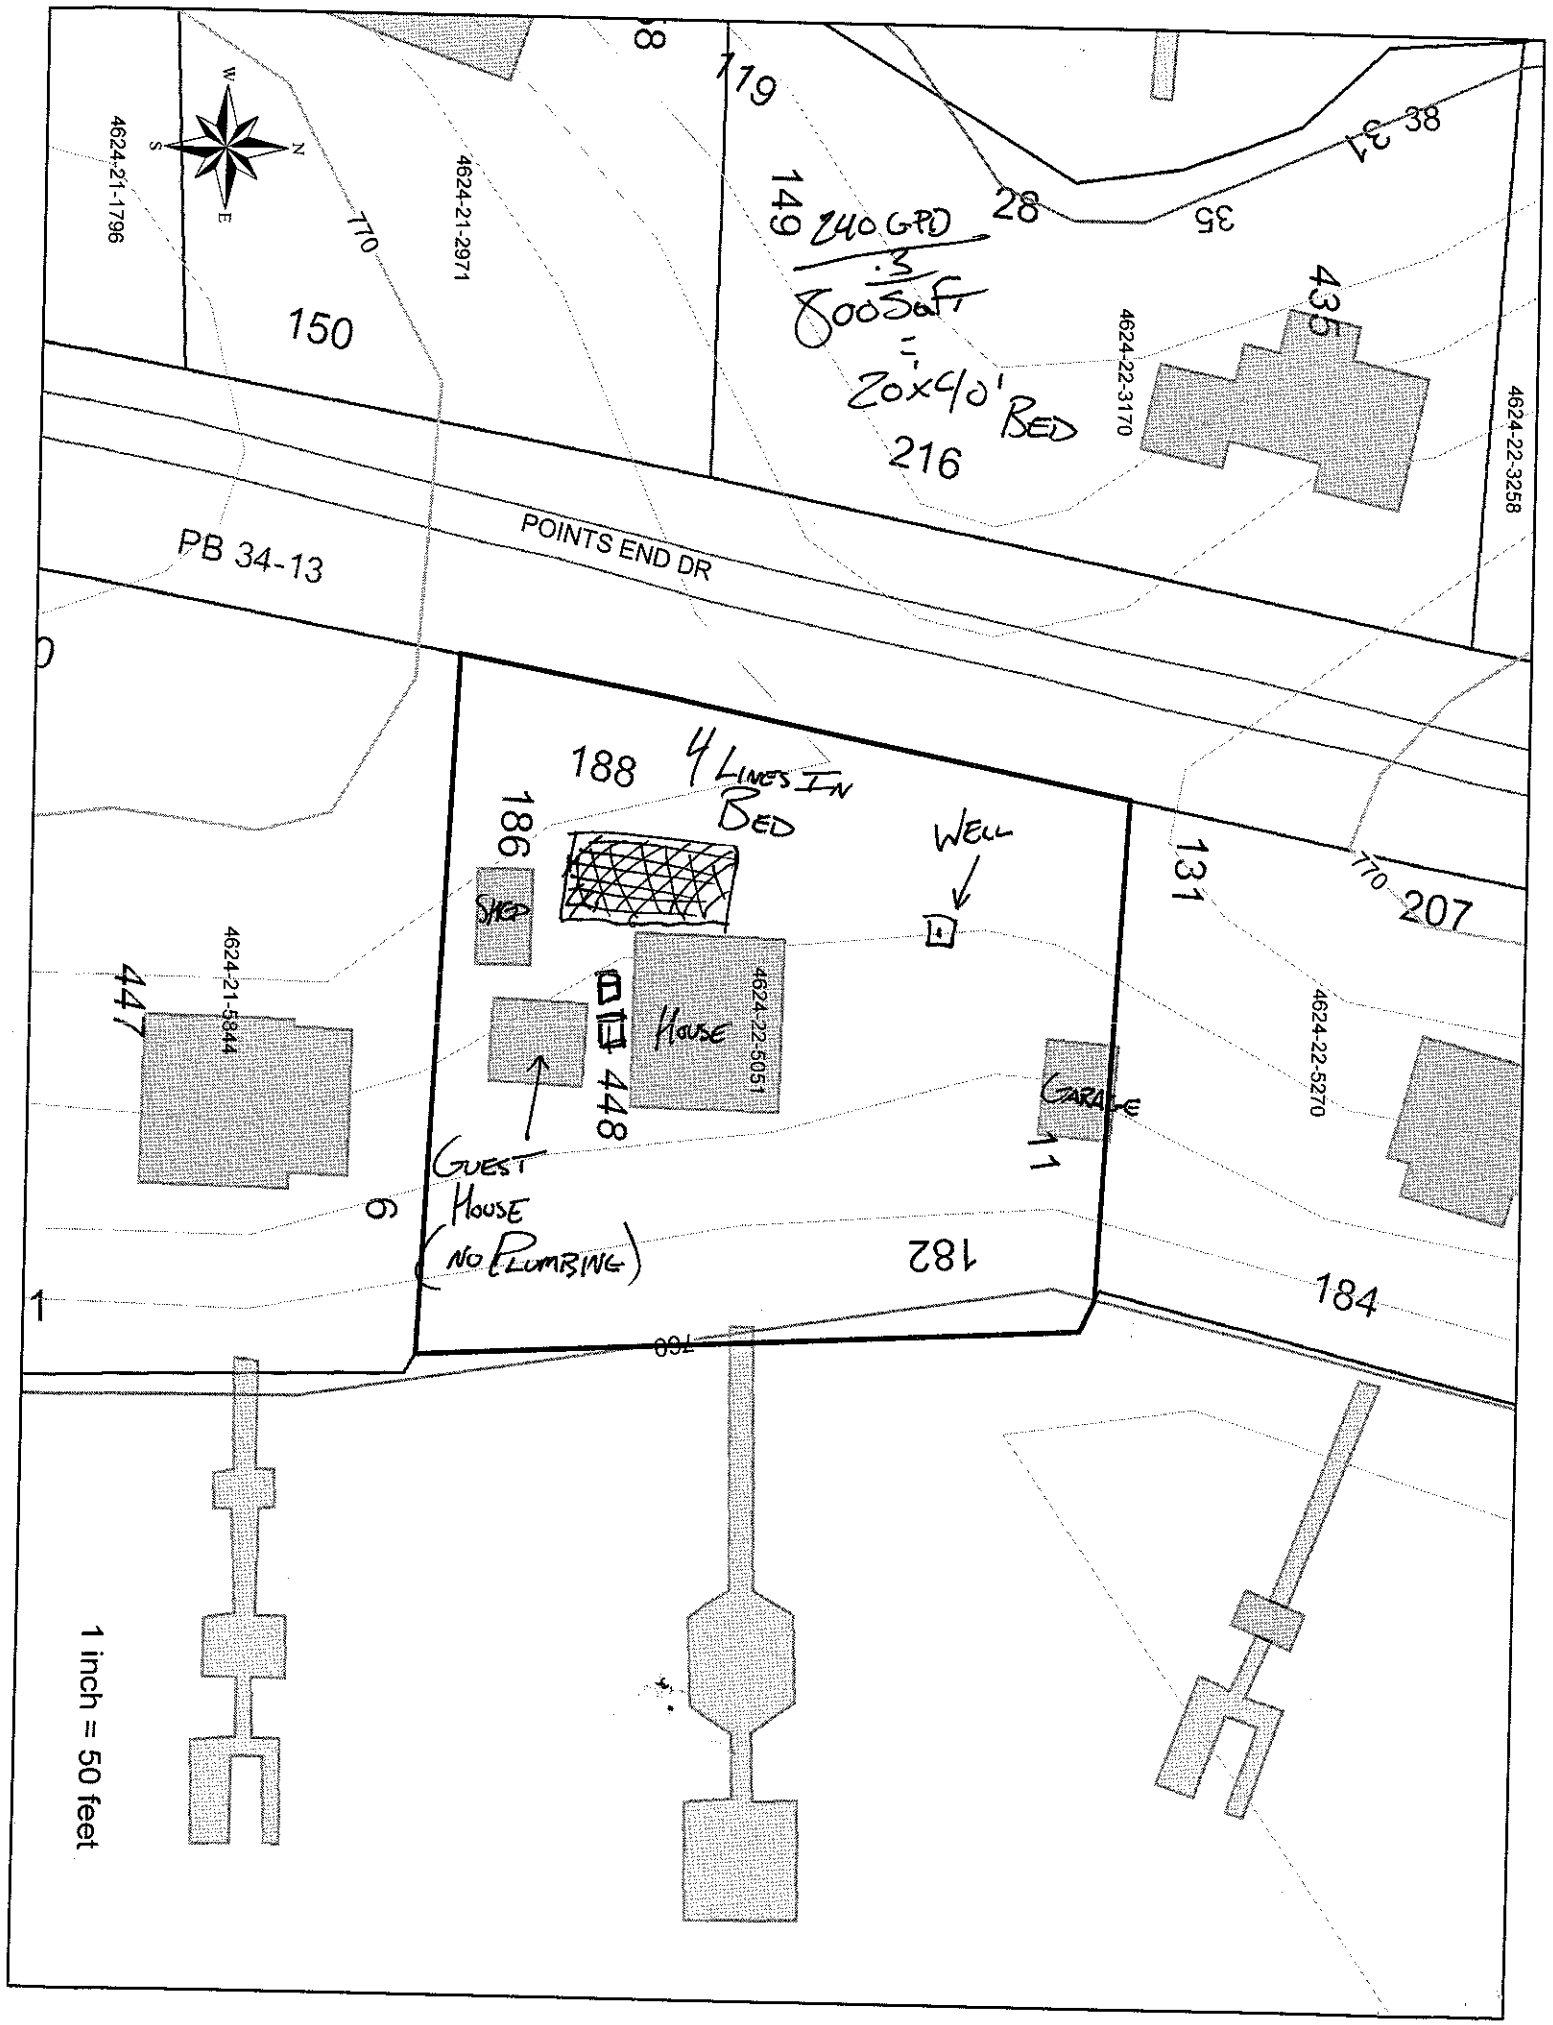
OWNER: _____
ADDRESS: _____ APPLICATION DATE _____
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 240 GPD DATE EVALUATED: 5-25-10
LOCATION OF SITE: POINTS END PROPERTY SIZE: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____ PROPERTY RECORDED: YES
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LINEAR <2%	0-6	FILL						
		6-33	C,MSBK	SSSPSQP	MANY MICA THROUGH OUT				
		33-58	CL,W,SBK	SSSPSQP	~~SAP~~ COMMON SAP		S	NA	.3/.35
		58+	SLSAP	SSSP					
2									
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		GRAVEL BED
System Type(s)		
Site LTAR		.3

COMMENTS:

OTHER FACTORS (.1946): OLD TANK TO BE PUMPED
SITE CLASSIFICATION (.1948): 3, FILLED
EVALUATED BY: _____
OTHER(S) PRESENT: _____


4624-21-1796
4624-21-2971
4624-22-3170
4624-22-3258
4624-21-5844
4624-22-5051
4624-22-5270
POINTS END DR
PB 34-13
770
150
149
240 GPD
.3
600 Sq Ft
20x40' Bed
216
435
119
28
35
38
188
4 Lines In Bed
186
Shed
Well
131
207
House
448
447
Guest House (No Plumbing)
Garage
182
184
1 inch = 50 feet