INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2486A DATE: 3/7/90

TC: 001 361 45 ☐ L

SERIAL

Permission is hereby given to ____ Install or Construct, ✓ Alter or ~~Repair~~ the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 2/27/90. All work shall be completed on or before 4/7/90, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

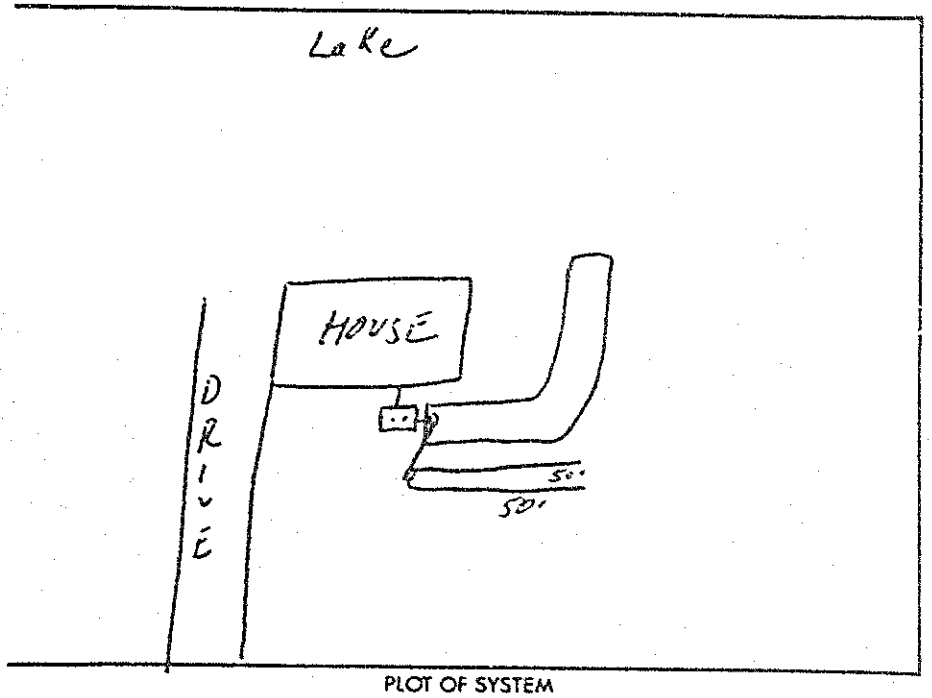

PLOT OF SYSTEM

Liquid Capacity of Septic Tank — gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction —

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 100 feet

Number of Lines 2

Depth of Stone 12 inches

Distance from House ~~40~~ 95 feet

Distance from Property Line 10 feet

Distance from Well >50 feet

NAME OF OWNER Don S. Carpenter

LOCATION OF PROPERTY 27700 Mayhew Rd

Comments: 2 Trenches x 50' long x 3' x 12" stone connected from existing D-Box. Put 6" cover on end of existing bed system

Division or Section Head

Phil S. Walker R.S.
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY