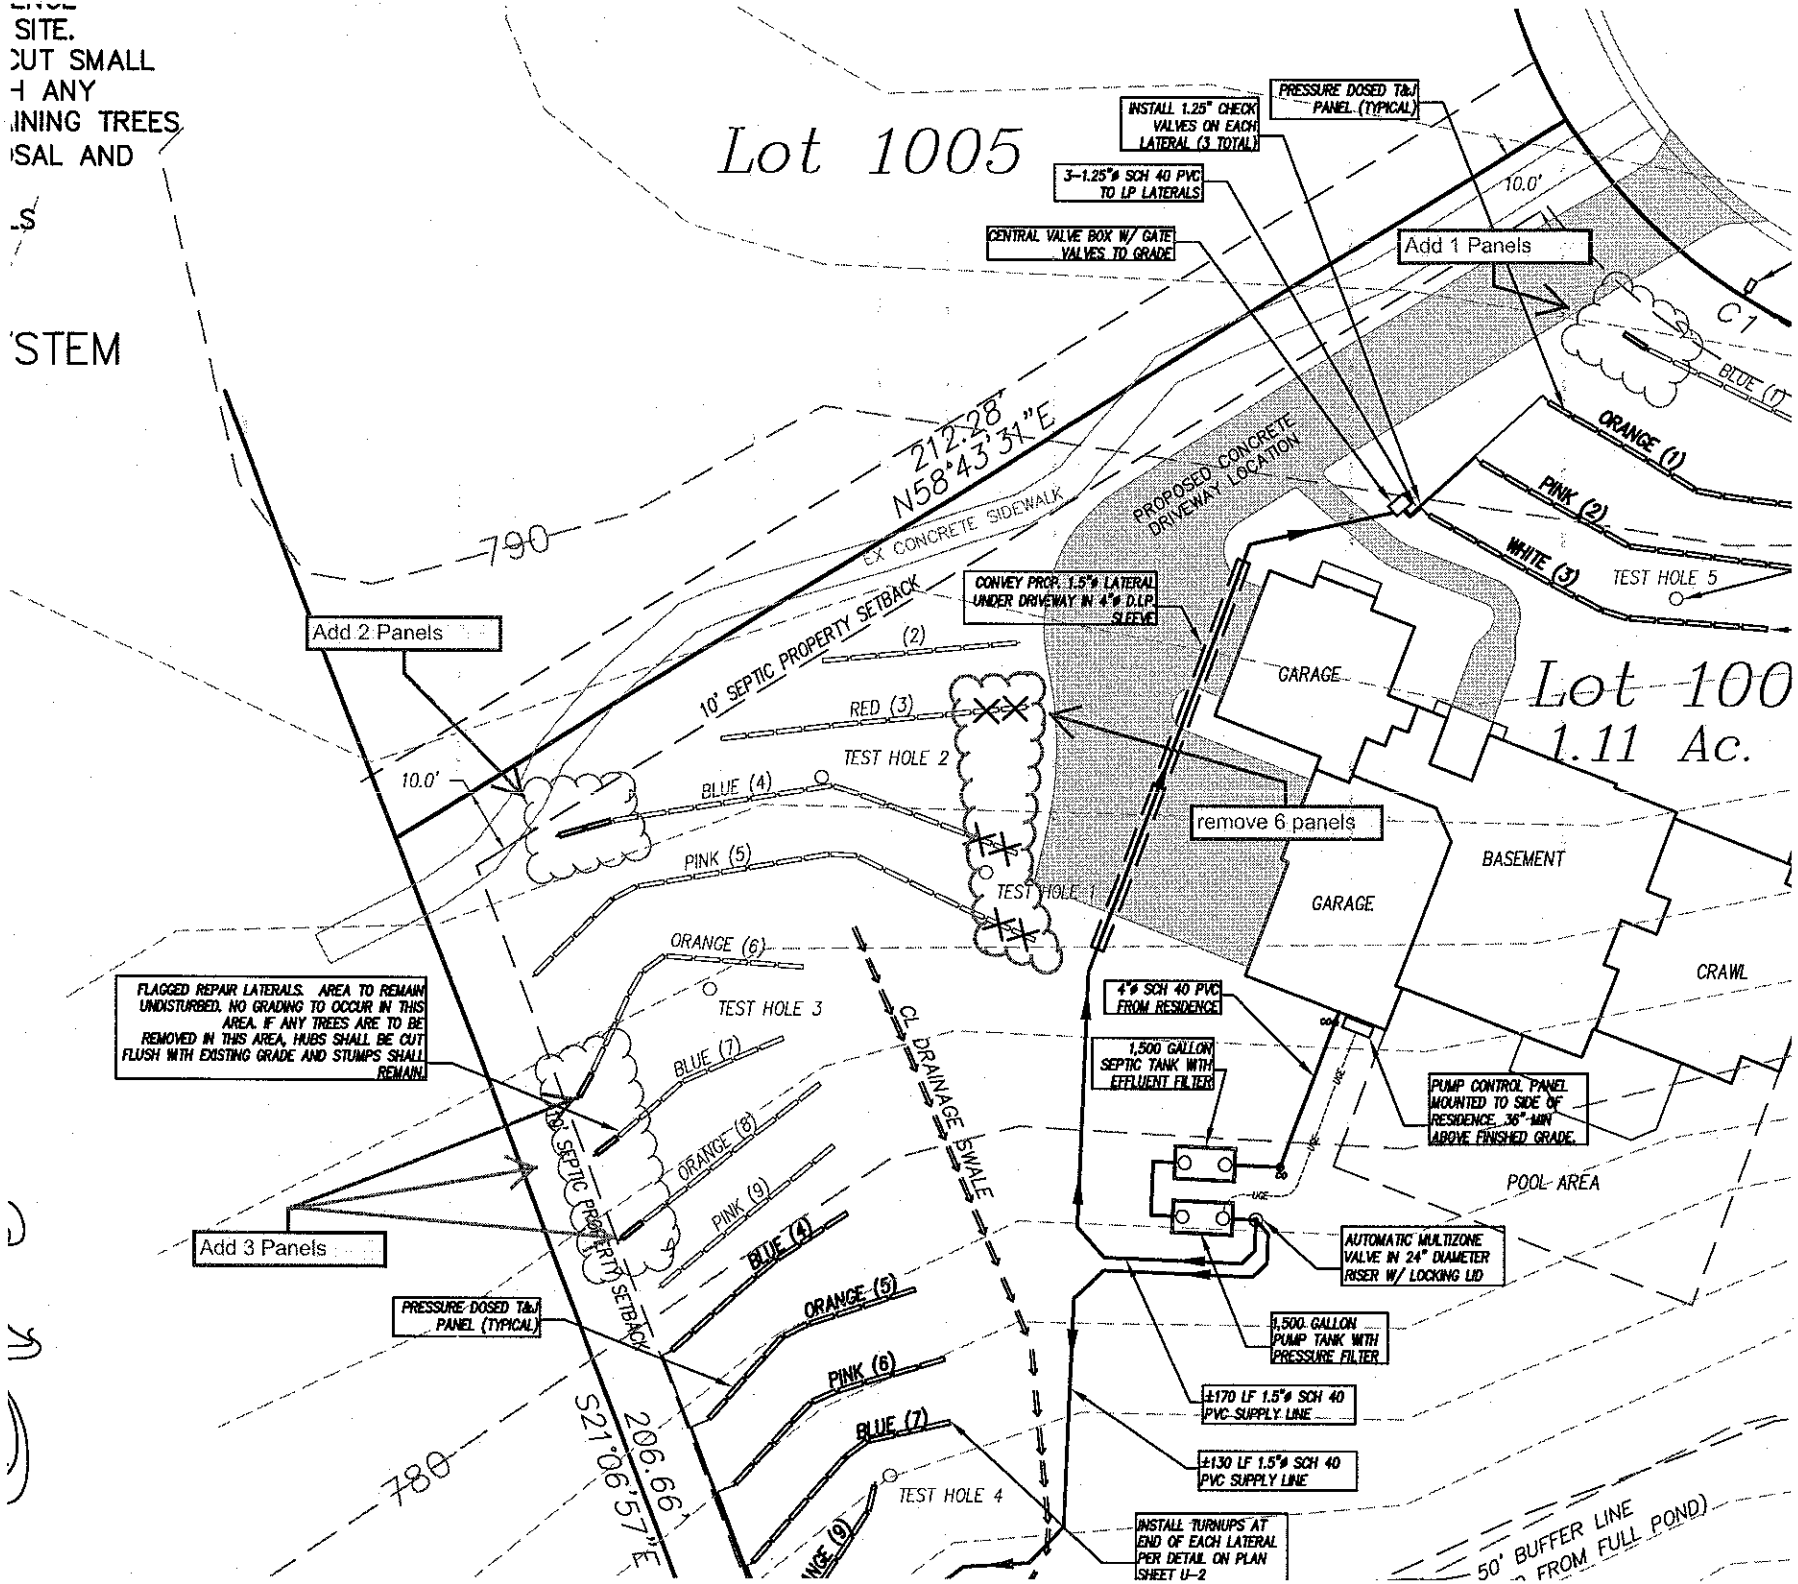

SITE.
UT SMALL
H ANY
INING TREES
SAL AND
S
STEM
Lot 1005
INSTALL 1.25" CHECK VALVES ON EACH LATERAL (3 TOTAL)
PRESSURE DOSED T&J PANEL (TYPICAL)
3-1.25"ø SCH 40 PVC TO LP LATERALS
CENTRAL VALVE BOX W/ GATE VALVES TO GRADE
Add 1 Panels
10.0'
C1
BLUE (1)
ORANGE (1)
PINK (2)
WHITE (3)
TEST HOLE 5
212.28'
N58°43'31"E
EX CONCRETE SIDEWALK
PROPOSED CONCRETE DRIVEWAY LOCATION
790
CONVEY PROP. 1.5"ø LATERAL UNDER DRIVEWAY IN 4"ø D.I.P. SLEEVE
Add 2 Panels
10' SEPTIC PROPERTY SETBACK
(2)
RED (3)
TEST HOLE 2
10.0'
BLUE (4)
PINK (5)
TEST HOLE 1
GARAGE
Lot 100
1.11 Ac.
remove 6 panels
BASEMENT
GARAGE
CRAWL
ORANGE (6)
TEST HOLE 3
FLAGGED REPAIR LATERALS. AREA TO REMAIN UNDISTURBED. NO GRADING TO OCCUR IN THIS AREA. IF ANY TREES ARE TO BE REMOVED IN THIS AREA, HUBS SHALL BE CUT FLUSH WITH EXISTING GRADE AND STUMPS SHALL REMAIN
BLUE (7)
ORANGE (8)
PINK (9)
CL DRAINAGE SWALE
4"ø SCH 40 PVC FROM RESIDENCE
1,500 GALLON SEPTIC TANK WITH EFFLUENT FILTER
PUMP CONTROL PANEL MOUNTED TO SIDE OF RESIDENCE, 36" MIN ABOVE FINISHED GRADE.
POOL AREA
Add 3 Panels
10' SEPTIC PROPERTY SETBACK
BLUE (4)
ORANGE (5)
PINK (6)
BLUE (7)
AUTOMATIC MULTIZONE VALVE IN 24" DIAMETER RISER W/ LOCKING LID
PRESSURE DOSED T&J PANEL (TYPICAL)
1,500 GALLON PUMP TANK WITH PRESSURE FILTER
±170 LF 1.5"ø SCH 40 PVC SUPPLY LINE
±130 LF 1.5"ø SCH 40 PVC SUPPLY LINE
780
S21°06'57"E
206.66'
TEST HOLE 4
INSTALL TURNUPS AT END OF EACH LATERAL PER DETAIL ON PLAN SHEET U-2
50' BUFFER LINE
FROM FULL POND)