DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Brian Jones
ADDRESS: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____
LOCATION OF SITE: Washam Pt Lot 2

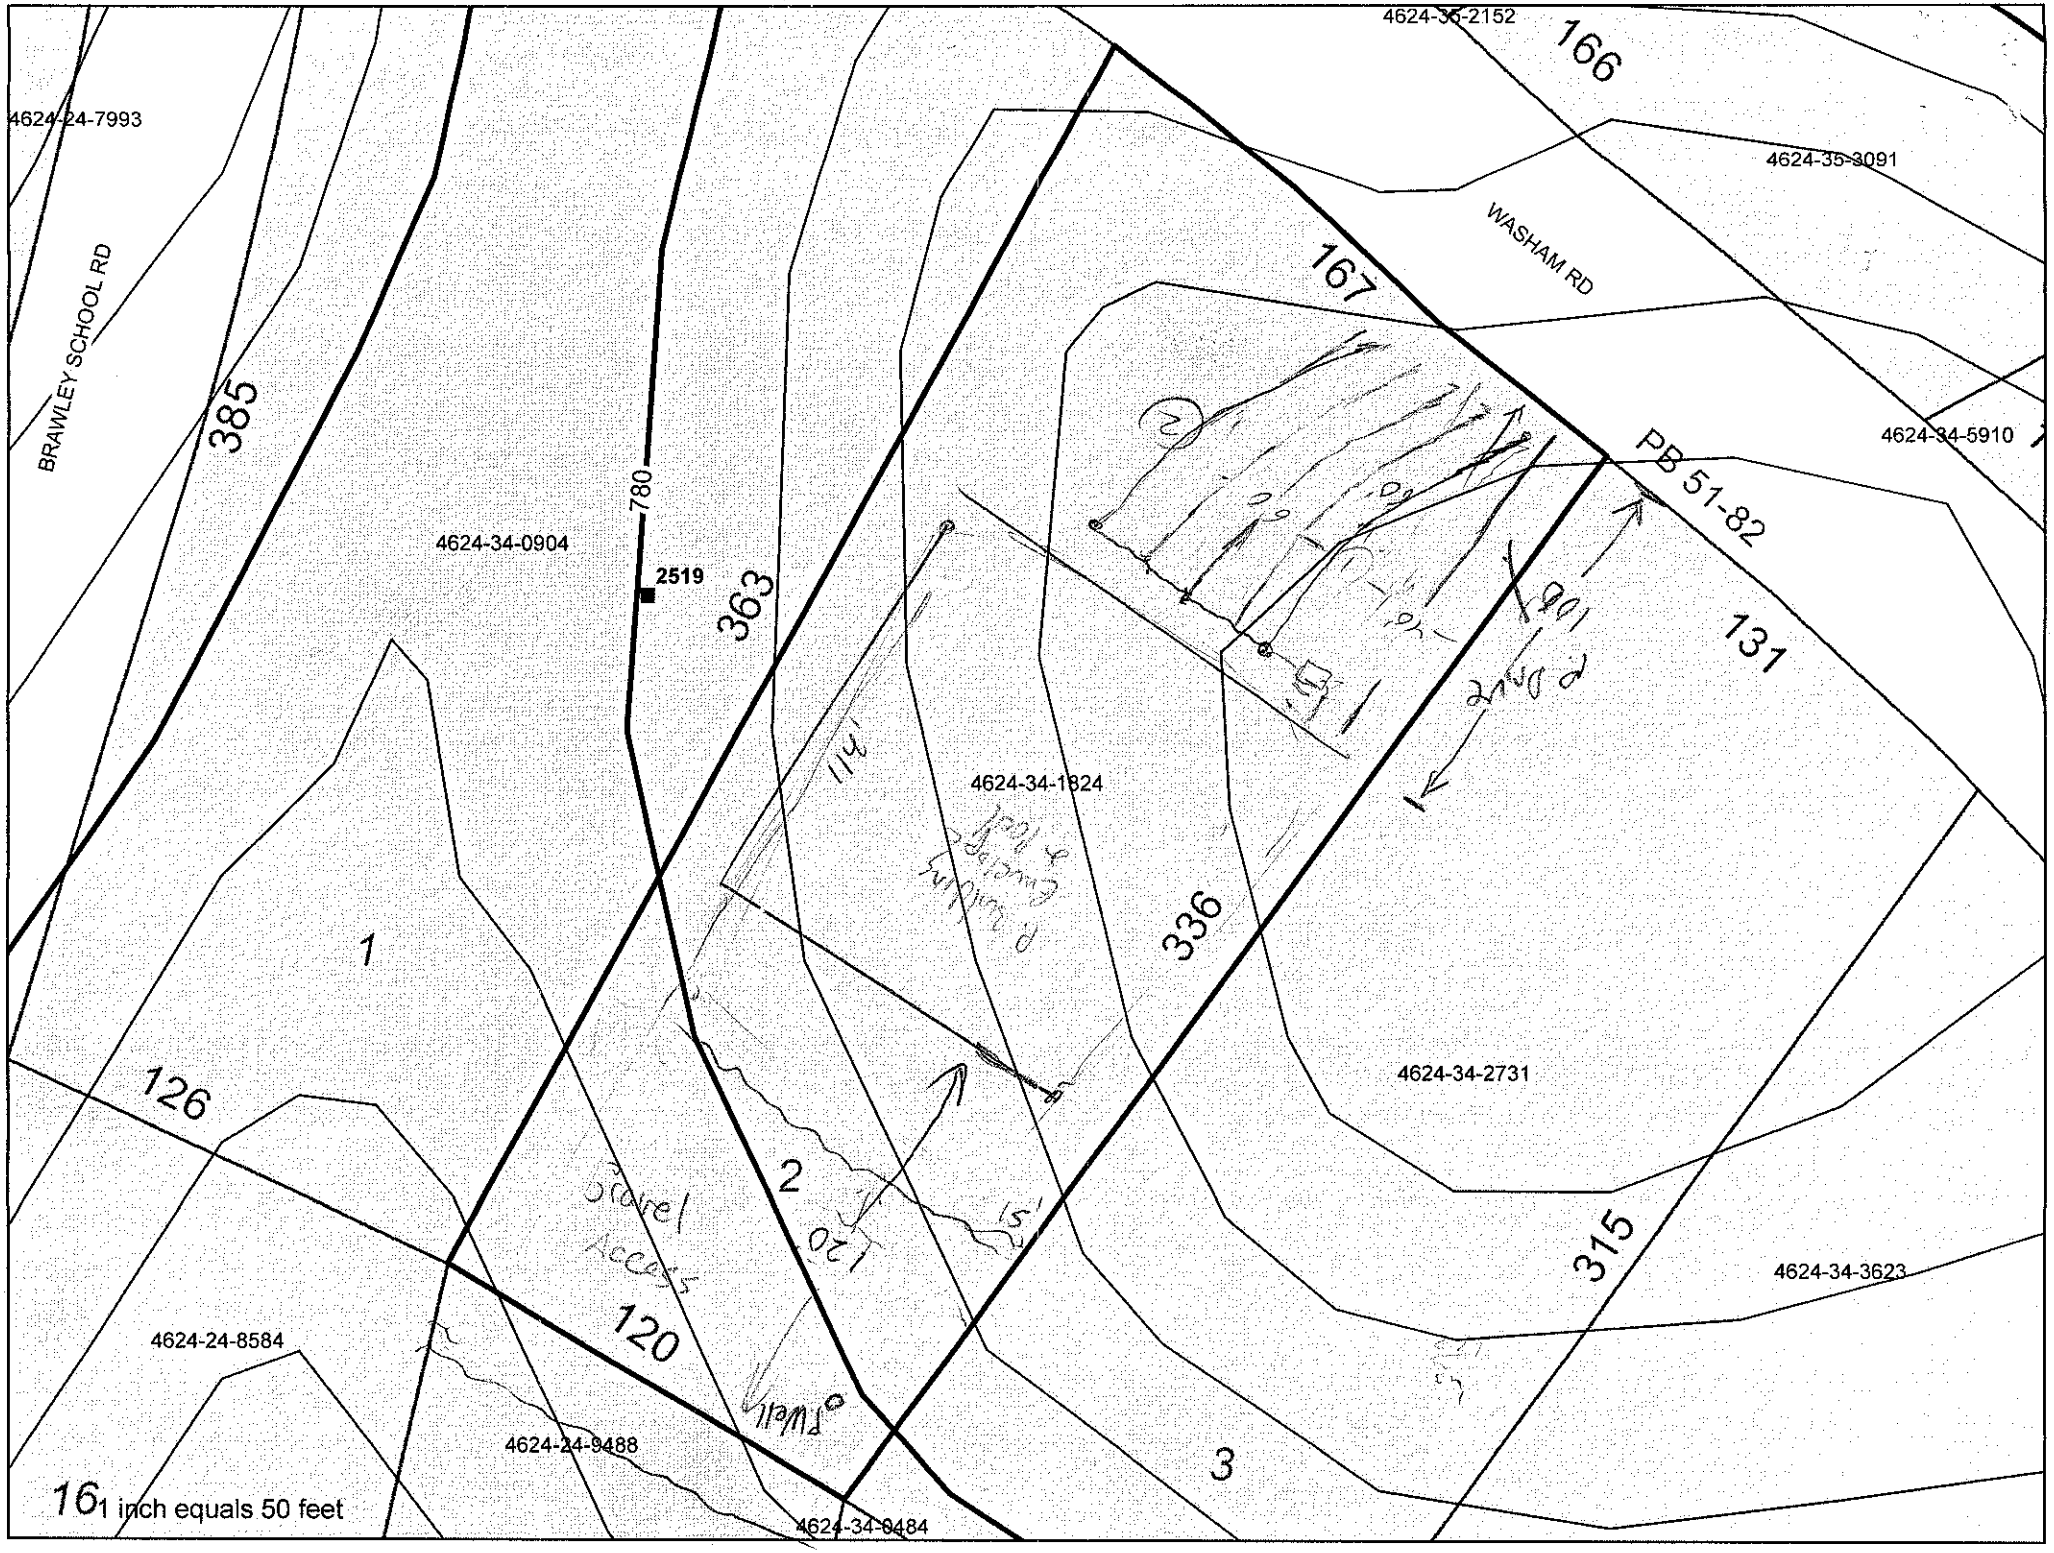
APPLICATION DATE _____
DATE EVALUATED: 11/8/07
PROPERTY SIZE: 1
PROPERTY RECORDED: _____

WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	L 2%	0-24	mSbk Red C	Pr SS Sp Sc Sy	Com Mica				PS .3
		24-48	mSbk Red C	Pr SS Sp Sc Sy					
2	L 2-3%	0-23	mSbk Red C	Pr SS Sp Sc Sy	Com Mica				PS .3
		23-98	m Abk/Sbk Red C	Pr SS Sp Sc Sy					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	25% Grav	25% Grav.
Size LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: Anthony Cotton
OTHER(S) PRESENT: _____


4624-36-2152
166
4624-24-7993
4624-35-3091
WASHAM RD
167
BRAWLEY SCHOOL RD
385
780
4624-34-5910
PB 51-82
4624-34-0904
2519
363
131
4624-34-1824
336
1
126
2
120
4624-34-2731
315
4624-34-3623
4624-24-8584
120
4624-24-9488
3
4624-34-0484
1 inch equals 50 feet