DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

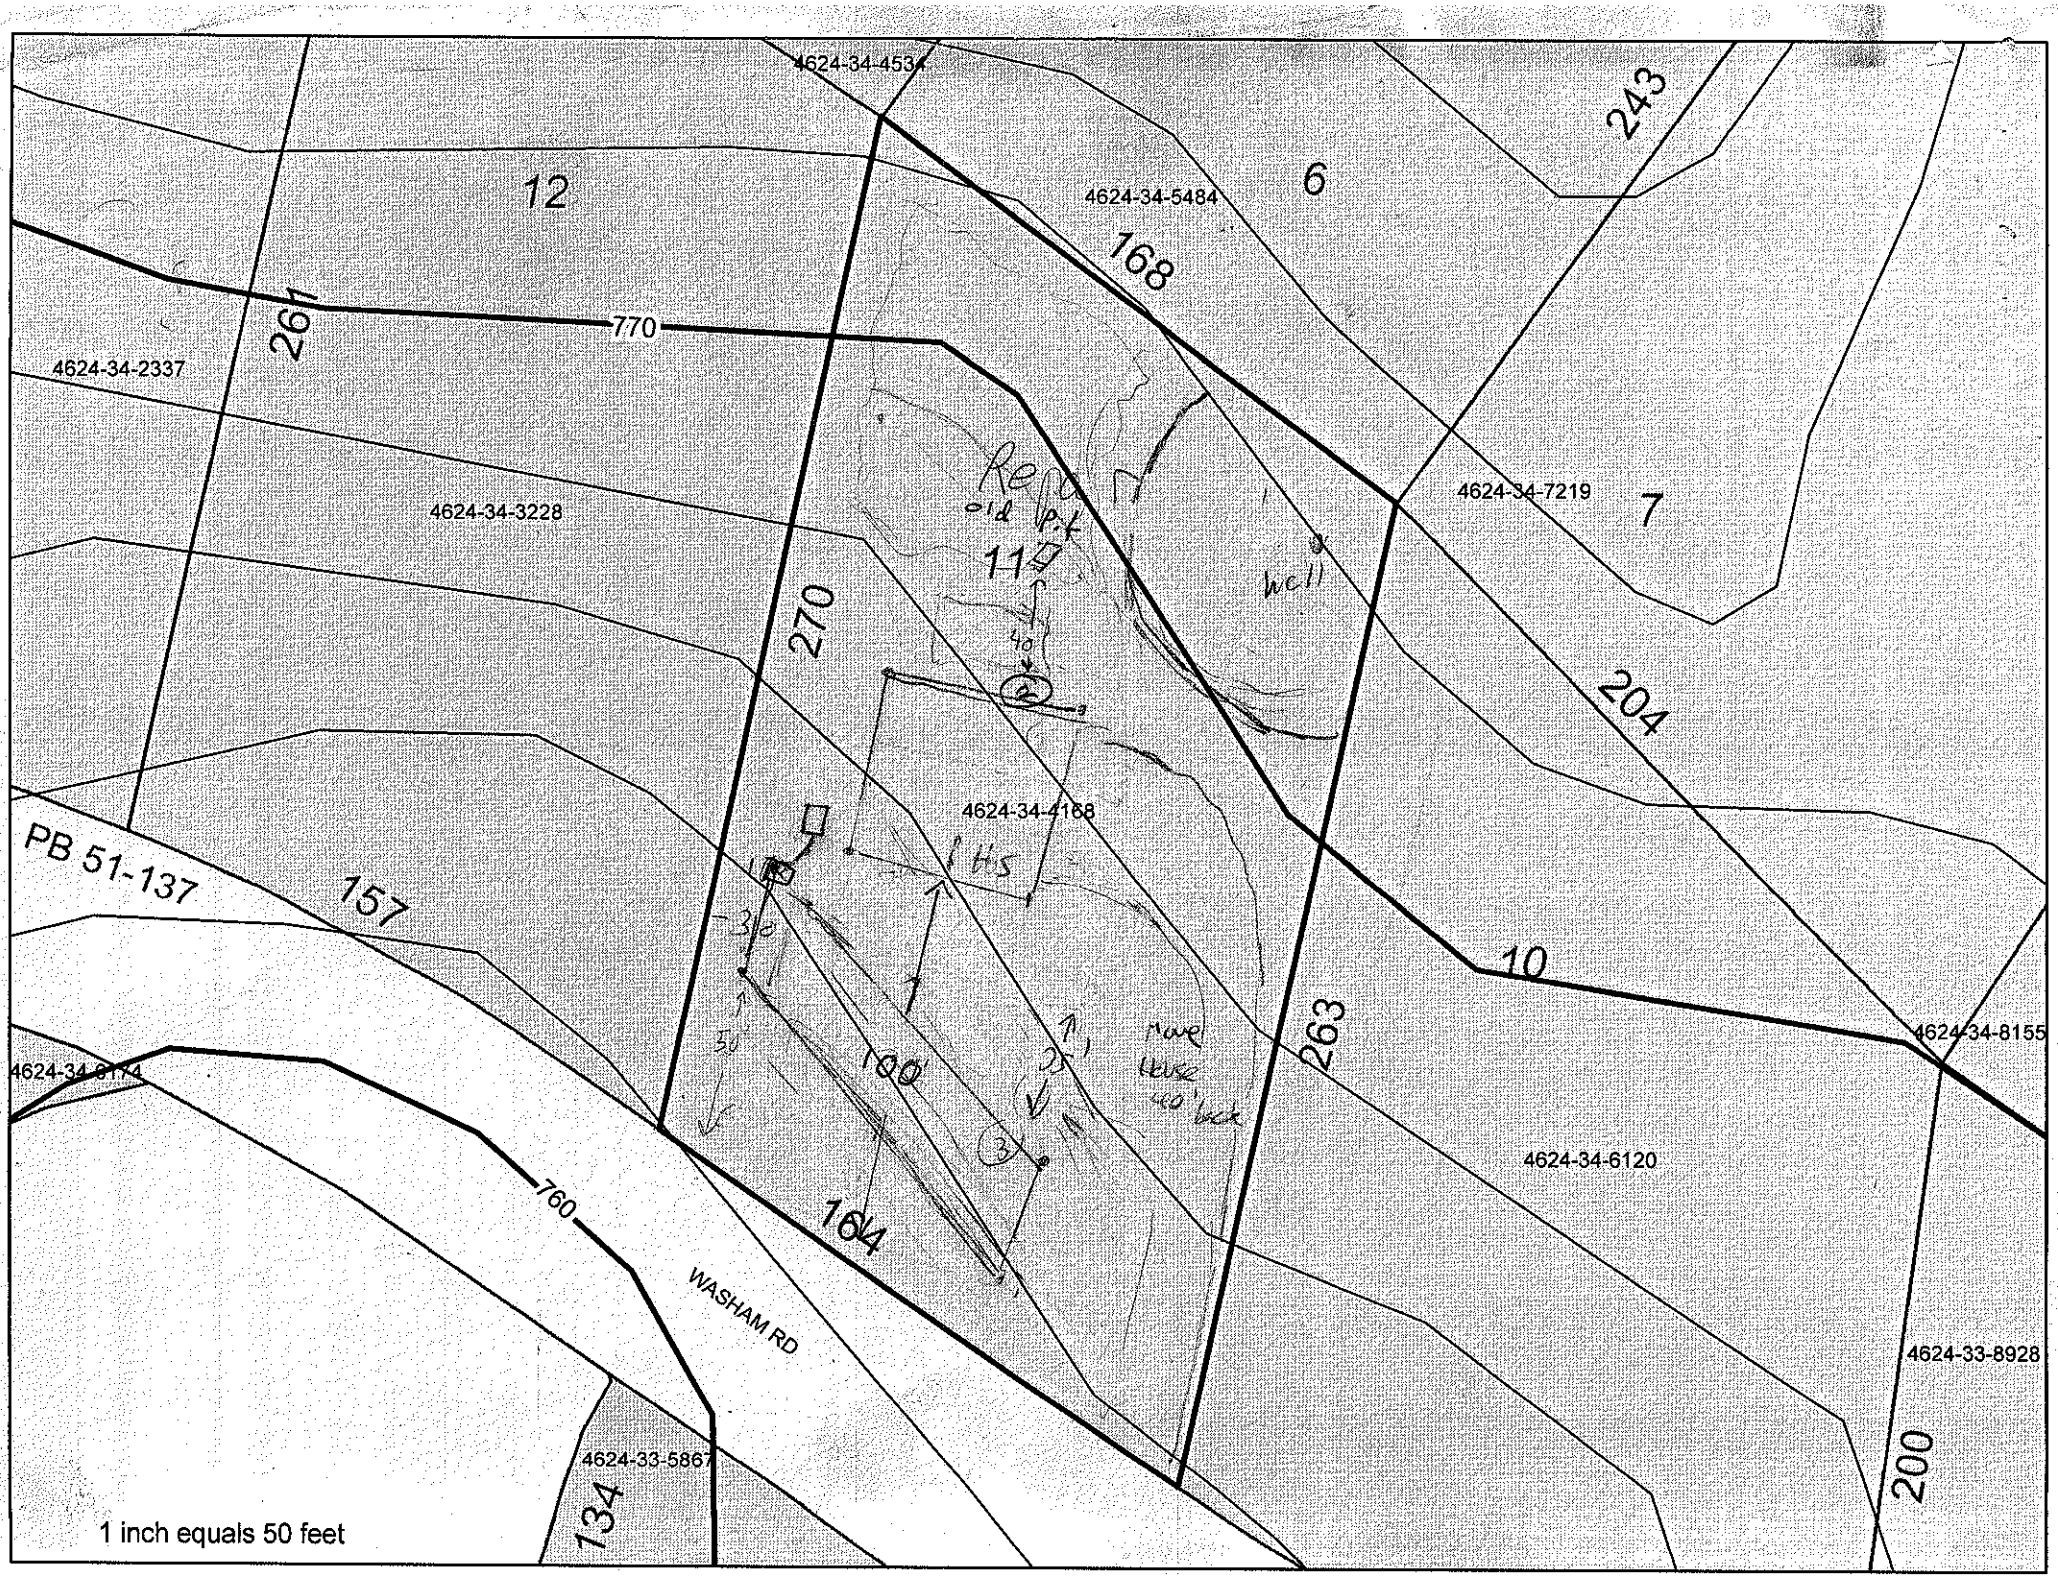
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Phillip Petro — APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 10/16/07
PROPOSED FACILITY: SFD — PROPOSED DESIGN FLOW (.1949): 480 — PROPERTY SIZE: _____
LOCATION OF SITE: Washam Pt Lot 11 — PROPERTY RECORDED: _____
WATER SUPPLY: ☑ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☑ Auger Boring ☑ Pit ☐ Cut — TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	ad Pit 4%	0-6	mAbk C	Pr 55 sp Sap					PS .275
		6-35	m sbk strong clay	Pr 55 sp Sap	Com mica				
		35-50	W sbk C	Pr 55 sp Sap	com mica com sap				
2	Auger 4%	0-14	fr scl	vPr 55 Mp	Rw Clay Rds				PS .3
		14-22	W sbk scl	vPr 55 sp					
		22-30	W sbk C	Pr 55 sp Sex	Rw mica				
		30-48	W sbk C	Pr 55 sp Sap	many mica				
3	3% L	0-15	mAbk C	Pr 55 sp Sex					PS .3
		15-25	W sbk/Abk C	Pr 55 sp Sex	Rw Sap mica				
		25-48	W sbk C/C	Pr 55 sp Sap	com sap mica				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Conv.	Pump 25%
Site LTAR	.3	.275

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Anthony Cole Jr
OTHER(S) PRESENT: Owner Phillip Petro


4624-34-4534
12
6
4624-34-5484
243
168
291
770
4624-34-2337
4624-34-3228
4624-34-7219
7
Rem
old pt
114
well
40
270
204
4624-34-4168
PB 51-137
757
30
1 HS
10
263
100'
50
25
mobile
house
40' back
4624-34-8155
4624-34-6174
4624-34-6120
760
164
WASHAM RD
4624-33-8928
4624-33-5867
134
200
1 inch equals 50 feet