

© Copyright 2006 Dominick Tringali Architects, Inc
expressly reserves its common law copyright and
other property rights in these plans. These plans
are not to be reproduced, changed or copied in any
form or manner whatsoever, nor are they to be
assigned to any third party without first obtaining
the express written permission and consent of
Dominick Tringali Architects

Acknowledgement Of
Plans Submittal ONLY!
Date 4-11-07
Date 4-11-07

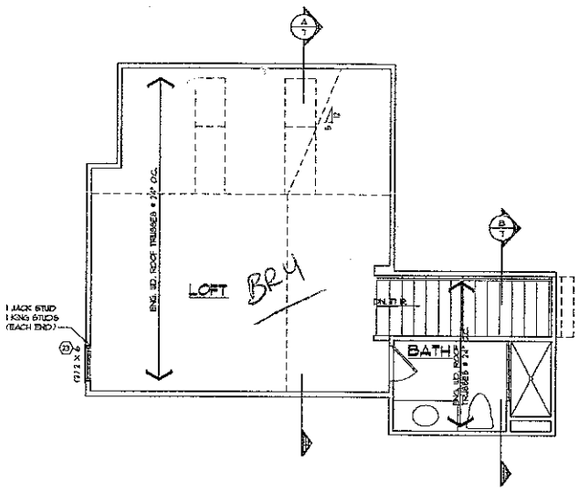


SECOND FLOOR PLAN (STRUCTURE)

SCALE: 1/4" = 1'-0"

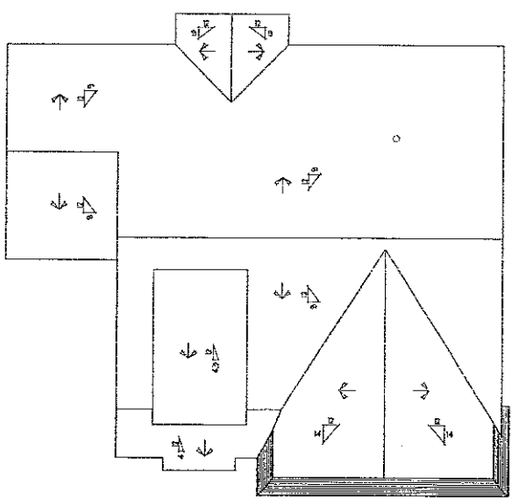

ROOF PLAN

SCALE: 1/8" = 1'-0"

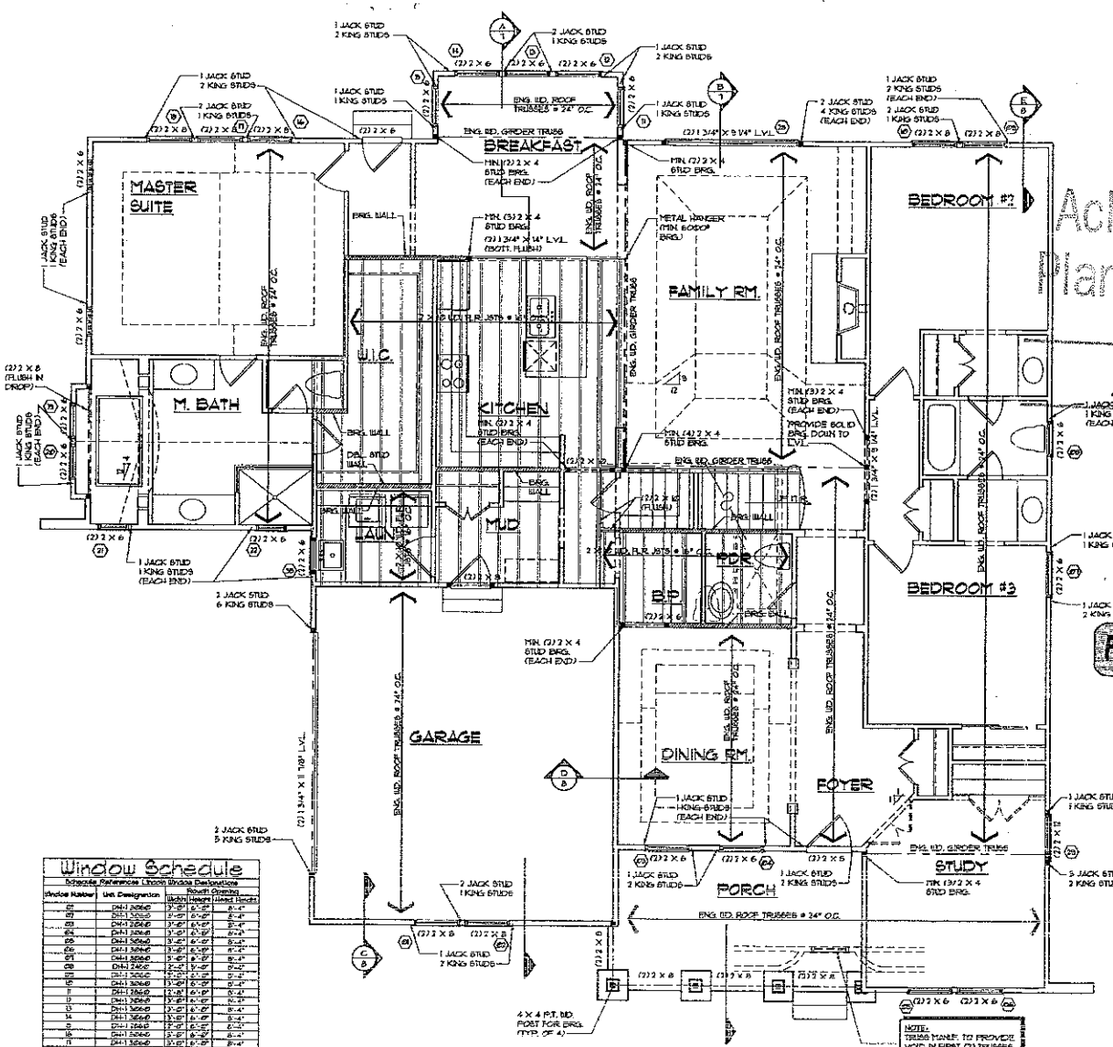

FIRST FLOOR PLAN (STRUCTURE)

SCALE: 1/4" = 1'-0"

Window Schedule

Schedule Reference: Lincoln Window Designations
Rough Openings

Window Number	Unit Designation	Width	Height	Head Height
01	DH-1 3068	3'-0"	6'-8"	8'-4"
02	DH-1 3068	3'-0"	6'-8"	8'-4"
03	DH-1 3068	3'-0"	6'-8"	8'-4"
04	DH-1 3068	3'-0"	6'-8"	8'-4"
05	DH-1 3068	3'-0"	6'-8"	8'-4"
06	DH-1 3068	3'-0"	6'-8"	8'-4"
07	DH-1 3068	3'-0"	6'-8"	8'-4"
08	DH-1 2468	2'-0"	6'-8"	8'-4"
09	DH-1 2468	2'-0"	6'-8"	8'-4"
10	DH-1 3068	3'-0"	6'-8"	8'-4"
11	DH-1 3068	3'-0"	6'-8"	8'-4"
12	DH-1 3068	3'-0"	6'-8"	8'-4"
13	DH-1 3068	3'-0"	6'-8"	8'-4"
14	DH-1 3068	3'-0"	6'-8"	8'-4"
15	DH-1 2868	2'-8"	6'-8"	8'-4"
16	DH-1 3068	3'-0"	6'-8"	8'-4"
17	DH-1 3068	3'-0"	6'-8"	8'-4"
18	DH-1 3068	3'-0"	6'-8"	8'-4"
19	DH-1 3068	3'-0"	6'-8"	8'-4"
20	DH-1 3068	3'-0"	6'-8"	8'-4"
21	DH-1 3068	3'-0"	6'-8"	8'-4"
22	DH-1 3068	3'-0"	6'-8"	8'-4"
23	DH-1 3068	3'-0"	6'-8"	8'-4"
24	DH-1 2468	2'-0"	6'-8"	8'-4"
25	DH-1 2468	2'-0"	6'-8"	8'-4"
26	DH-1 3068	3'-0"	6'-8"	8'-4"
27	DH-1 3068	3'-0"	6'-8"	8'-4"
28	SL GLS DH 4868	4'-0"	6'-8"	8'-4"
29	DH-1 3068	3'-0"	6'-8"	8'-4"
30	DH-1 3068	3'-0"	6'-8"	8'-4"

ATTIC VENTILATION CALCULATIONS:

AREA OF ATTIC SPACE = 3600#
3600#/300 = 12 (SQ. FT. REQ'D)
12 X 144 = 1688" (SQ. INCH CONVERSION)
1656" X 1/3 = 576" (SQ. INCHES REQ'D)
576" / 18 = 54' (LINEAR FT. OF RIDGE VENT REQ'D)

PER IRC SECTION 806.2 THE TOTAL AREA IS PERMITTED TO BE REDUCED TO 1/300 PROVIDED AT LEAST 50% + NO MORE THAN 80% OF THE REQUIRED VENTILATING AREA IS PROVIDED BY THE VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS

NOTE:
PROVIDE 1 JACK STUD AND 1 KING STUD ON EACH SIDE OF ALL EXTERIOR WINDOWS AND DOORS (UNLESS NOTED OTHERWISE)

NOTE:
ALL INTERIOR DOORS AND ARCHES IN NON-BEARING WALLS TO HAVE MIN. (2) 2 X 4 HEADER (UNLESS NOTED OTHERWISE)

NOTE:
☒ = POINT LOAD
▨ = BRG WALL

NOTE:
TRUSS MANUF. TO HOLD TRUSS LENGTH BACK 1/2" FROM EA. END (FOR SHEATHING TO EXTEND)

FOR PERMIT ONLY
Feb 16, 2007

DOMINICK TRINGALI ARCHITECTS
1550 Telegraph Road Suite 250
Bloomfield Hills MI 48302
Tel 248 335 8888
Fax 248 335 0944
www.DTArchitects.com

DOMINICK ROBERT TRINGALI
REGISTERED ARCHITECT
9782
NORTH CAROLINA
U.S.A.

SCONSET VILLAGE
ARLINGTON
ELEVATION C

Review Set: 2-05-07
Permit:
Final Set: 2-16-07
Revisions:

Drawn: K.B.
Chkd: M.G.
Job No: 07004
Sheet No: 5 OF 11

2/16/2007 4:50:50 PM, Copyright 2006 Dominick Tringali Architects, Inc.