DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

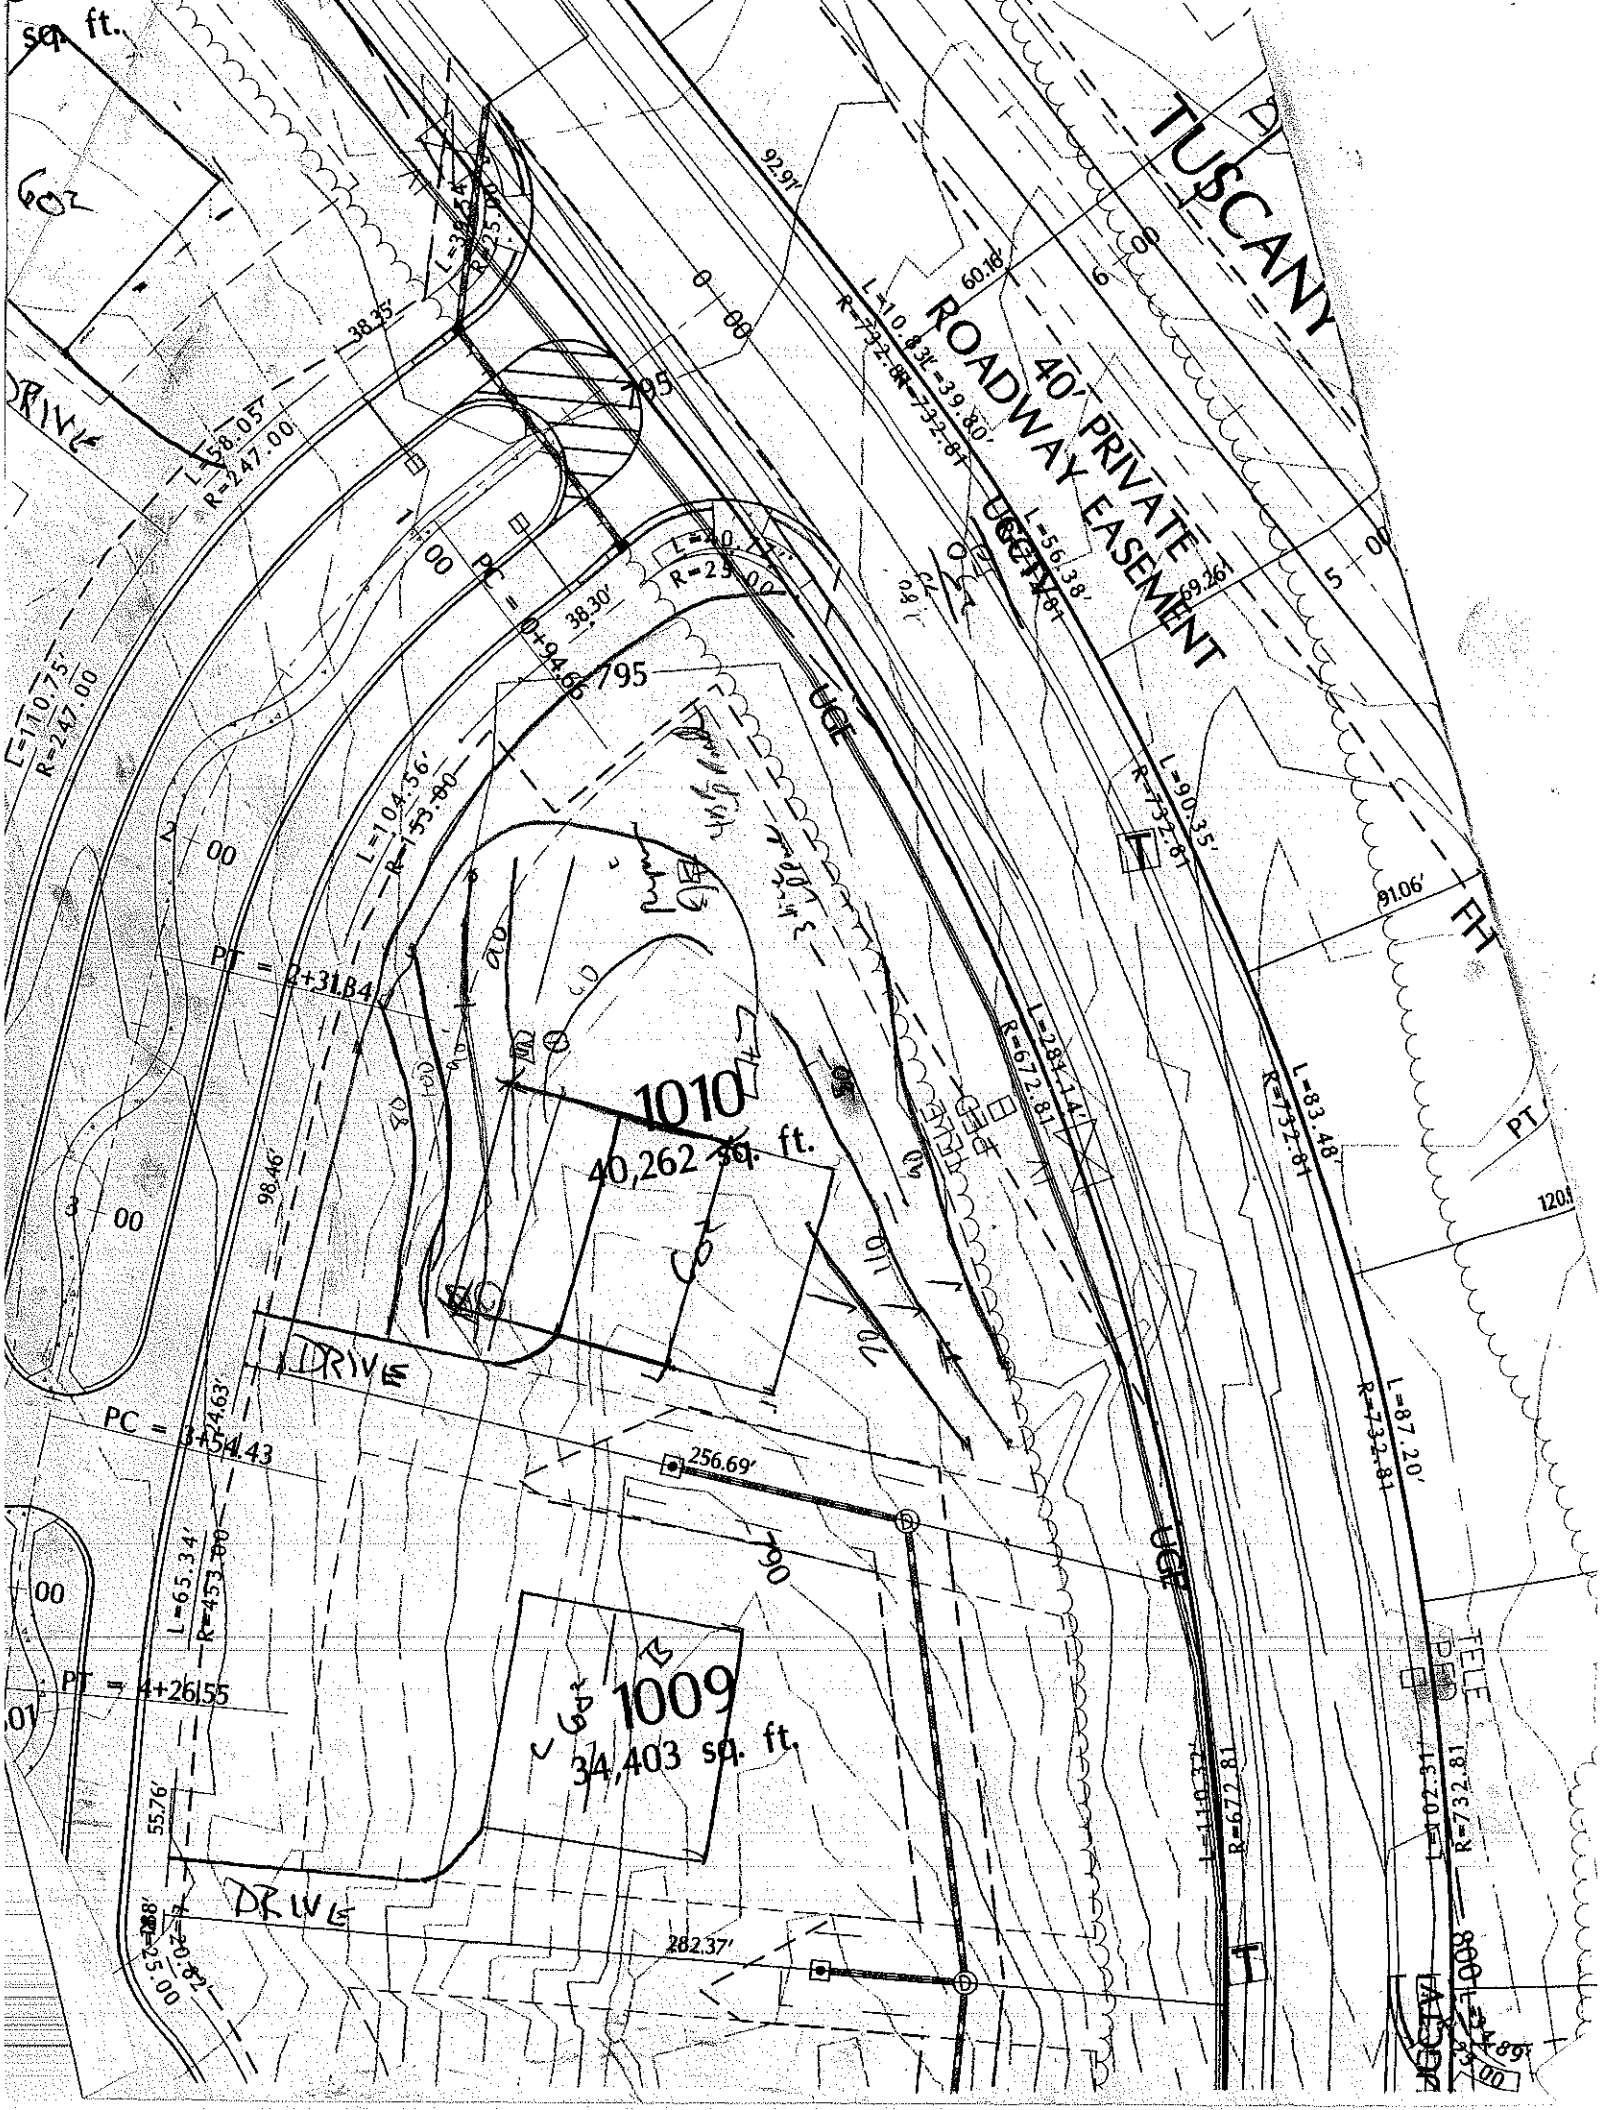
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 1010 Po. A PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-24	BSCL VR	fri SSSP					PS -3
		24-54	RC SCL	fri SSSP					
2		0-5	BSCL VR	fri SSSP					PS -3
		5-33	RC SCL	fri SSSP					
		33-48	RC mt SCL	fri SSSP					
3		0-4	BSCL VR	fri SSSP					PS -3
		4-27	RC SCL	fri SSSP					
		27-58	RC mtg SCL	fri SSSP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


TUSCANY
40' PRIVATE ROADWAY EASEMENT
1010
40,262 sq. ft.
1009
34,403 sq. ft.
DRIVE
DRIVE
DRIVE
PC = 3+54.43
PT = 4+26.55
PT = 2+31.84
PC = 0+94.66
L=110.75'
R=247.00
L=58.05'
R=247.00
L=65.34'
R=453.00
L=104.56'
R=153.00
L=38.30'
R=25.00
L=39.80'
R=732.81
L=56.38'
L=90.35'
R=732.81
L=87.20'
R=732.81
L=83.48'
R=732.81
L=110.32'
R=672.81
L=102.31'
R=732.81
L=28.14'
R=672.81
256.69'
282.37'
92.91'
60.18'
69.26'
91.06'
98.46'
55.76'
38.35'
UGE
795
800
790
PT
PT