892-5741
2:00.
Bobby Mayhew

09466

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR James T. Webb DATE Jan 25, '89 PERMIT NO. ______

PHONE: Business ______ Home ______

LOCATION 1100 TR 1236 (Stonemaker) TR Tiger Lane on Rt. S. R. No. ______

SUBDIVISION NAME CL&T Lake Norman LOT NO. 1692 SECTION OR BLOCK NO. 6

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ PS Yes (✓) No ( )

Character & Porosity of Soil clay

Percolation Rate ~3


Topography ~4%

Depth to Water Table 4'+

Rock or other impervious formations none obs.

Lot Area ~1 AC.

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

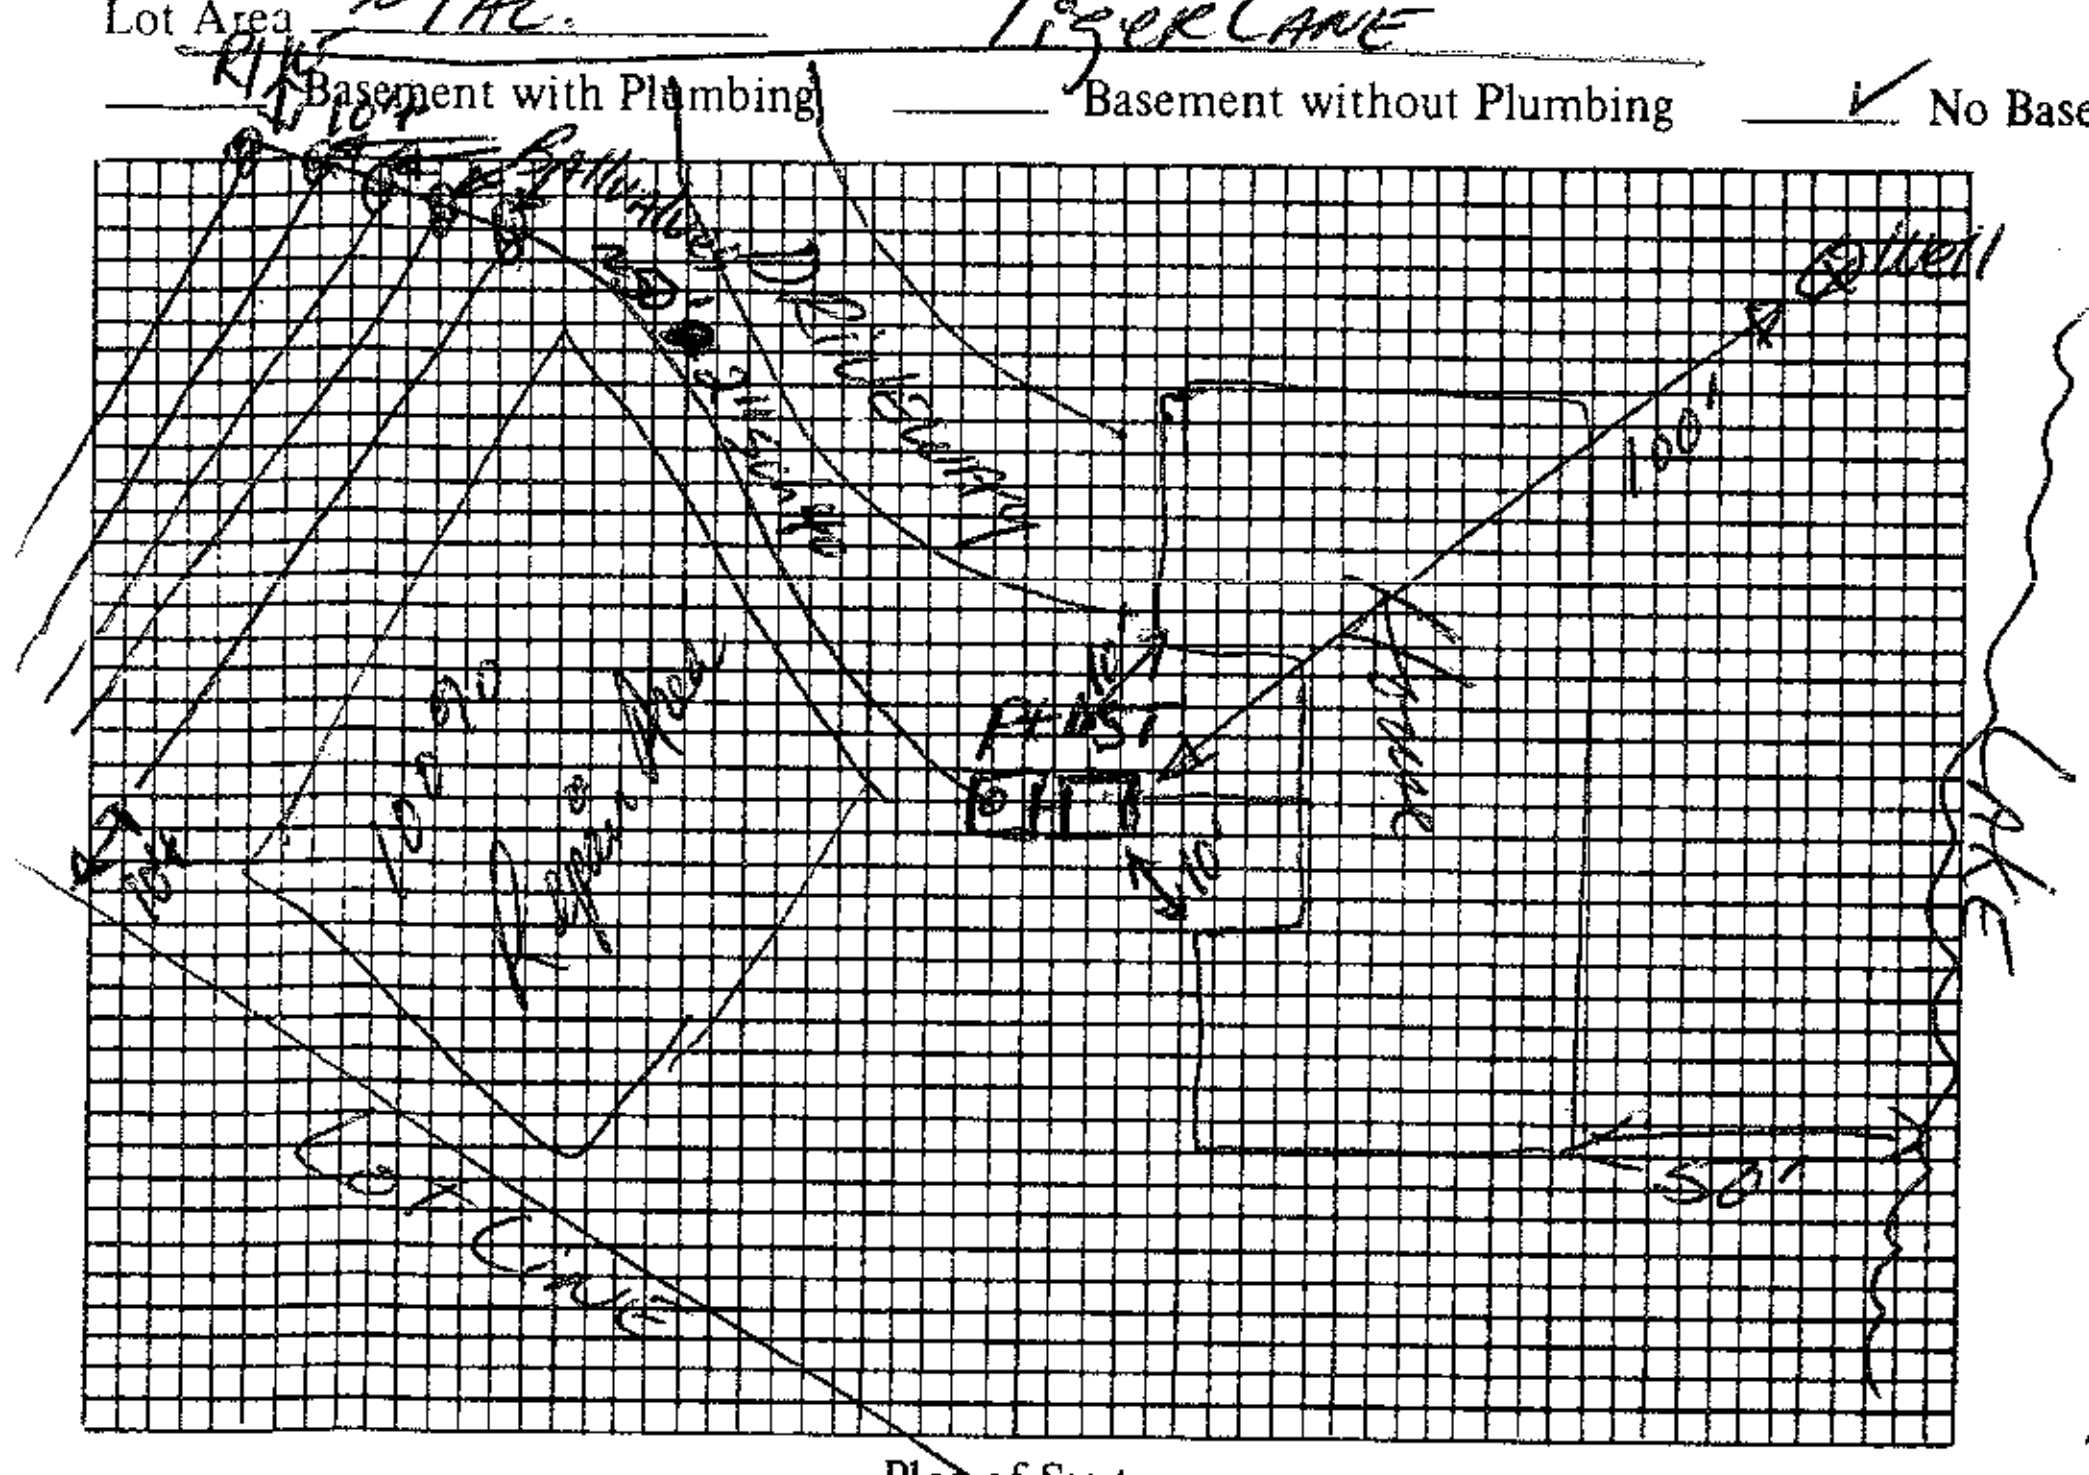

Plot of System

1500 p.t.

Size of Tank 1500 Gals.

Nitrification Field:

No. of Lines ~5

Sq. Ft. 1602 Linear Ft. 534 *

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

* pressure-dosed

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: R. C. Eller

Pump specs: 44 gal/min at approx. 22' TDH
2 foot pressure head per ditch

IMPROVEMENTS PERMIT BY D. R. Hanson, RS

COMMENTS: Pressure-dosed conventional type drainfield. 1¼" or 1½" sch 40 down the center of each ditch with one 5/32" hole every 5 feet. The first hole in each ditch to start 5 feet from the valve; the stone is to start 2 feet from the valve. Follow contour with lines. Trench bottom depth → 30".

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold