IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5281

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PERMIT# 109595 PIN# ~~4624-27-5905.000~~ 4624-47-7598 DATE Jan 14,03

OWNER OR CONTRACTOR Crescent Resources Inc / The Point on Norman / HH PHONE: Business _____ Home _____

ADDRESS 2214 Brawley Sch Rd. Mooresville, N.C. 28117

LOCATION Brawley Sch Rd. TL Torrence Chapel Rd. on Right

SUBDIVISION The Point BLOCK / SECTION 11 LOT 1108 LOT AREA 46,367 ft² SITE CLASS. PS DESIGN FLOW 480 gpd L.T.A.R. .25

Septic Tank: 1000 Gallons; STB 338 Date 6-29-04
Pump Tank: 1000 Gallons; PT 283 Date 7-24-04
Pump Make: Goulds Model _____ Serial No. _____
Nitrification Field: No Fields 1 Square Feet 640/960 Linear Feet 320
No Lines 4 Trench Width 24" min 8'oc Max Trench Bottom Depth 36" Gravel Depth NR

☑ New System ☐ Repair System Type: I, II, III, ⓘ V, VI
System Description: LPP BPS
Repair System Description: SAME
Maintenance Agreement Required: ☑ Yes ☐ No


☑ House/Mod. Home No. Bedrooms 4
☐ Mobile Home No. Bathrooms 4
☐ Business No. Employees ____
☐ Other _____
☐ Slab ☑ Crawl Space ☐ Basement w/plumbing ☐ Basement wo/plumbing

Water Supply: ☐ Individual ☑ Public ☑ Community

Comments:/Conditions: OR 36" MAX 9'oc
REAR YARD Not EVALUATED


Comments:/Conditions: Reviewed Building plans & Site plans 4/30/04 IP, essentially in Compliance with Checked lines 8/24/04 MP 3/16" hole drilled

1"=50' INITIAL SITE SKETCH

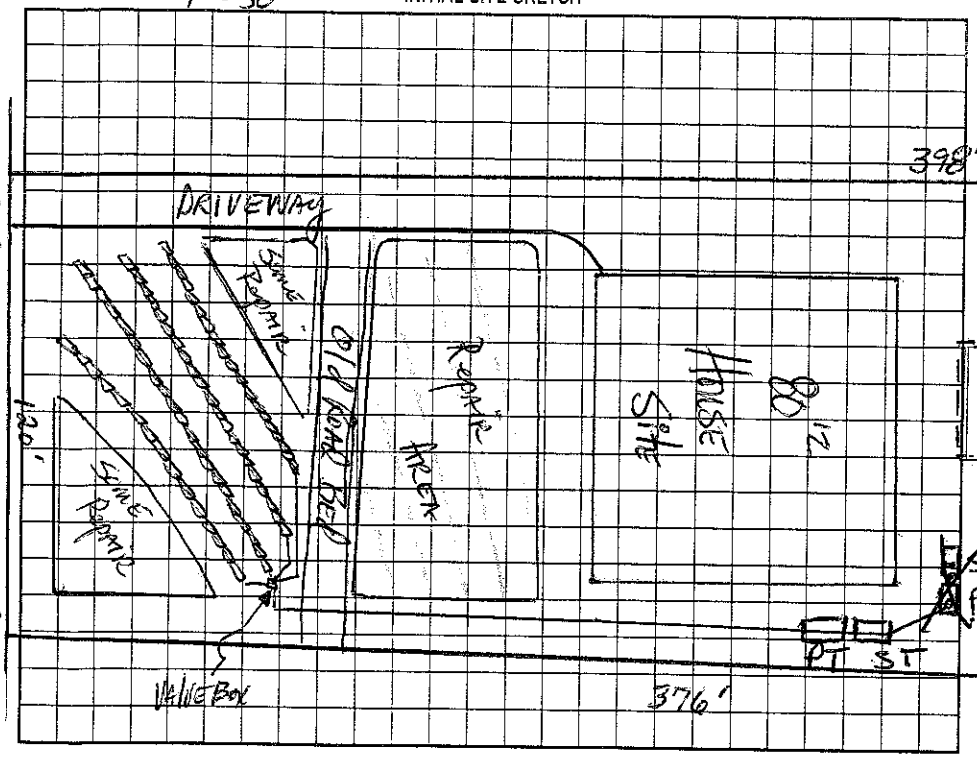

AS/BUILT SKETCH

Installed as Drawn

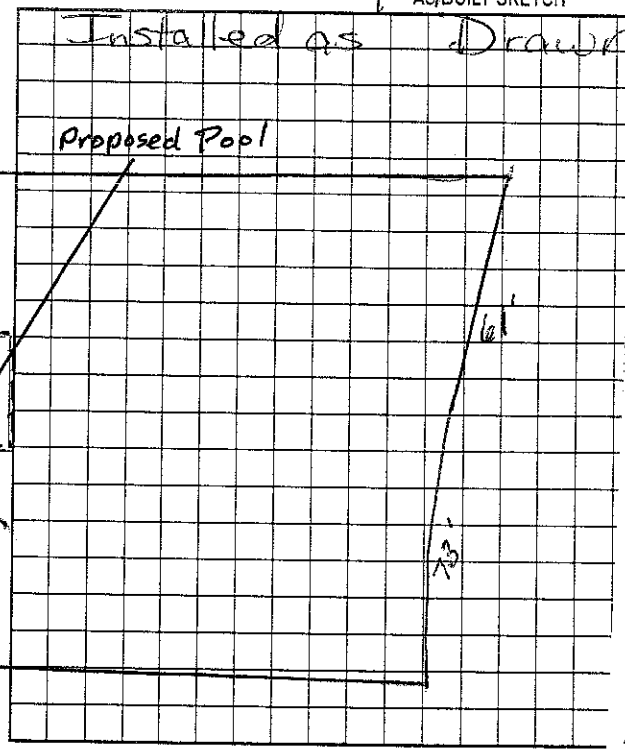

Location of the proposed Pool addition does not appear to impact the existing on-site septic system.**NOTE: Shall be min. 15' from tanks
Date: 11-12-03 REHS
ICHD-Environmental Health Division

Permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit with plat valid without expiration. Improvement Permit with site plan valid for sixty months. Authorization to Construct is valid for a period equal to that of Improvement Permit – not to exceed sixty months.

Signed: _____ date 4/30/03 Installed by: Bobby Mayhew

Improvement Permit by: _____ date Jan 14,03 Operation Permit by: Maina H Dotson RS date 10/14/04

Authorization to Construct by: Maina H Dotson RS date 4/30/04 Existing System Inspection by: _____ date _____

HEALTH DEPT. COPY: WHITE OWNER COPY (FINAL): YELLOW OWNER COPY (INITIAL): PINK