DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

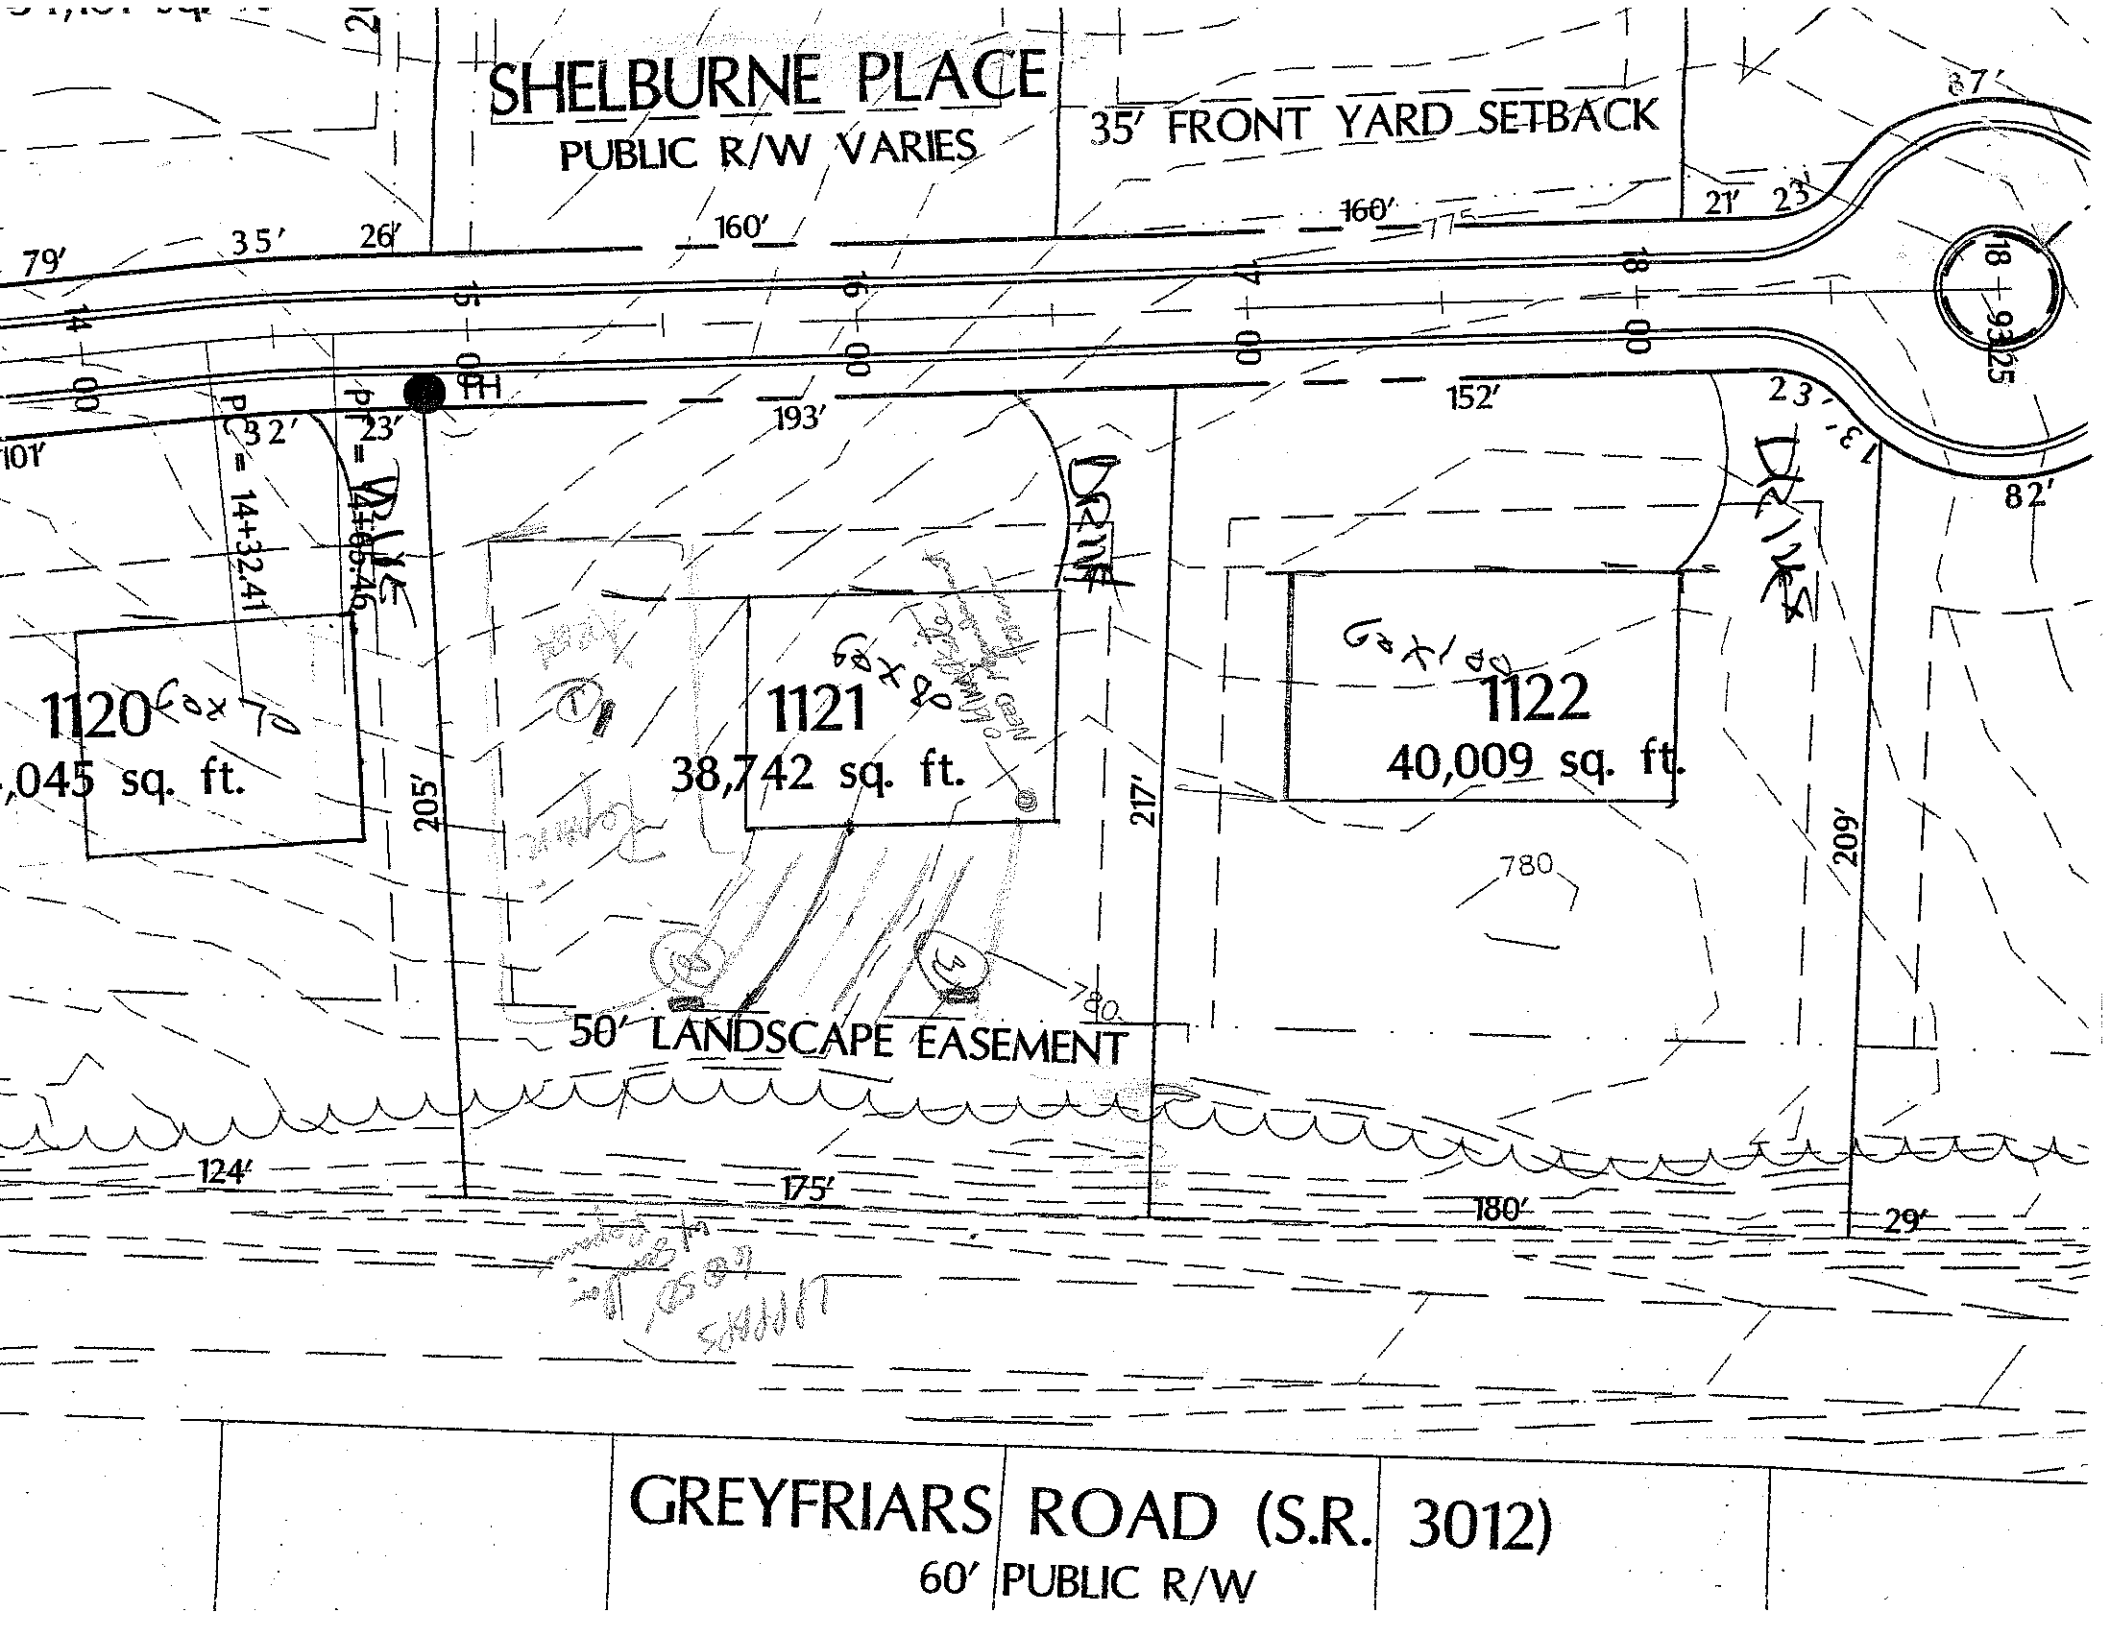
OWNER: CRI APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 12-16-02
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4600 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 112 Phase II Trail PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-13	wk fine gran-sbkn sl/sl fr sss p						≥.3
		13-48	wk sbk RC	fr sss p					
2	4-6%	0-6	sg gran sl	fr sss p					≥.3
		6-27	wk-mod sbk RC	fr sss p					
		27-55	mk sbk yel	fr sss p common mi sp					
3		0-4	sg gran sl	fr sss p					≥.3
		4-32	mk sbk RC	fr sss p					
		32-53	mod wk sbk RCh	fr sss p few common mi sp					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)	LPP BPS	LPP BPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS per. 1956
EVALUATED BY: DHH
OTHER(S) PRESENT: Paul Pennington

COMMENTS: _____


SHELBURNE PLACE
PUBLIC R/W VARIES
35' FRONT YARD SETBACK
160'
160'
79'
35'
26'
193'
152'
205'
217'
209'
1120
,045 sq. ft.
1121
38,742 sq. ft.
1122
40,009 sq. ft.
50' LANDSCAPE EASEMENT
124'
175'
180'
29'
82'
GREYFRIARS ROAD (S.R. 3012)
60' PUBLIC R/W