11319

4624887997

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Bost Bldg Co. DATE 7/18/90 PERMIT NO. 2C-1-B-6

PHONE: Business _____ Home _____

LOCATION 1100 TL 1101 (Yacht Rd) ~ 1mi on right

SUBDIVISION NAME Yacht Harbor S. R. No. _____

LOT NO. 6 SECTION OR BLOCK NO. _____


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil FS clay
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate N .35
Auto. Wash. Machine	Yes (✓)	No ( )	Topography 2-4%
Site Suitable	Yes (✓)	No ( )	Depth to Water Table 4'+
			Rock or other impervious formations none obs.

Lot Area _____

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

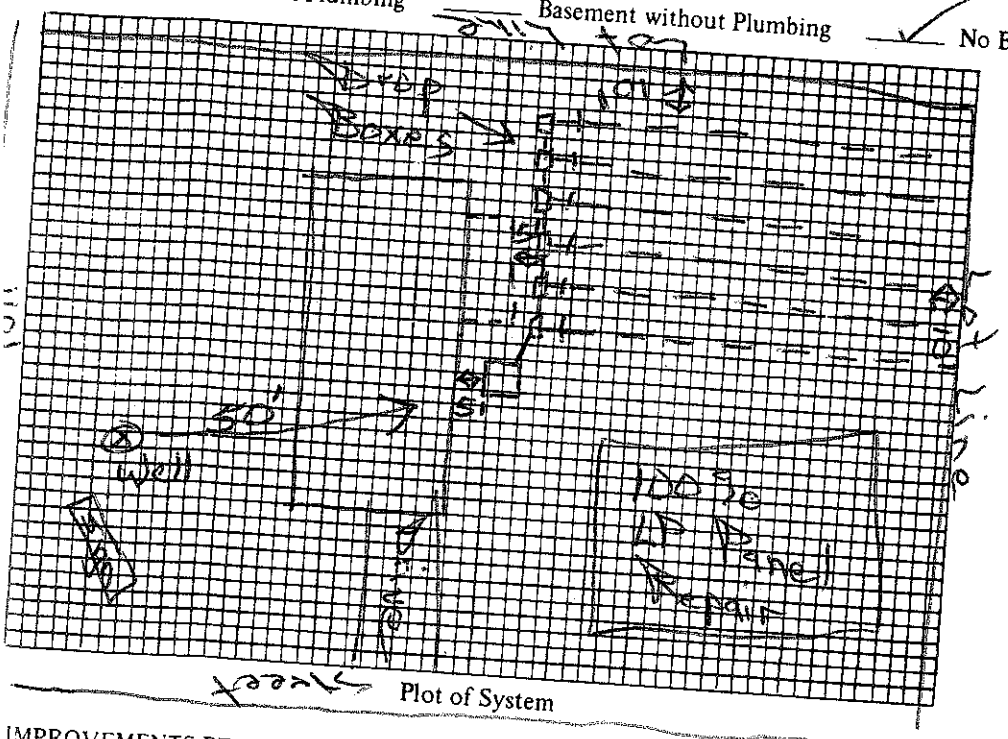

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 5-6

Sq. Ft. 1050 Linear Ft. 350

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by Larry Hinkle

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: Installed Sch 40 tee to come out side of tank.

CERTIFICATE OF COMPLETION BY Sam Ingram EHS

EXISTING SYSTEM CHECKED BY: _____ DATE 7/17/90

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit. _____ DATE _____

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold