DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

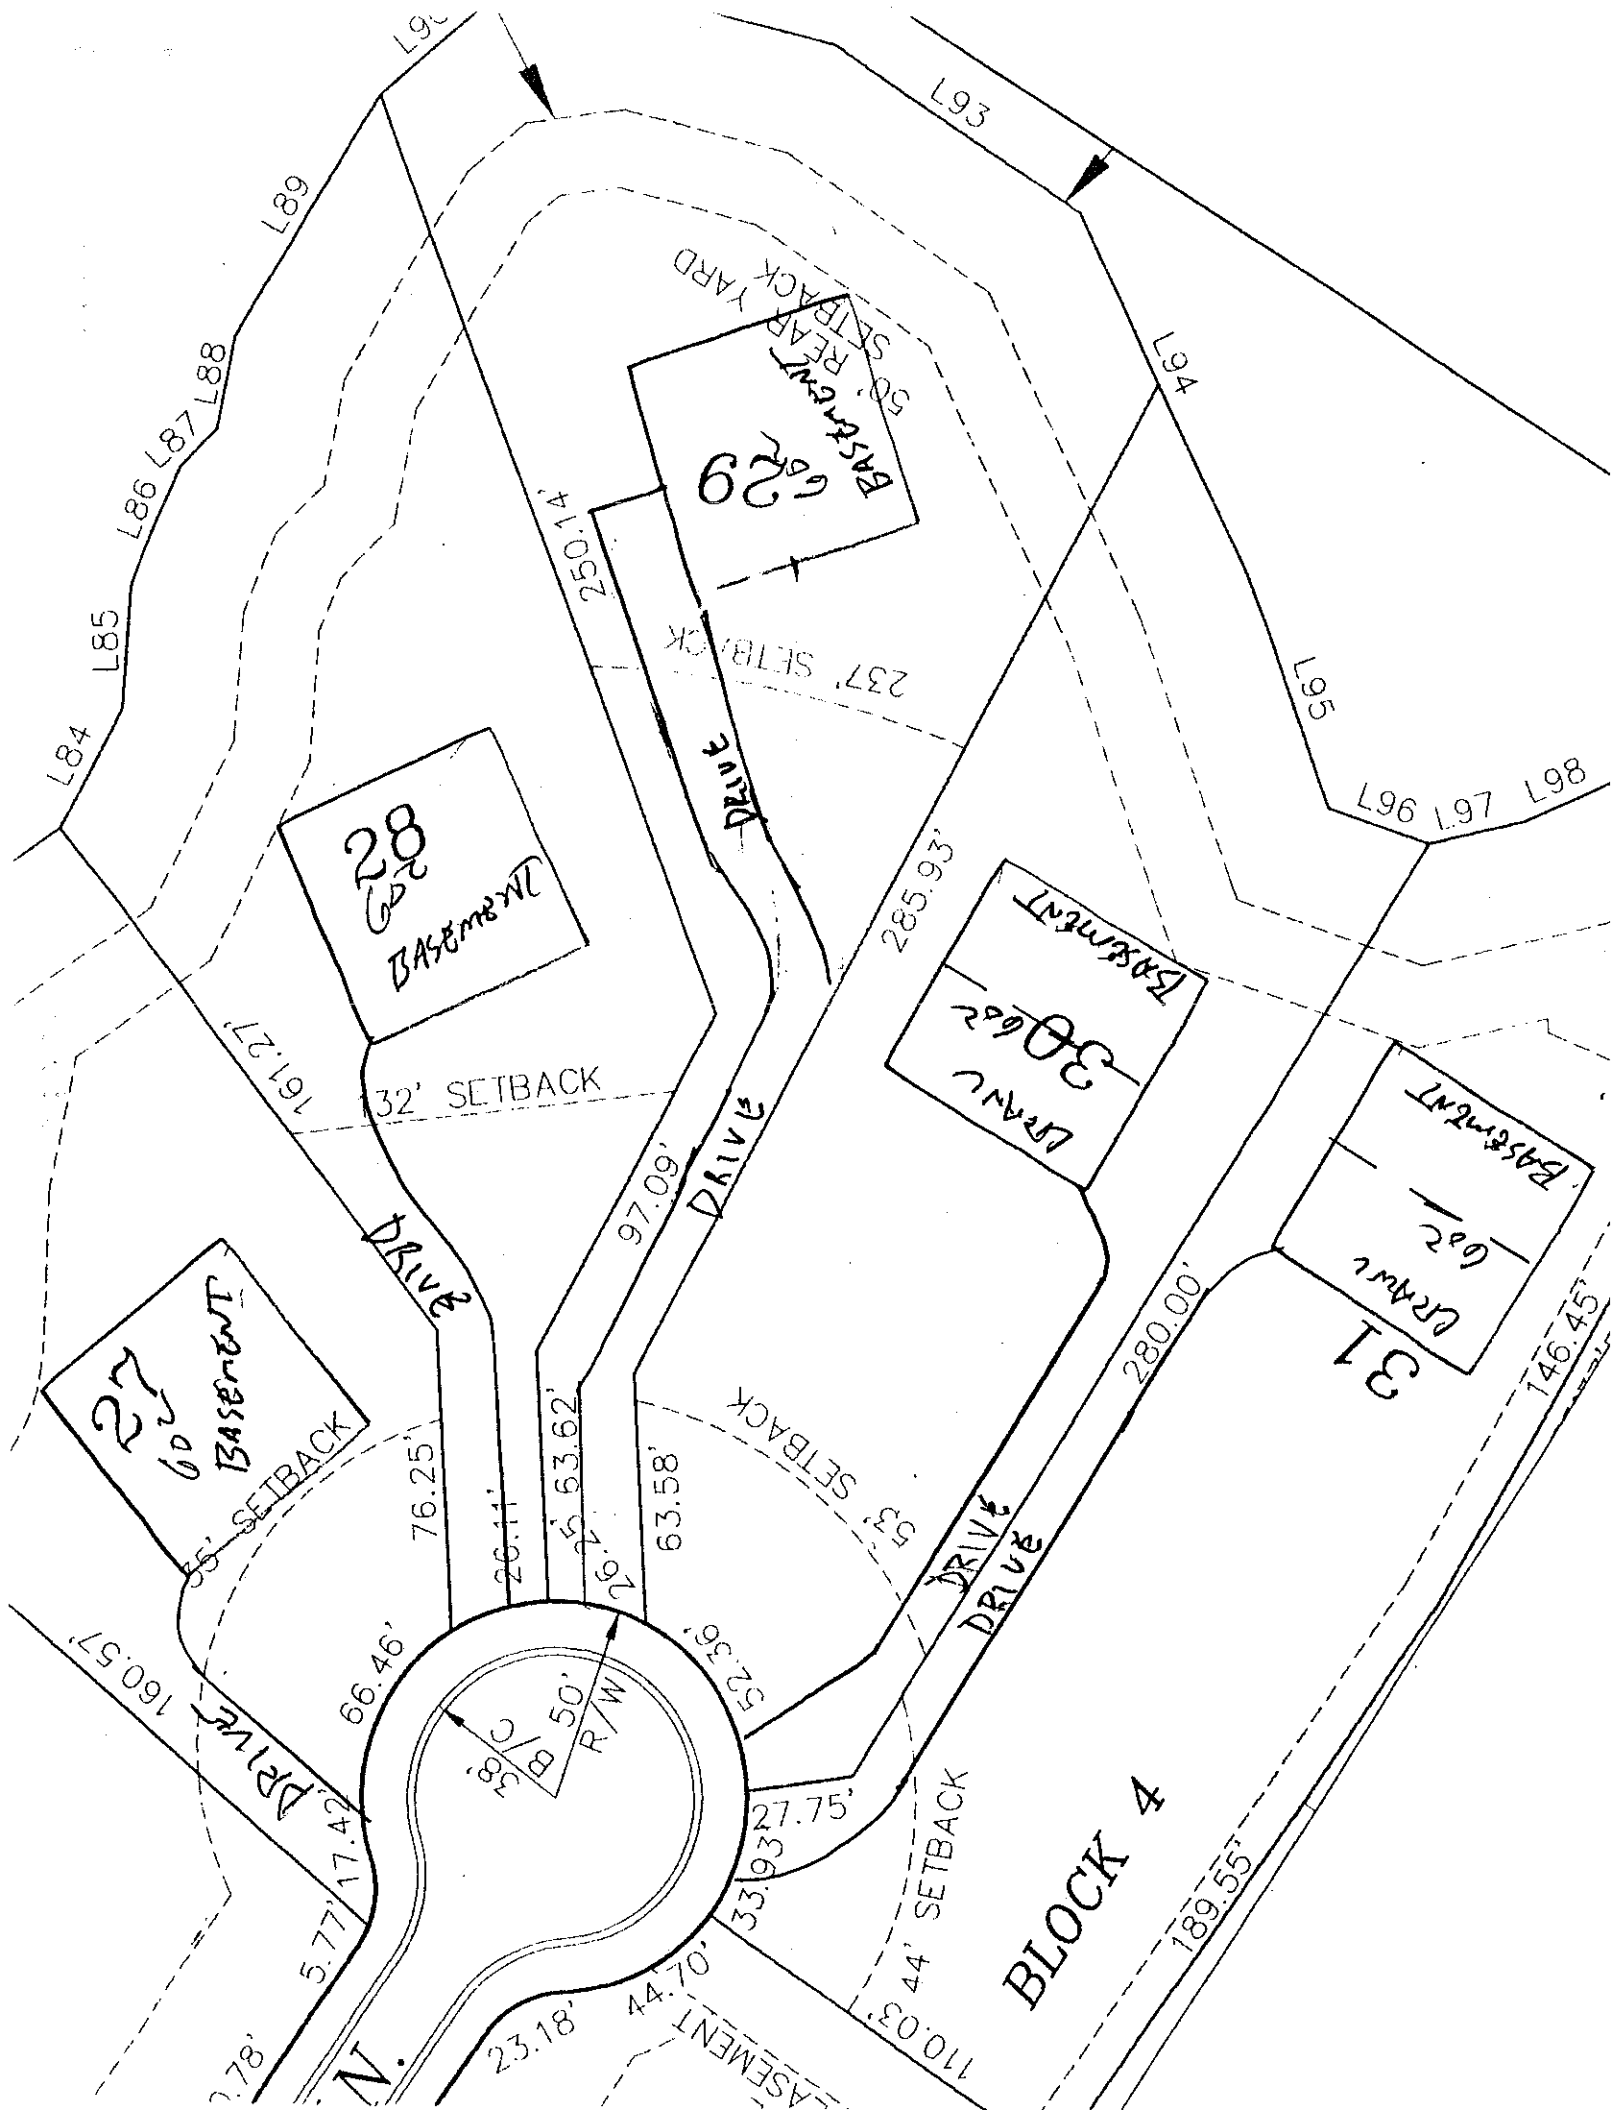
OWNER: CRL APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 7/18/97
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4 PROPERTY SIZE: _____
LOCATION OF SITE: Lot 294 (Covenant) Hardee PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) 1941 STRUCTURE/ TEXTURE	1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS 1942 SOIL WETNESS/ COLOR	1943 SOIL DEPTH	1956 SAPRO CLASS	1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	V 4.6%	0-4	brn cl	fr					S .3 @ ≤36"
		4-13	SaCl brn sc	fr fi sp ss ps sp					
		13-36	SaCl RCL	fr fi sp ss ps sp					
			Hit a gravel rock (limestone) @ 36"						
			could not go deeper						
2	TOE 4%	0-2	brn cl	fr					PS .25-.3 @ ≤33"
		2-16	SaCl R brn sc fi sp sap						
		16-33"	mk SaCl y brn, gy brn cl fi sp sap						
		33+	CL sap gy mott wtr						
3	V 4.6%	0-5	brn cl	fr					PS .25-.3 @ ≤36"
		5-22	SaCl brn R sc fi sp sap						
		22-36	SaCl R, brn cl fi fr ss sp sap						
		36-48	mk SaCl brn cl gy mott sap fi sl sp sap y brn gy mott wtr						
4	V 8%	0-3	brn, sc L fi fr						S .3
		3-14	SaCl brn R sc fi sp sap						
		14-28	mk SaCl y brn gy brn cl fr ss sp sap						
		28-48	mk SaCl y brn cl fr ss sp sap						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


L93
L94
L95
L96 L97 L98
L89
L88
L87
L86
L85
L84
50' REAR YARD SETBACK
250.14'
237' SETBACK
285.93'
280.00'
146.45'
189.55'
110.03'
44' SETBACK
161.27'
32' SETBACK
97.09'
DRIVE
DRIVE
DRIVE
DRIVE
DRIVE
76.25'
26.11'
63.62'
63.58'
53' SETBACK
52.36'
66.46'
160.57'
17.42'
5.77'
35' SETBACK
50' R/W
C
B
A
27.75'
33.93'
44.70'
23.18'
BLOCK 4
29
BASEMENT
28
BASEMENT
27
BASEMENT
30
DRAW
BASEMENT
31
DRAW
BASEMENT