DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

SHEET ____ OF ____
PROPERTY I.D.#: ____
PROPERTY RECORDED: ____
COUNTY: ____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

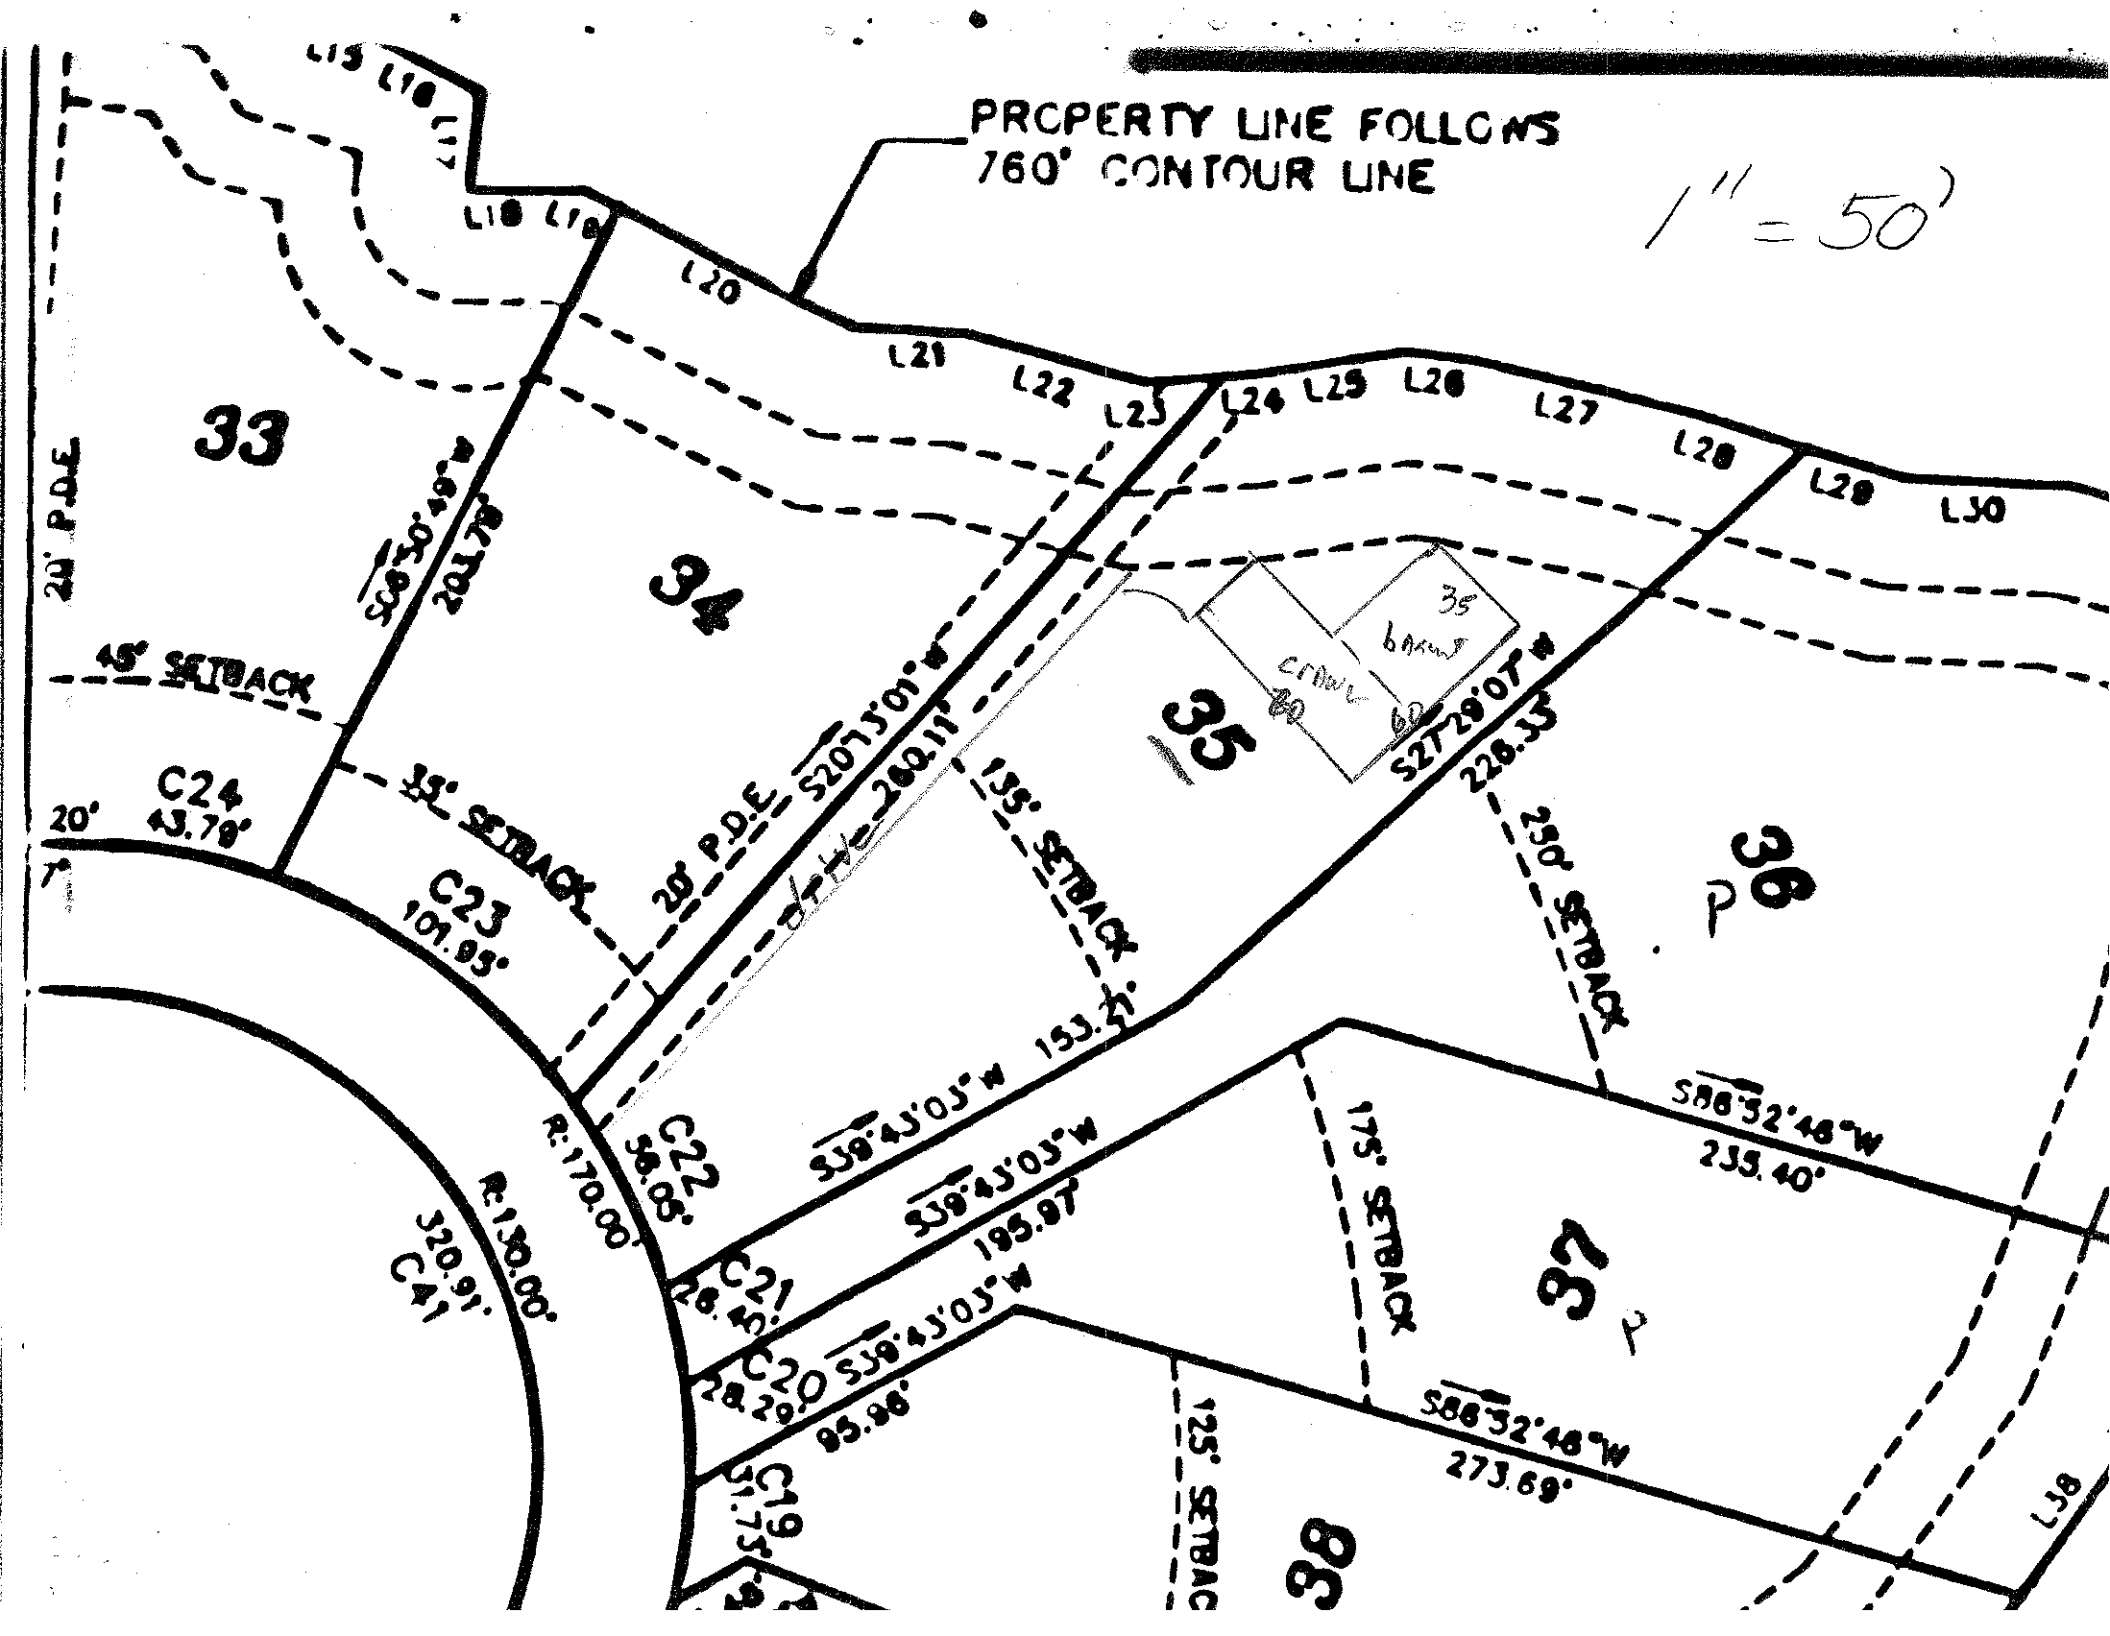
APPLICANT: Toney C Jacobs CPSS OWNER: AGENT: ✓ PHONE: 663 6905
ADDRESS: Cresdent Resources Inc APPLICATION DATE: DATE EVALUATED: 7-19-94
PO Box 1003 PROPOSED FACILITY: SFR 480 gpd
Charlotte PROPERTY SIZE:
LOCATION OF SITE: The Harbour Lot 35 phase I map D
WATER SUPPLY: On-Site Well ___ Comm. Well ✓ Public ___ Other ___ EVAL. METHOD: Auger Boring ___ Pit ✓ Cut ___

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
1		0-9	cl wk gran	mfr	–	–	–	–	–
		9-23	c wk sbk	mfi	–	–	P	–	0.3
		23-50	sic wk sbk	msfi	–	–	F	–	0.3
		50-68	Saprolite wk sbk-gran		>68	>68	–	–	–
2		0-8	cl wk gran	mfr	–	–	–	–	–
		8-20	c wk sbk	mfi	–	–	P	–	0.3
		20-30	sic wk sbk	msfi	–	–	P	–	0.3
		30-36+	Saprolite		>36	>36	–	–	–
3		0-12	cl wk gran	mfr	–	–	–	–	–
		12-24	c wk sbk	mfi	–	–	P	–	0.3
		24-30+	sic+ Saprolite pit terminates 42"		>42	>42	–	–	0.3
4									
5									

AVAILABLE SPACE (.1945) ____ SITE CLASSIFICATION (.1948): ____ SITE LONG-TERM ACCEPTANCE RATE: 0.3

EVALUATED BY: AL OTHER(S) PRESENT: ____

COMMENTS: ____


PROPERTY LINE FOLLOWS
760' CONTOUR LINE
1" = 50'
33
34
35
36
37
38
20' P.D.E.
45' SETBACK
35' SETBACK
20' P.D.E.
135' SETBACK
250' SETBACK
175' SETBACK
125' SETBACK
S38°50'48"E 203.78'
S20°13'01"E 260.11'
S27°29'07"E 228.33'
S38°43'05"W 153.21'
S38°43'05"W 195.97'
S38°43'05"W 95.98'
S86°32'48"W 239.40'
S86°32'48"W 273.69'
C24 43.78'
C23 101.95'
C22 56.86'
C21 28.52'
C20 28.29'
C19 17.54'
C41 320.91'
R:170.00'
R:130.00'
L15 L16 L17 L18 L19 L20 L21 L22 L23 L24 L25 L26 L27 L28 L29 L30 L38
35
BASE
CROWN
60
60