VISION OF ENVIRONMENTAL HEALTH
-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

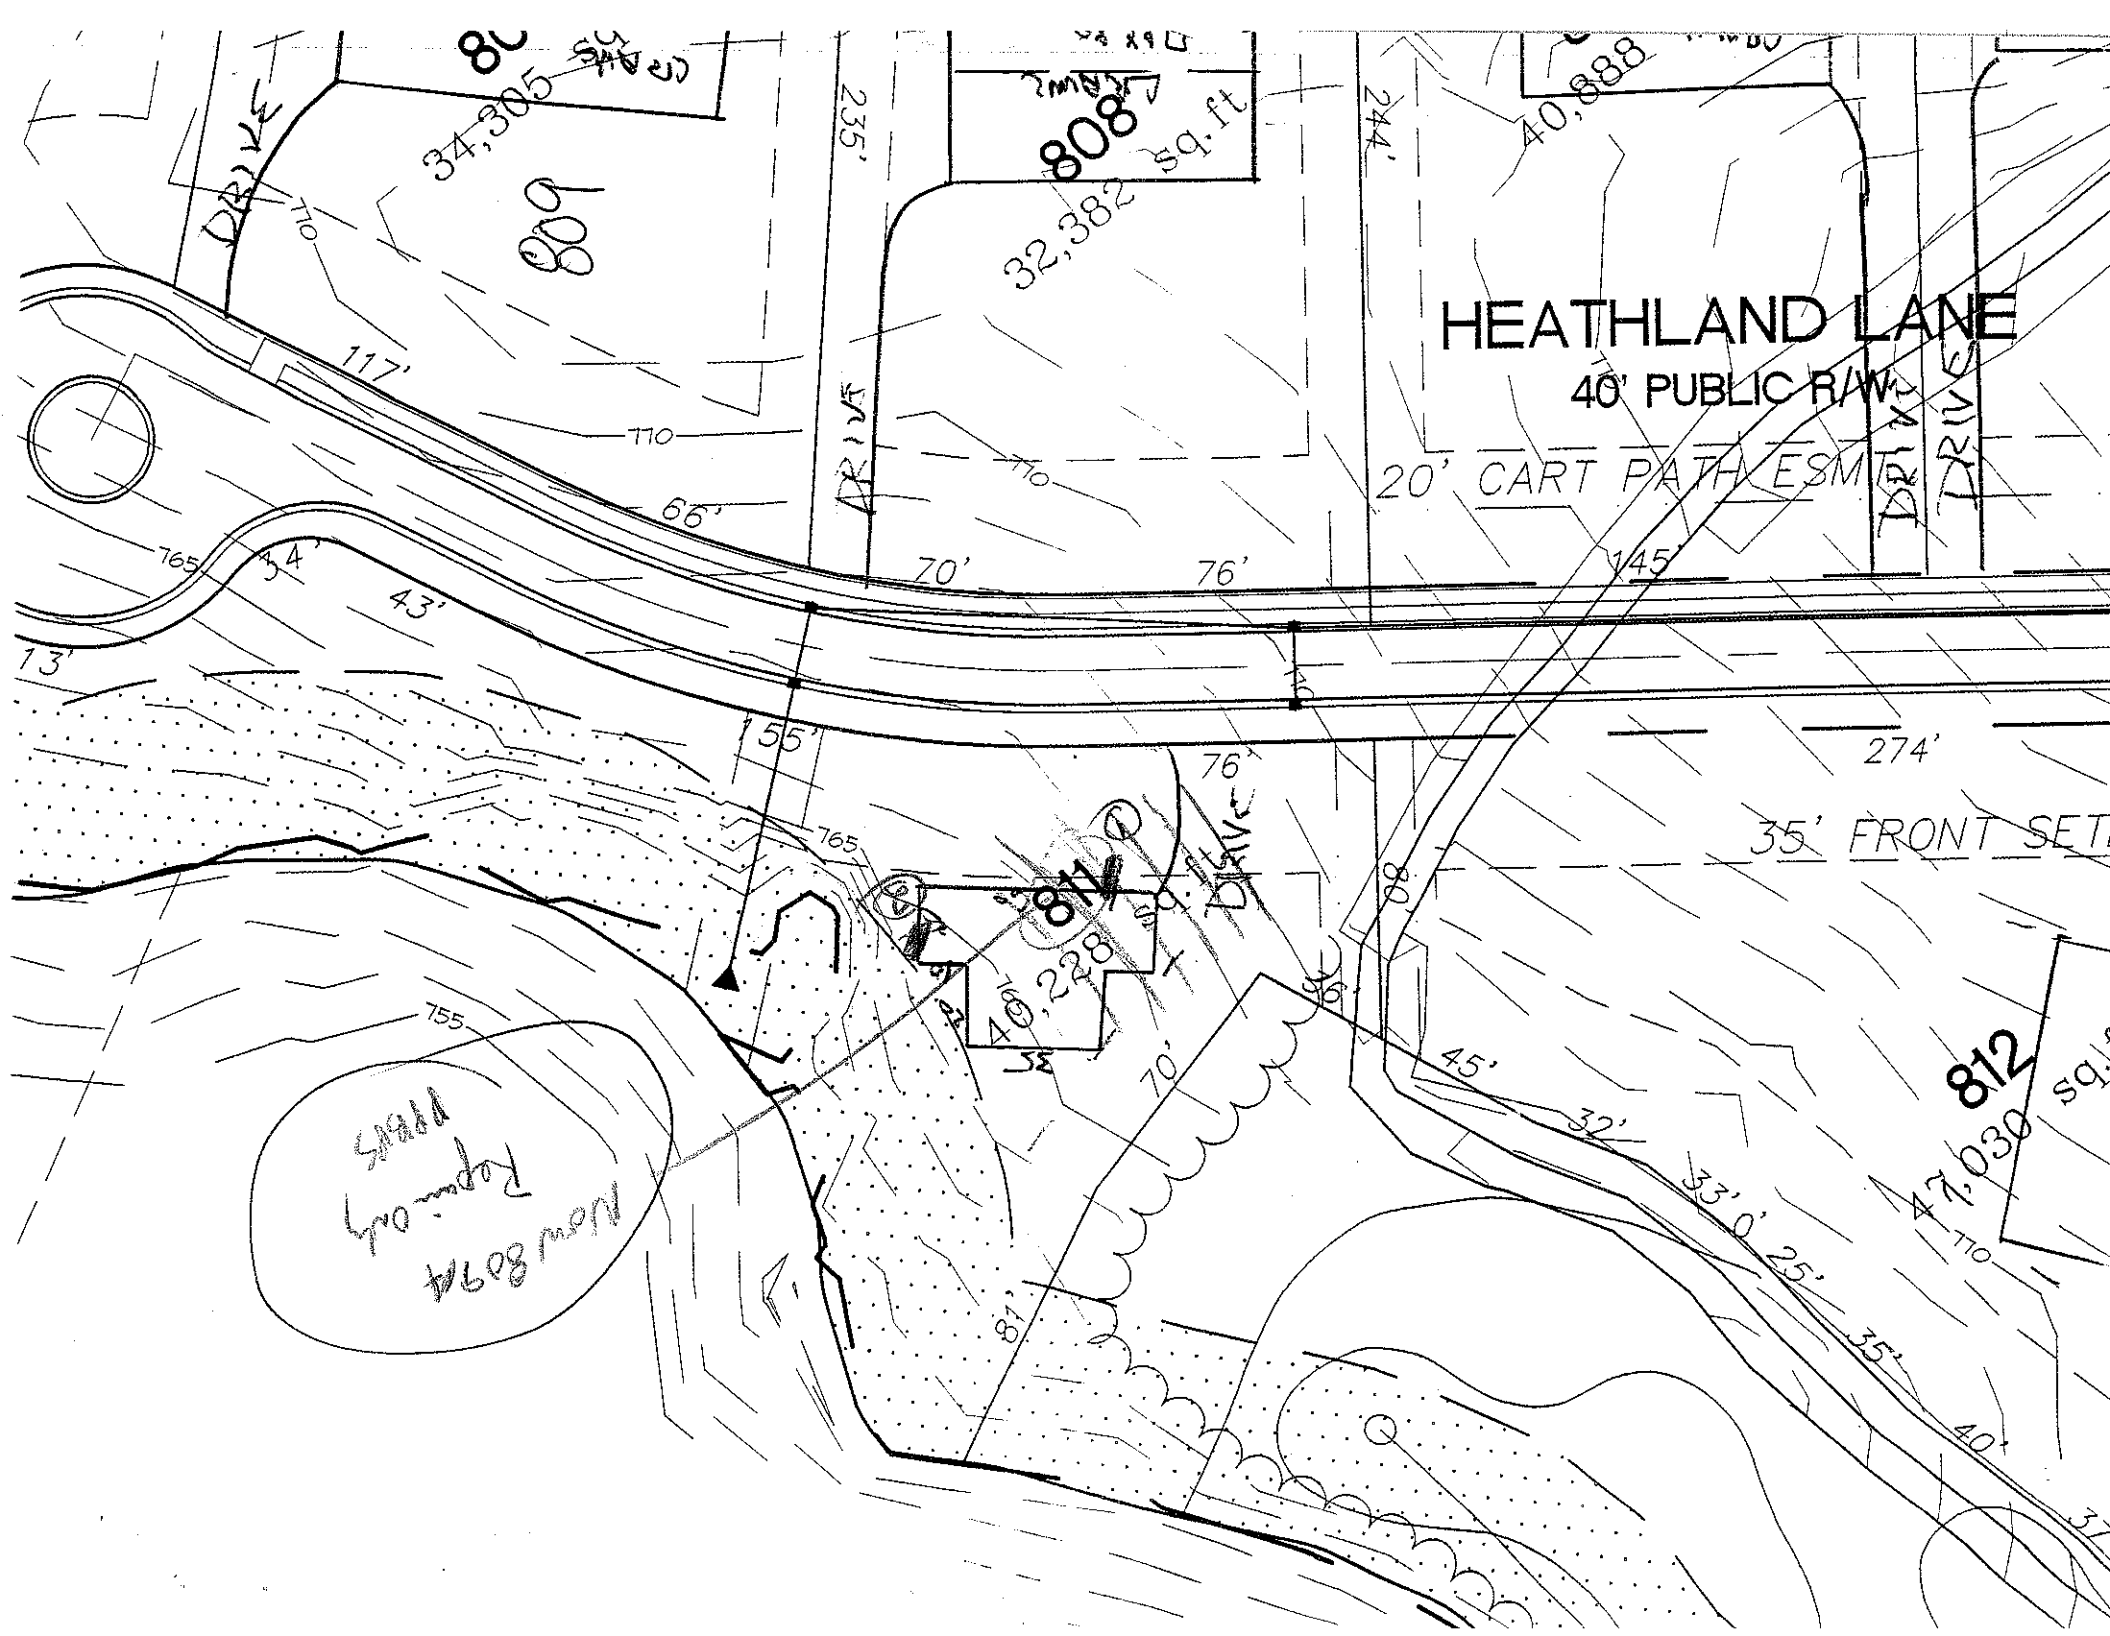
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Moffat Loop Rd 809 PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
P12	0-7	gr SL	fr					R .3
	7-31	wk fsbk R c	fr sss p					
	31-45	mod fsbk cl/sl	common reddish mottles fr sss p					
(2)	0-7	brn sl	fr					R .3
	7-26	mod sbk heavy cl	fr sss p					
	26-50	wk fsbk heavy cl	fr sss p					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
ailable Space (.1945)		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____


HEATHLAND LANE
40' PUBLIC R/W
20' CART PATH ESMT
35' FRONT SET
809
808
811
812
34,305 sq.ft
32,382 sq.ft
40,888
40,228 sq.ft
117'
66'
70'
76'
145'
274'
155'
43'
34'
13'
45'
32'
25'
35'
40'
81'
770
765
755
DRIVE

for ON-SITE WASTEWATER SYSTEM

NER: _____ APPLICANT: _____

DRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 8-10-01

OPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____

CATION OF SITE: Lot 811 (869K) Rhea Theft. PROPERTY RECORDED: _____

TER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____

ALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

PE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
(1)	0-20	mSnbk RC	fi sp					.3
	20-55	wkab gr cl	fr ss sp common mi sap					
(2)	0-6	2 brn sL	fr ss sp					-.3
	6-22	wksab R brn scl	fr ss sp					
	22-39	Sab RC	fi sp					
	39-54	m-wksab gr cl	fr ss sp common mi sap					

DESCRIPTION | INITIAL SYSTEM | REPAIR SYSTEM | OTHER FACTORS (.1946): _____