DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

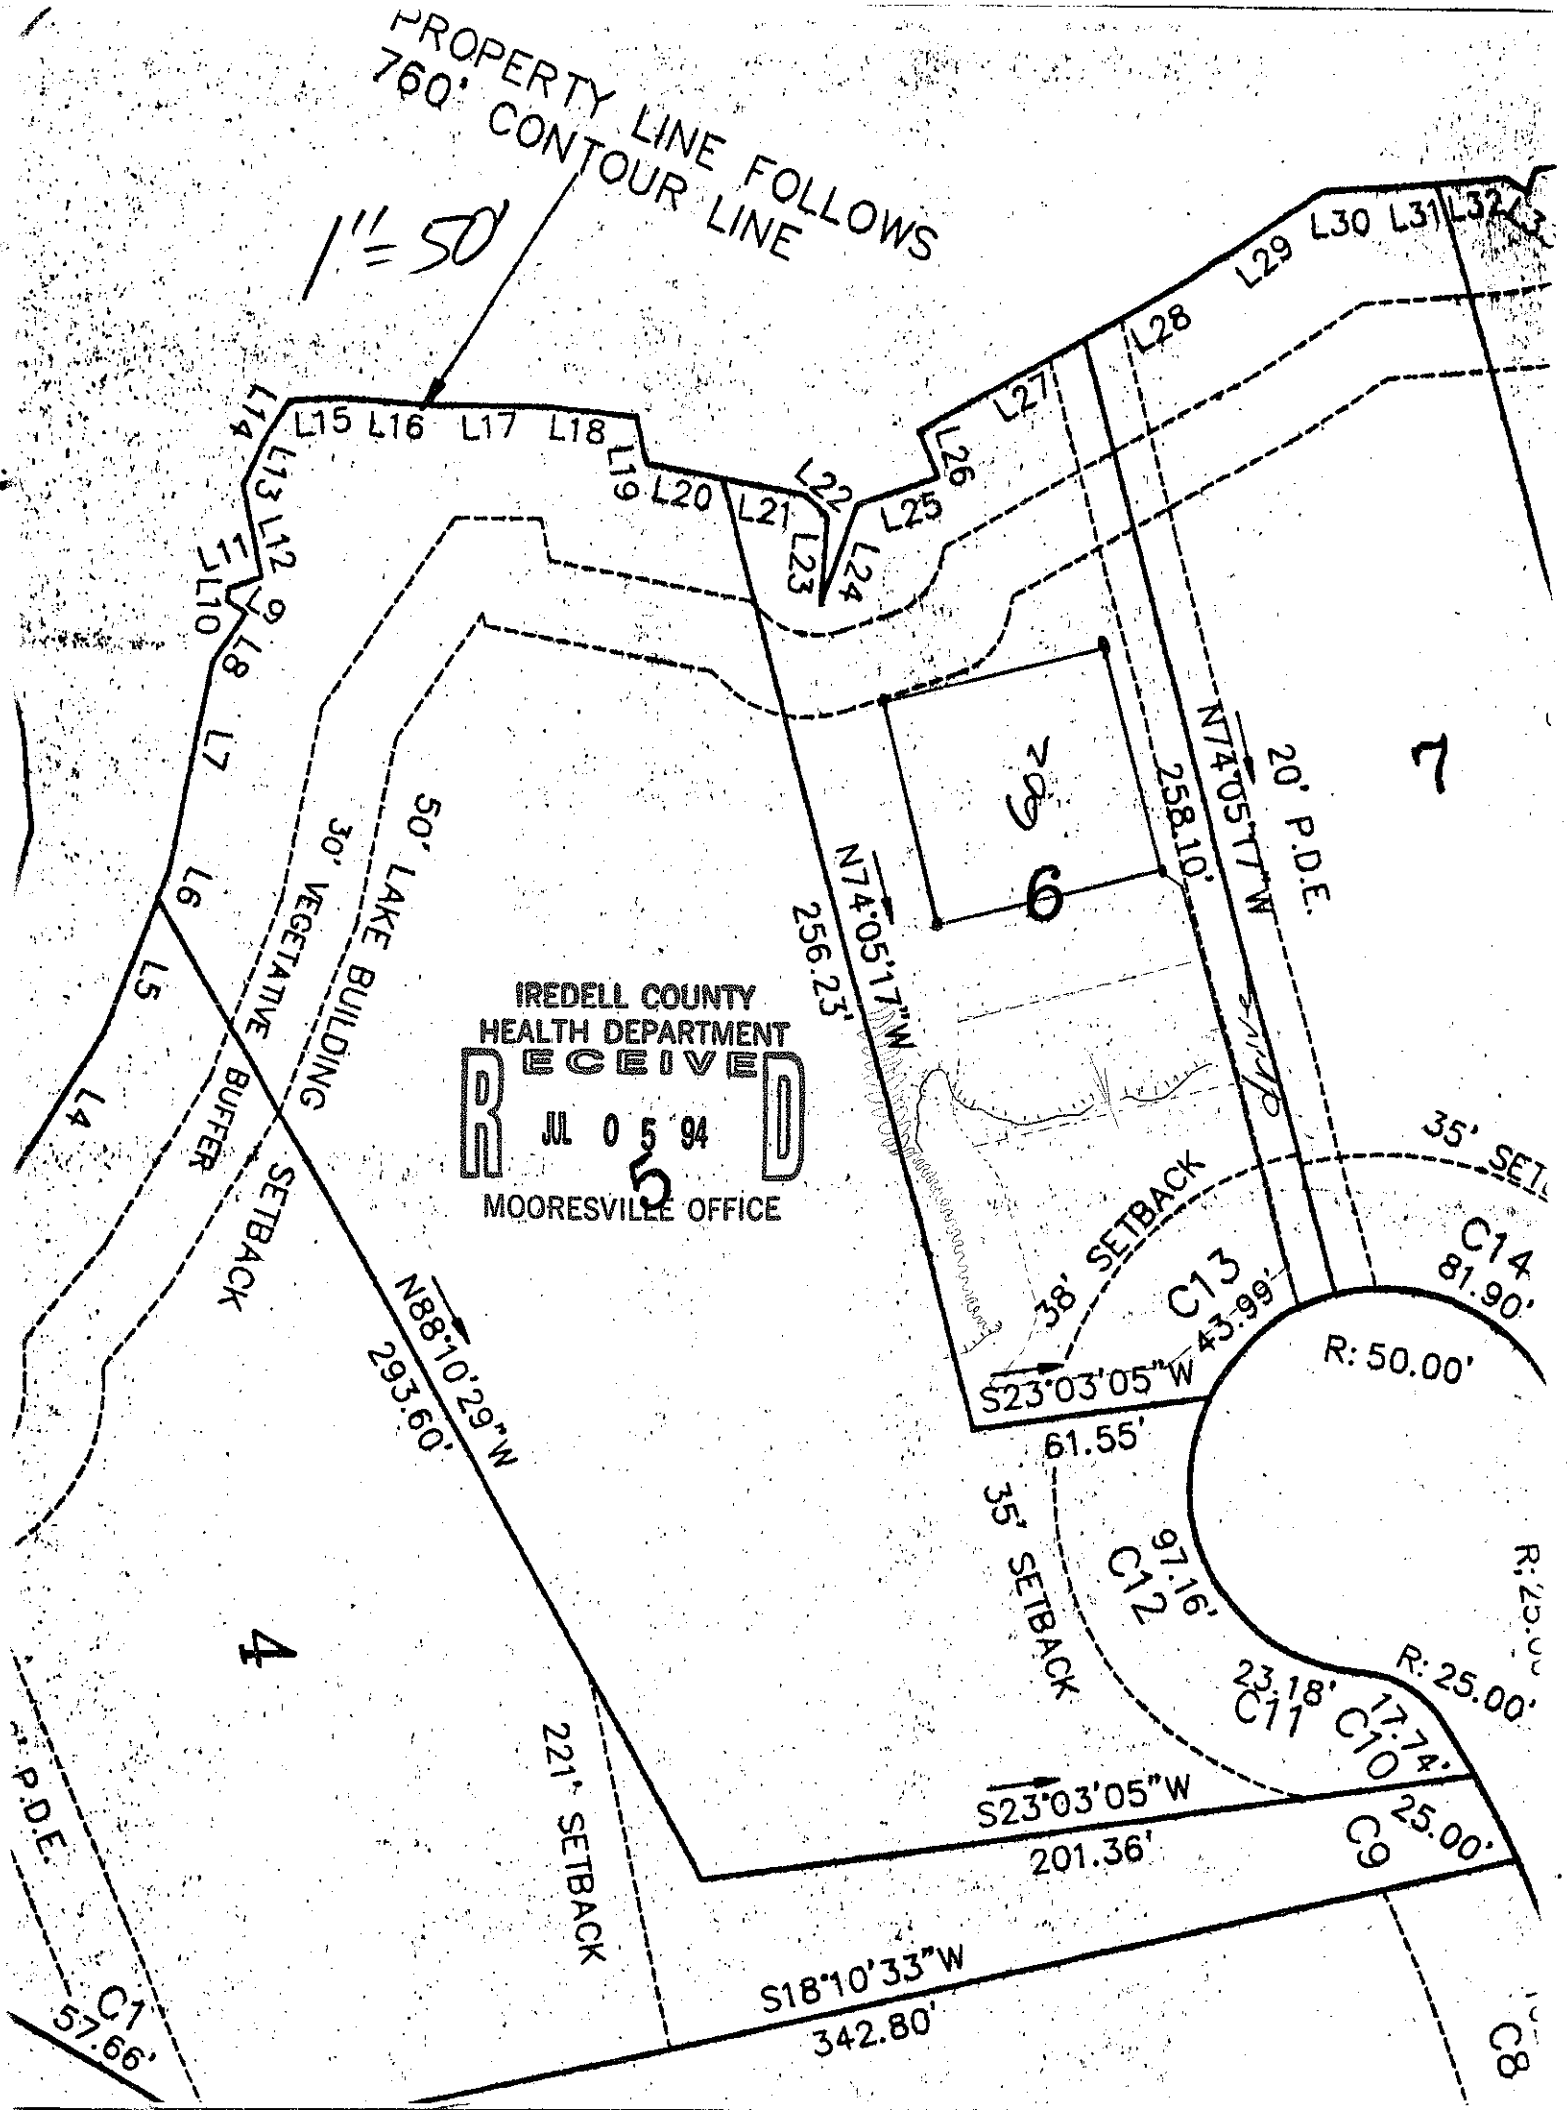
SHEET ___ OF ___
PROPERTY I.D.#: ___
PROPERTY RECORDED: ___
COUNTY: ___

# SOIL/SITE EVALUATION
## FOR
## ON-SITE WASTEWATER SYSTEM

APPLICANT: Tonay Jacobs CP55 OWNER/AGENT: ___ PHONE: ___
ADDRESS: Crescent Resources Inc APPLICATION DATE: ___ DATE EVALUATED: ___
PROPOSED FACILITY: SFR
PROPERTY SIZE: ___
LOCATION OF SITE: Lot 6 Harbour
WATER SUPPLY: On-Site Well ___ Comm. Well ___ Public ___ Other ___ EVAL. METHOD: Auger Boring ✓ Pit ___ Cut ___

| PROFILE # | .1940 LANDSCP POS. (%) | HORIZON DEPTH (IN.) | .1941 STRUCTURE/TEXTURE | .1941 MINERALOGY/ CONSISTENCE | .1942 WETNESS COND. | .1944 RESTRICT HORIZONS | .1948 CLASS OF HORIZ | 1943/ 1956 SAPRLT CLASS | HORIZON LTAR |
|---|---|---|---|---|---|---|---|---|---|
| 1 | | 0-12 | cl | mfr | — | — | P | — | — |
| | | 12-24 | si c | mfi | — | — | P | — | 0.3 |
| | | 24-34 | si cl + Saprolite | mfi | — | — | P | — | 0.3 |
| | | 34-47 | si cl | mfr | >47 | >47 | P | — | 0.3 |
| | | | | | | | | | |
| 2 | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| 3 | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| 4 | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| 5 | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

AVAILABLE SPACE (.1945) ___ SITE CLASSIFICATION (.1948): P SITE LONG-TERM ACCEPTANCE RATE: 0.3
EVALUATED BY: AL OTHER(S) PRESENT: None
COMMENTS: off Site Repair


PROPERTY LINE FOLLOWS
760' CONTOUR LINE
1" = 50'
L14 L15 L16 L17 L18 L19 L20 L21 L22 L23 L24 L25 L26 L27 L28 L29 L30 L31 L32
L13 L12 L11 L10 L9 L8 L7 L6 L5 L4
50' LAKE BUILDING SETBACK
30' VEGETATIVE BUFFER
N74°05'17"W 256.23'
N74°05'17"W 258.10'
20' P.D.E.
7
6
5
4
IREDELL COUNTY
HEALTH DEPARTMENT
RECEIVED
JUL 05 94
MOORESVILLE OFFICE
35' SETBACK
38' SETBACK
C13
43.99'
S23°03'05"W
C14
81.90'
R: 50.00'
61.55'
35' SETBACK
C12
97.16'
C11
23.18'
C10
17.74'
R: 25.00'
S23°03'05"W
201.36'
C9
25.00'
N88°10'29"W
293.60'
221' SETBACK
S18°10'33"W
342.80'
P.D.E.
C1
57.66'
C8