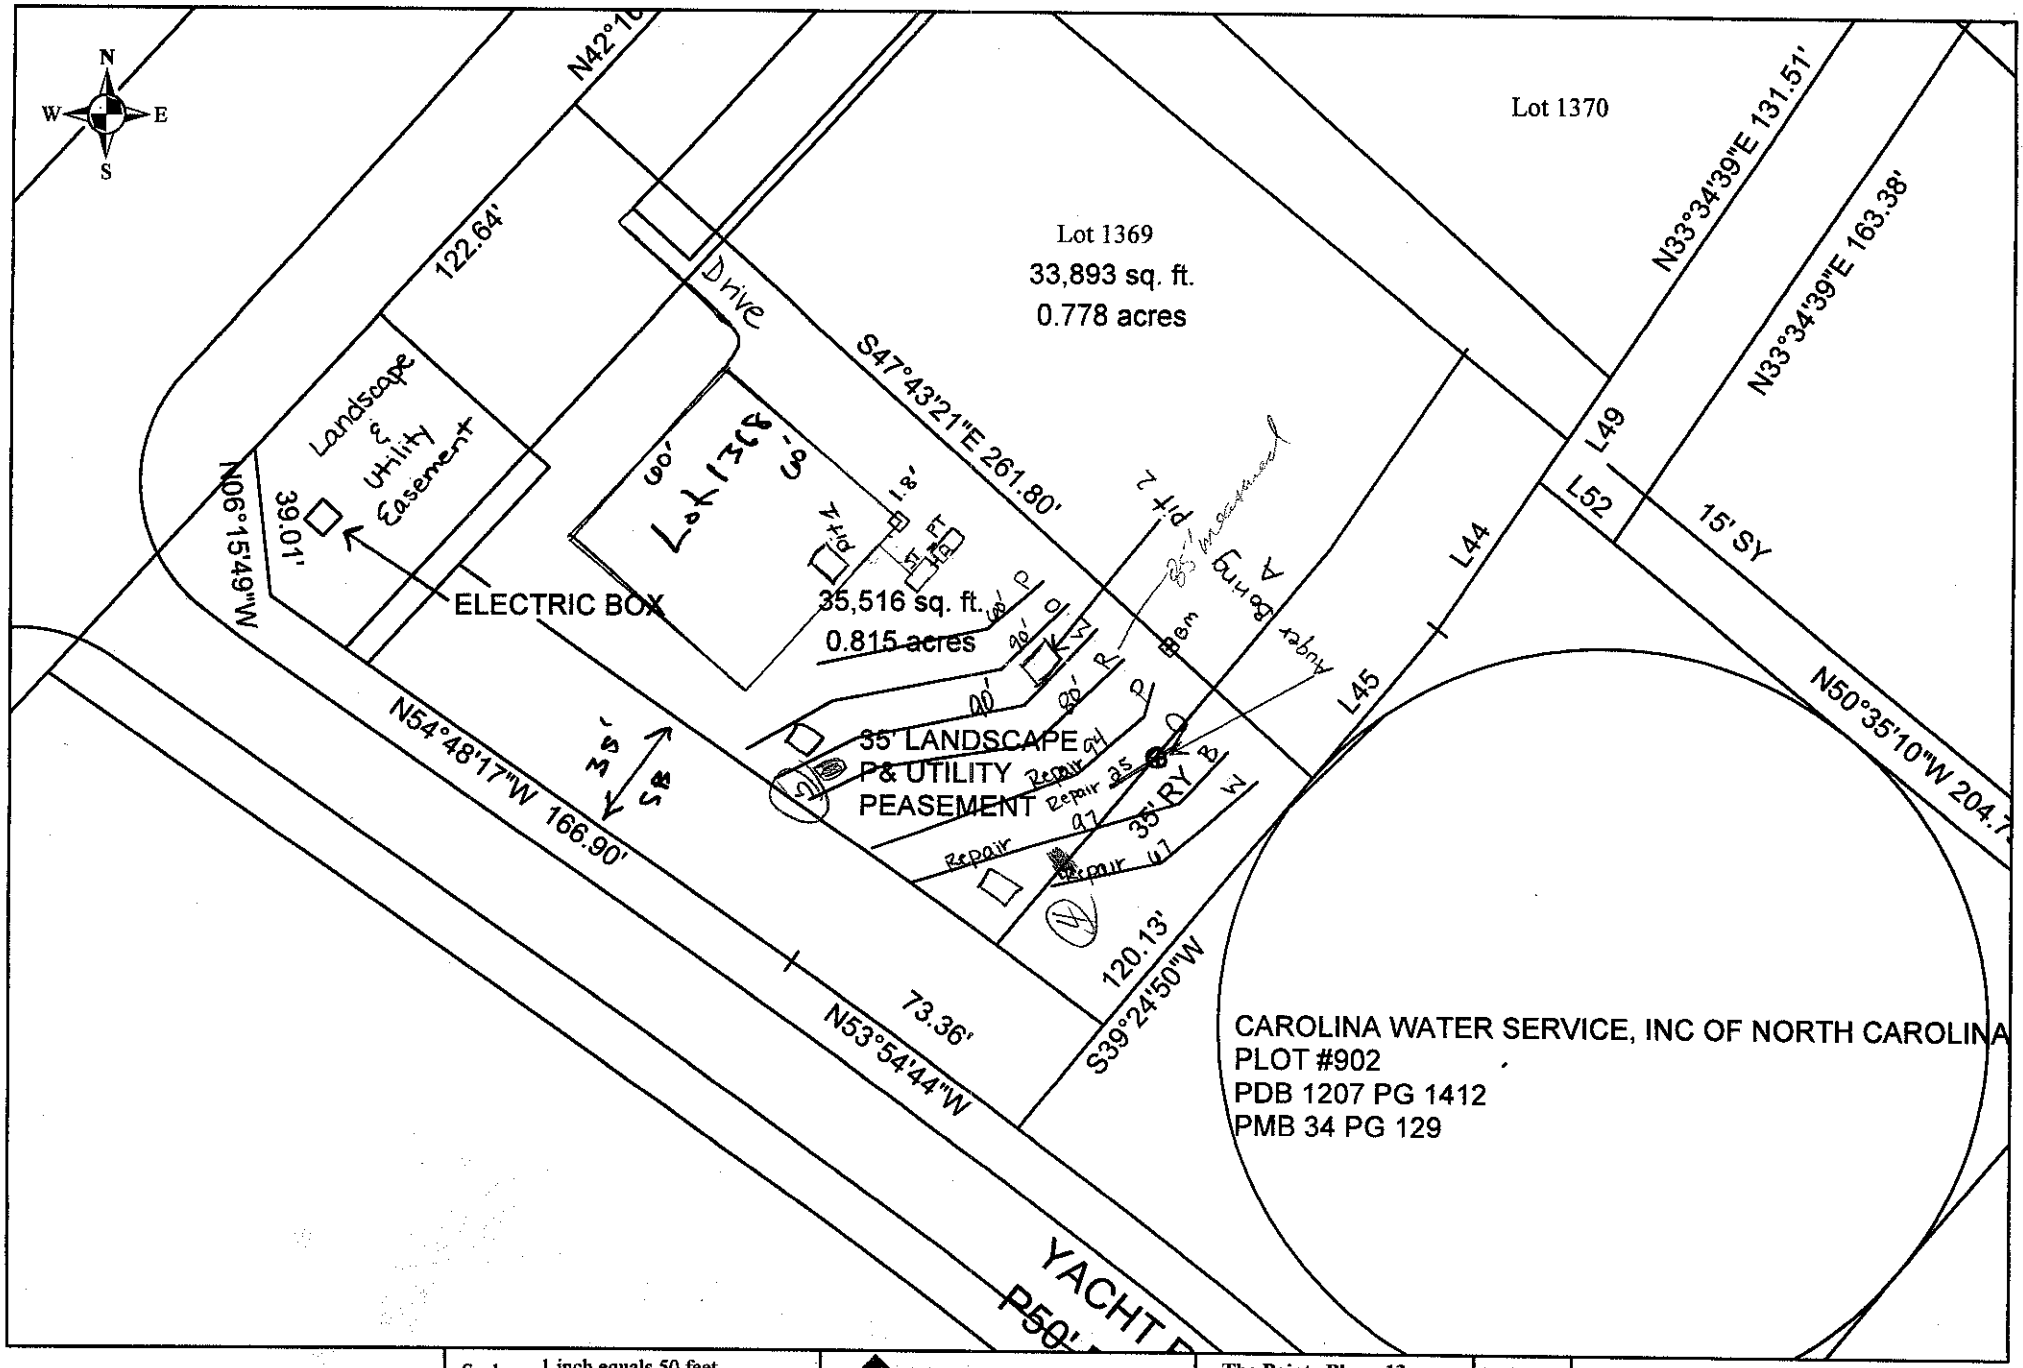


Scale: 1 inch equals 50 feet	S&ME	The Pointe Phase 13	FIGURE
Drawn by: JBP	ENVIRONMENTAL SERVICES · ENGINEERING · TESTING	Lot 1368	1
Reviewed by: PGP		Iredell County, NC	
Date: July, 2005			

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: The Point on Lake Norman APPLICANT: ___
ADDRESS: ___ APPLICATION DATE: ___ DATE EVALUATED: 6/24/0
PROPOSED FACILITY: House PROPOSED DESIGN FLOW (.1949): 480 PROPERTY SIZE: ___
LOCATION OF SITE: ___ PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

#5 0-5 gr-wk sbk sl/dk brn sl/scl frssp
5-42 wk sbk rcl frsssp/sclp .3
42-49 " rcl frssp/cos sap

13608

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941): .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS: .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	Linear 2-4%	0-2	Mo GR SL	SS SP FR	Br				
		2-30	Mo SBK C	SS SP FR	Red; F	F sap			
		30-48	WK SBK CL	SS SP FR	Red; C	sap			.3
2	Linear 2-4%	0-3	Mo GR SL	SS SP FR	DK Br				
		3-12	WK SBK SL	SS SP FR	Br				
		12-36	Mo SBK C	SS SP FR	Red; F	sap			.3
		36-48	WK SBK CL	SS SP FR	Red; C	sap			
A B	Linear 0-2%	0-4	Mo GR SL	SS SP FR	Br				
		4-36	Mo SBK C	SS SP FR	Red				
		36-48	Mo SBK CL	SS SP FR	Red; F	Relic yel Br			.3
						F sap			
4	5-9% L	0-15	wk sbk brn sl/scl	frssp					
		15-49	SBK RCL	frsssp SAP					.3

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): ___
EVALUATED BY: ___