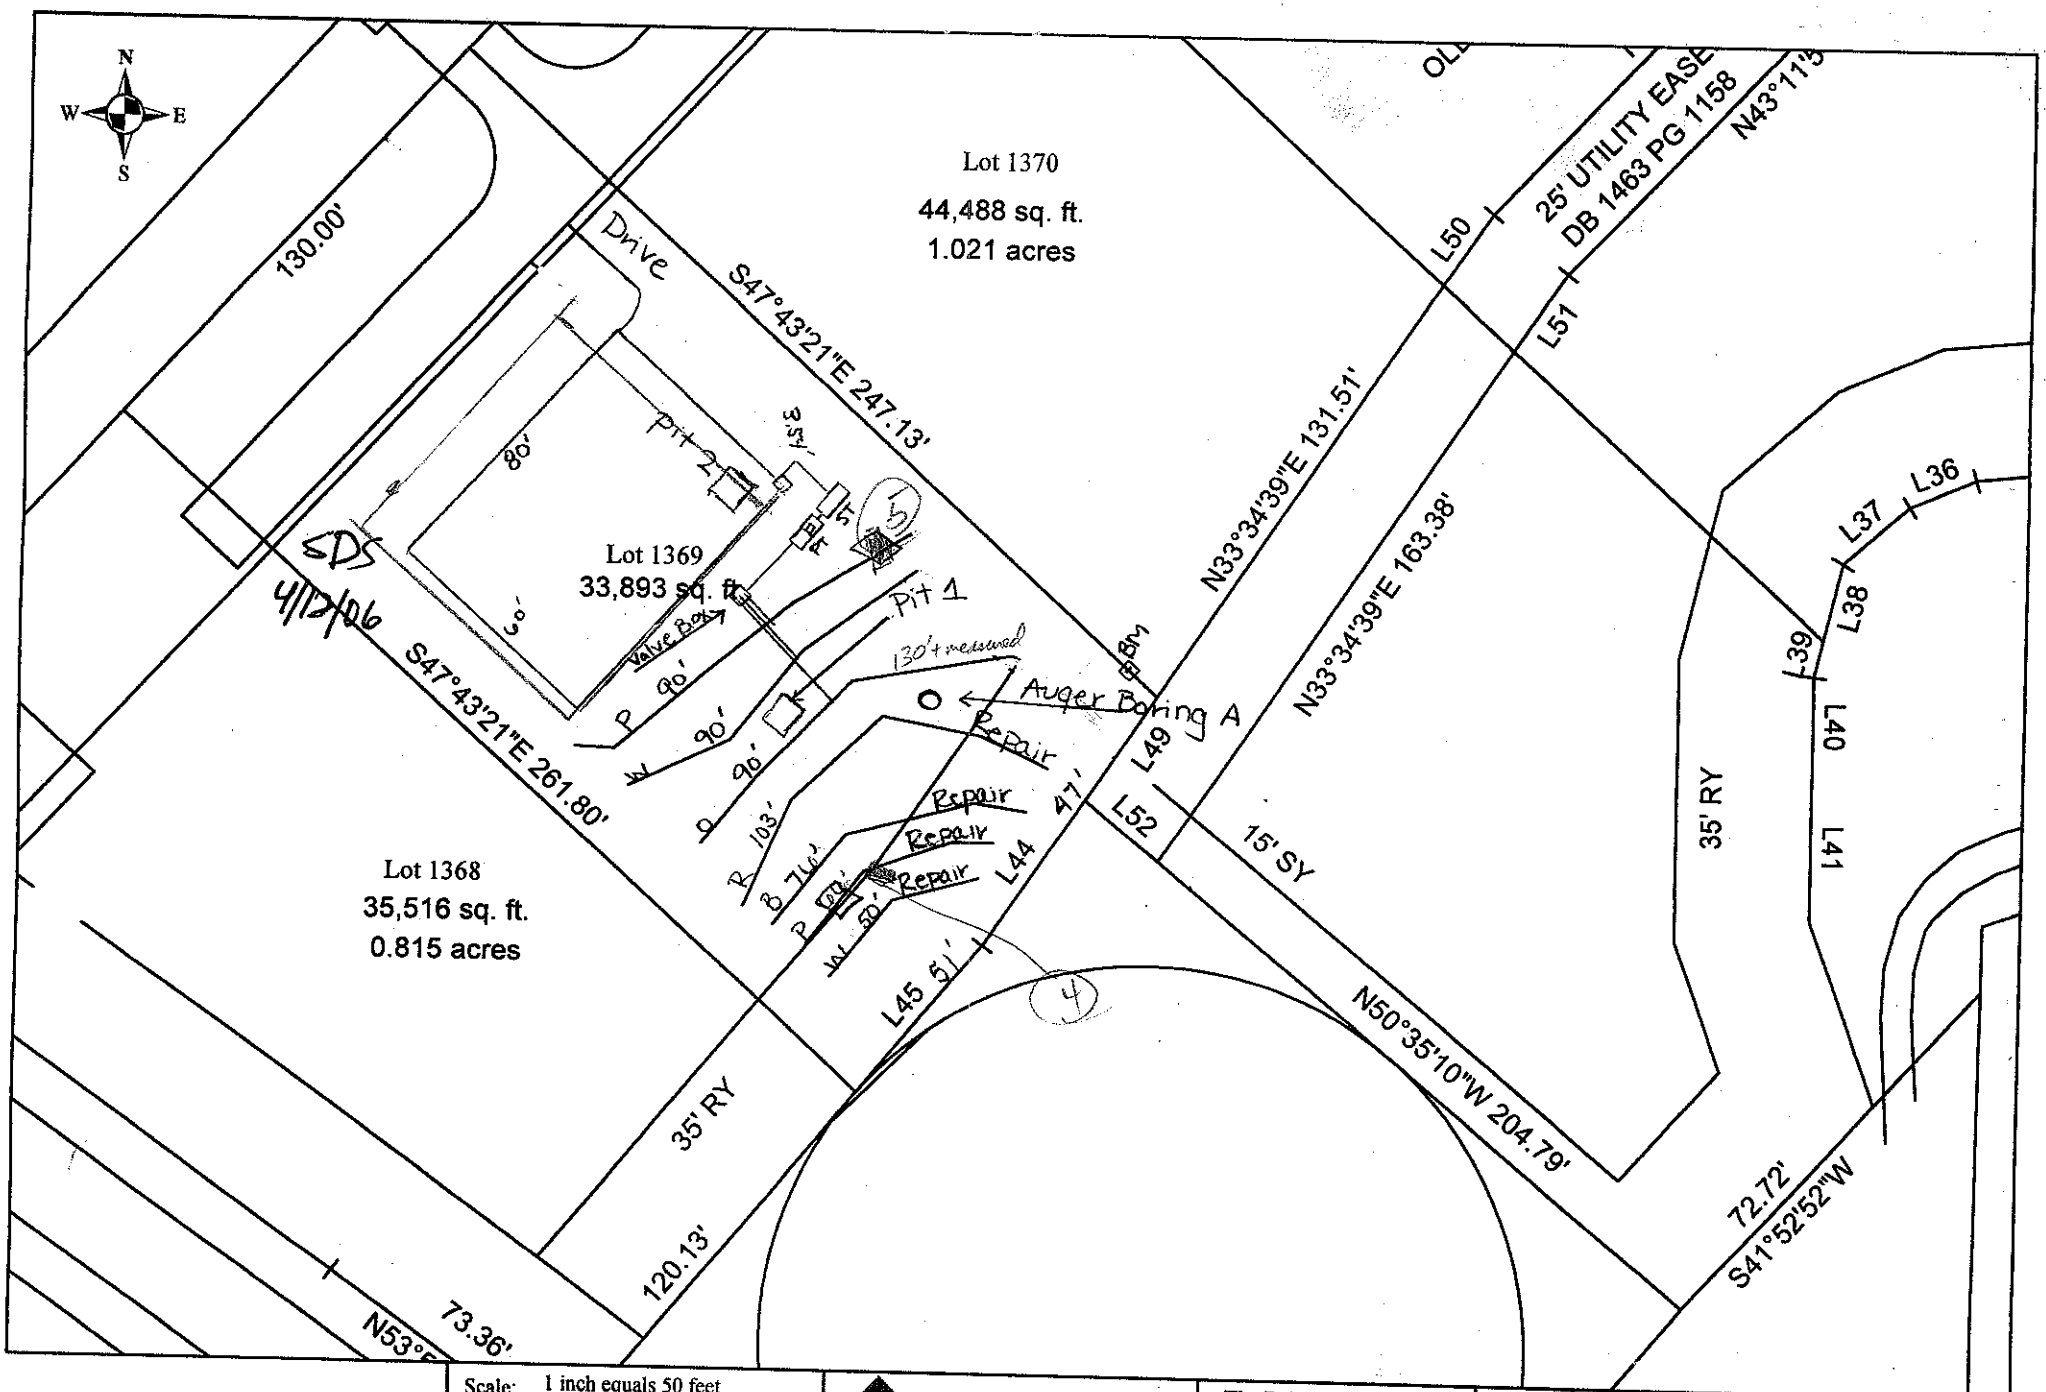


Scale: 1 inch equals 50 feet	S&ME ENVIRONMENTAL SERVICES · ENGINEERING · TESTING	The Pointe Phase 13	FIGURE
Drawn by: JBP		Lot 1369	1
Reviewed by: PGP		Iredell County, NC	
Date: July, 2005			

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: The Point on Norman APPLICANT: ___
ADDRESS: ___ APPLICATION DATE: ___ DATE EVALUATED: 6/24
PROPOSED FACILITY: House PROPOSED DESIGN FLOW (.1949): 480 PROPERTY SIZE: ___
LOCATION OF SITE: ___ PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed
13609

#1 0-2 gr PRW SL FR
2-13 Wk SBK Rsep-SCL
13-48 SBK red-Trss-SSSP/Comm

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	Linear 4-6%	0-3	Mo GR SL	SS SP FR	DK Br				.3
		3-10	WK SBK SL	SS SP FR	Br				
		10-28	Mo SBK C	SS SP FR	Red; C	Yel Br	18-28"		
		28-38	WK SBK CL	SS SD FR	Red; C Sap				
		38-62	MA L Sap	FR	Red				
2	Linear 2-4%	0-8	WK SBK SL	SS SD FR	Br				.3
		8-26	Mo SBK C	SS SP FR	Red				
		26-44	WK SBK CL	SS SP FR	Red; F Sap				
		44-52	MA L Sap	FR	Red				
3	Linear 0-2%	0-4	Mo GR SL	SS SP FR	Br				.3
		4-26	Mo SBK SCL	SS SP FR	Br; F Red				
		26-45	Mo SBK SCL	SS SP FR	Red; F Br				
		45"	Floater Rock						
4	2-4% ✓	0-48	WK SBK Rsep SCL/CL	Trss SSSP SSP					.3

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): ___
EVALUATED BY: ___