DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

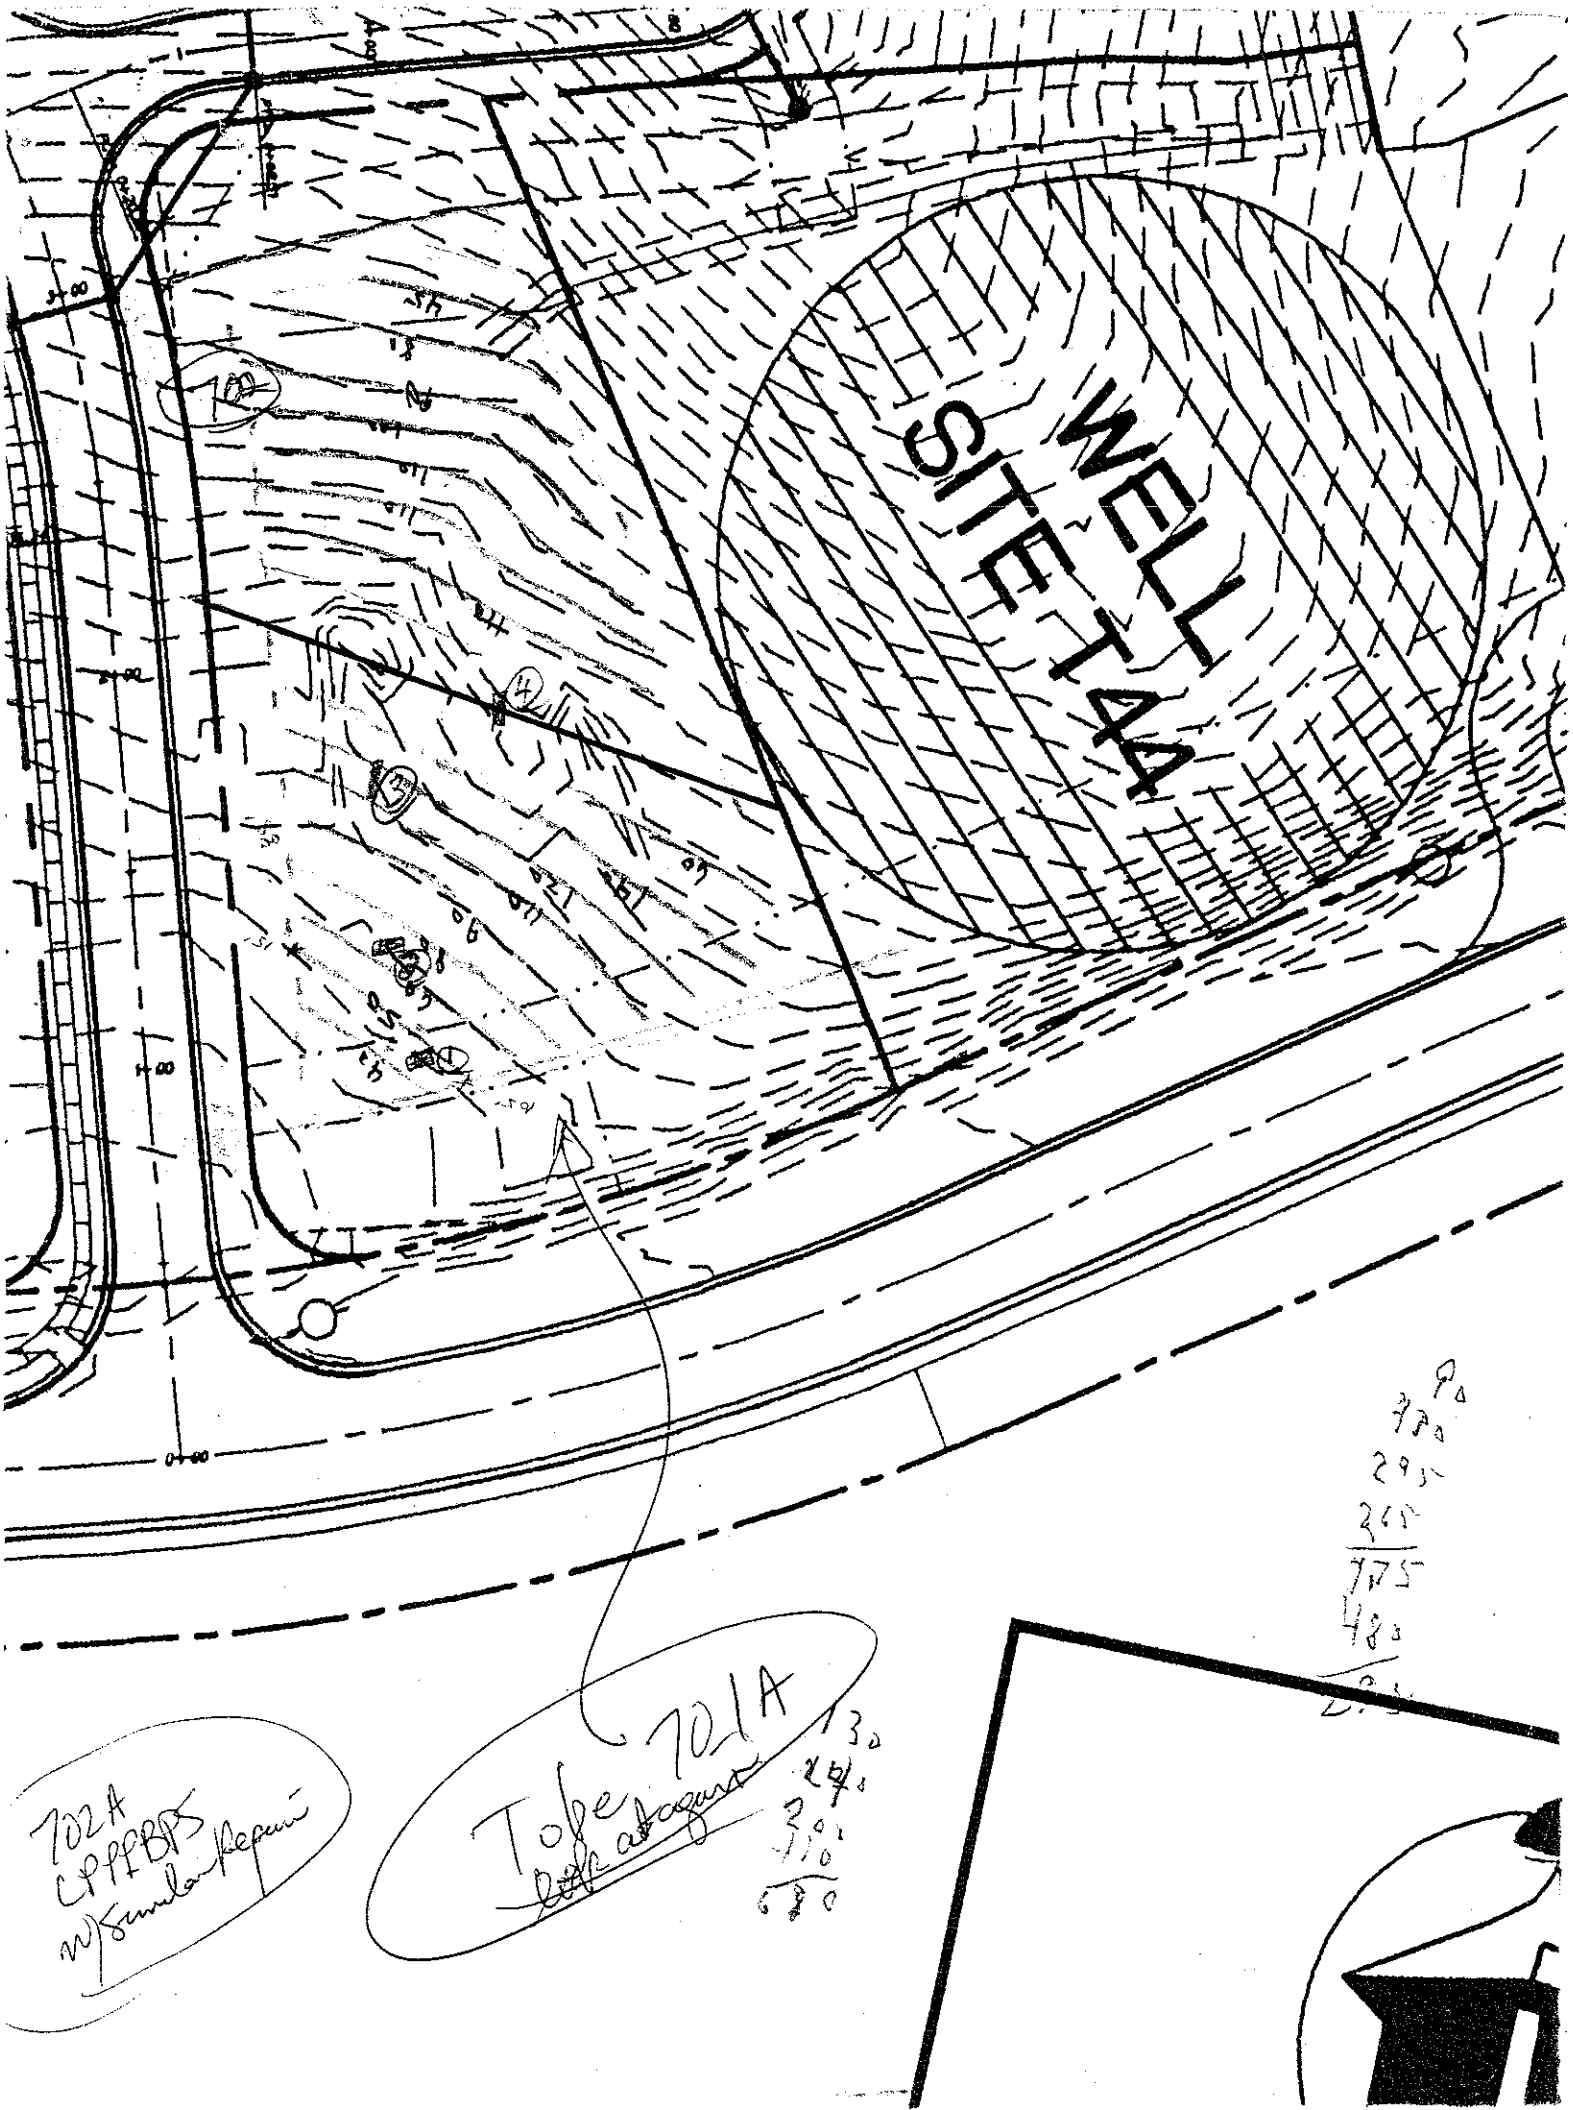
OWNER: CRI — APPLICANT: _____
ADDRESS: _____ — APPLICATION DATE: _____ — DATE EVALUATED: 3-30-01
PROPOSED FACILITY: _____ — PROPOSED DESIGN FLOW (.1949): _____ — PROPERTY SIZE: _____
LOCATION OF SITE: 5 FETS thru 7 The PT — PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

Now 701 A
702 A

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-5	sl						PS .3
		5-31	mfsbk ppc	fr sp					
		31-50	wk sbk ypcl	few-common mica sapp	fr ss sp				
2		0-8	RCL fill						.3 .3 .3 78"
		8-14	gr-mk sbk brn scl	fr					
		14-29	sbk pc	fr sp					
		29-52	wk sbk ypcl	few-common mica sapp	fr ss sp				
3		0-14	fill RCL/rock & bldr						B .25-.3 714"
		14-32	mfsbk ypc	fi fr sp					
		32-48	wk sbk brn pcl	fr ss sp	few-common mica sapp				
4		0-5	gr brn scl	fr					.25
		5-25	m nb ypc	fi sp					
		25-48	m-wk nb ypcl	fi-fr s-sp few-common gr/ironstones					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


WELL
SITE 144