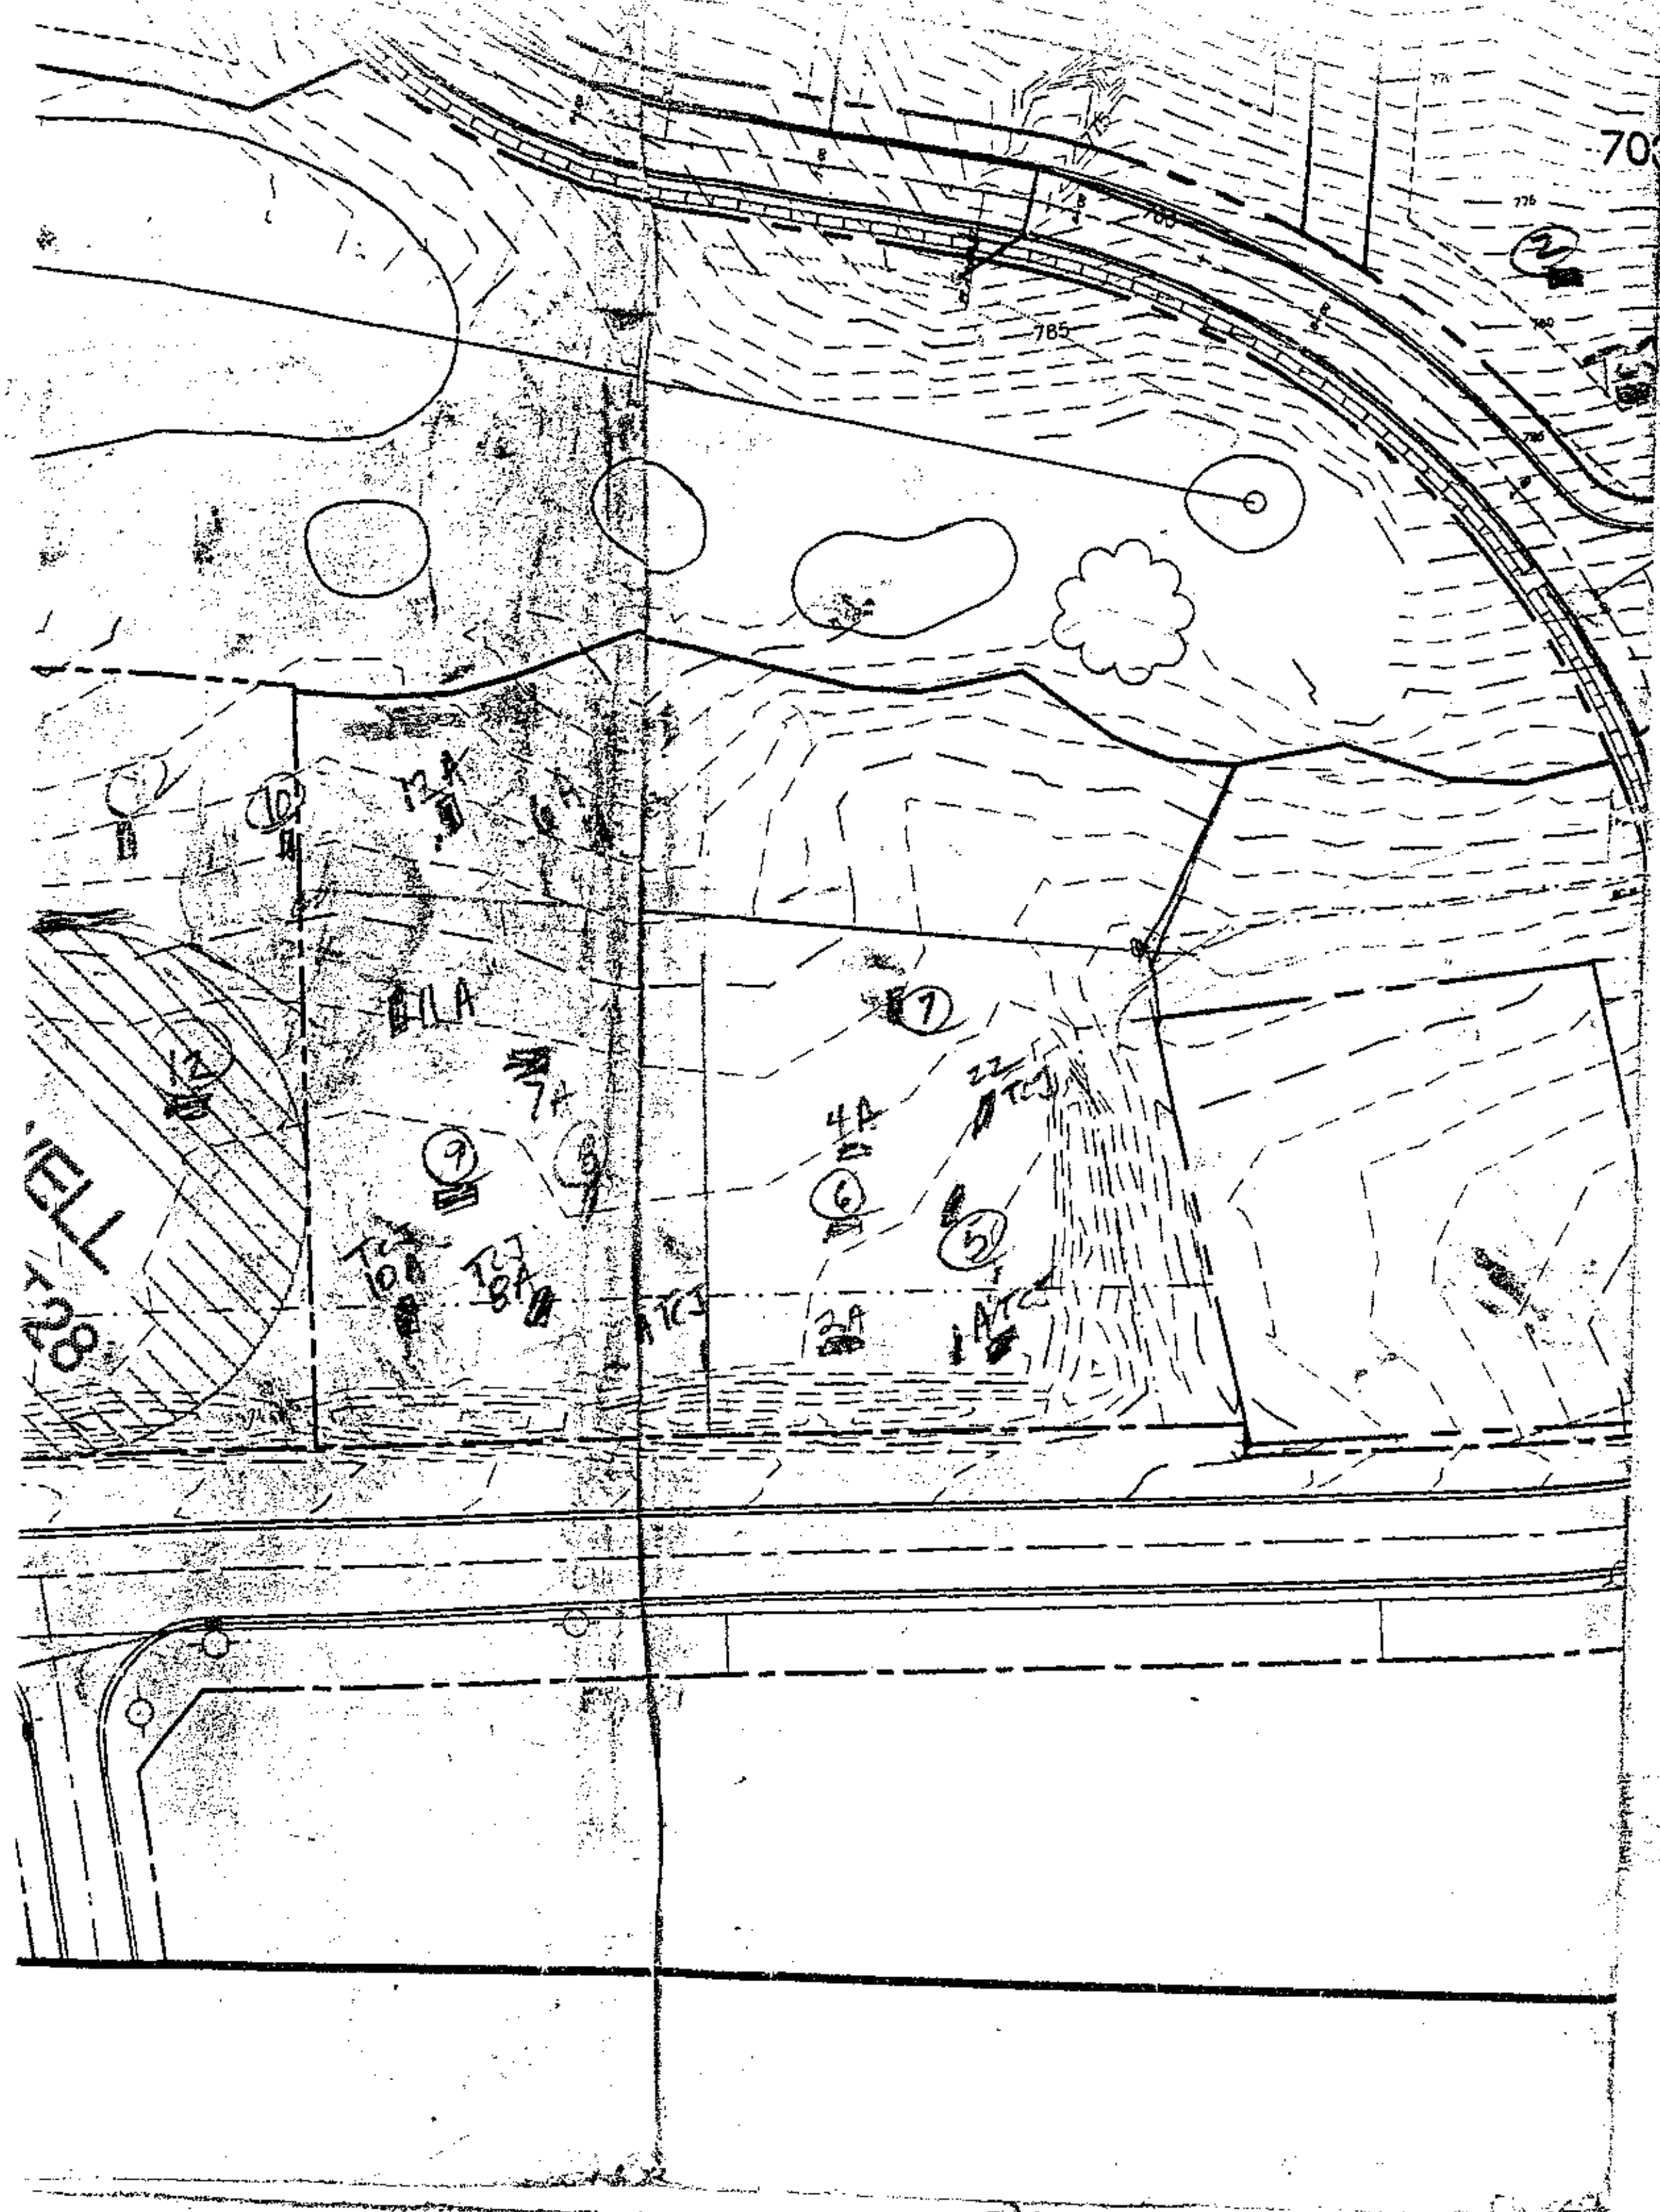


703
785
776
780
ELL
28
12
10
12A
6A
11A
7A
9
8
7
4A
6
5
22 TCJ
TCJ 10A
TCJ 8A
TCJ
2A
1A TCJ
2

...ON OF ENVIRONMENTAL HEALTH
...TE WASTEWATER SECTION

PROPERTY ID #: ____
COUNTY: ____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

CFL

ER: ____ APPLICANT: ____
RESS: ____ APPLICATION DATE: ____ DATE EVALUATED: 3-30-07
POSED FACILITY: ____ PROPOSED DESIGN FLOW (.1949): ____ PROPERTY SIZE: ____
ATION OF SITE: SFE's #s 7 ThePt PROPERTY RECORDED: ____
ER SUPPLY: ❑ Private ❑ Public ❑ Well ❑ Spring ❑ Other ____
LUATION METHOD: ❑ Auger Boring ❑ Pit ❑ Cut
E OF WASTEWATER: ❑ Sewage ❑ Industrial Process ❑ Mixed

.1940 LAND-SCAPE POSITION/ SLOPE%	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR. HORIZ	PROFILE CLASS & LTAR
#5	0-8	wk sab brn scl	fr sss p					
	8-21	AB pbrn cl	fr sp common yb mottles (lateral water movement)					.2-.25
	21-53	wk fsab yp cl	common mic smp fsssp					.25-.3
1A TCA	0-6	brn scl	sl compacted fi					
	6-48	AB RCL	many drainage mottles fi fr (agricultural)					.2
2A TCA	0-8	wk sab brn scl	fi					
	8-54	AB RCL	y brn mottles fi fr chz @ ~24"-47"					(4)
(6)	0-5	Somewhat compacted						
	5-23	AB RC	Common yb brn mottles					.2
	23-51	wk fsab yp cl	Com-common mic smp fsssp					.25-.3

N OF ENVIRONMENTAL HEALTH
E WASTEWATER SECTION

PROPERTY ID #: ____
COUNTY: ____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

CP1

R: ____ APPLICANT: ____
ESS: ____ APPLICATION DATE: ____ DATE EVALUATED: 3-30-01
OSED FACILITY: ____ PROPOSED DESIGN FLOW (.1949): ____ PROPERTY SIZE: ____
TION OF SITE: plus 7 SFE Theft PROPERTY RECORDED: ____
R SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other ____
JATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

much rain on 3-29-01

.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
4K TCS	0-7	wksbk brnsl	fi fr					
	7-18	AB RCL	common y brn mottles fi fr					.2
	18-48	wksbk RCL	few-common mist Stp fi fr					.25-.3
22 TCS	0-25	compacted (casting) sicl/c	sf fi					
	25-48	wksbk yp cl	fr sssp common mist Stp					.25 @ 25"
(1)	0-12	wksbk brnsicl	fr sp					
	12-29	SAB RCL	fr sp-sssp	few y brn mottles				.25
	29-54	wksbk yp cl/L	common-many mist Stp					
(8)	0-5	compacted brnsicl	fr sssp					
	5-25	m AB yp cl	few y brn mottles fr sp					.2-.25
	25-50	wksbk/m yp cl	fr sssp few-common mist Stp					.3