
WALL HEIGHT (h)	STUD SIZE/ SPACING
h < 10'	2x4 @ 16" oc
10' < h < 11'	2x4 @ 12" oc
11' < h < 18'	2x6 @ 16" oc
h > 18'	CONSULT ENG.

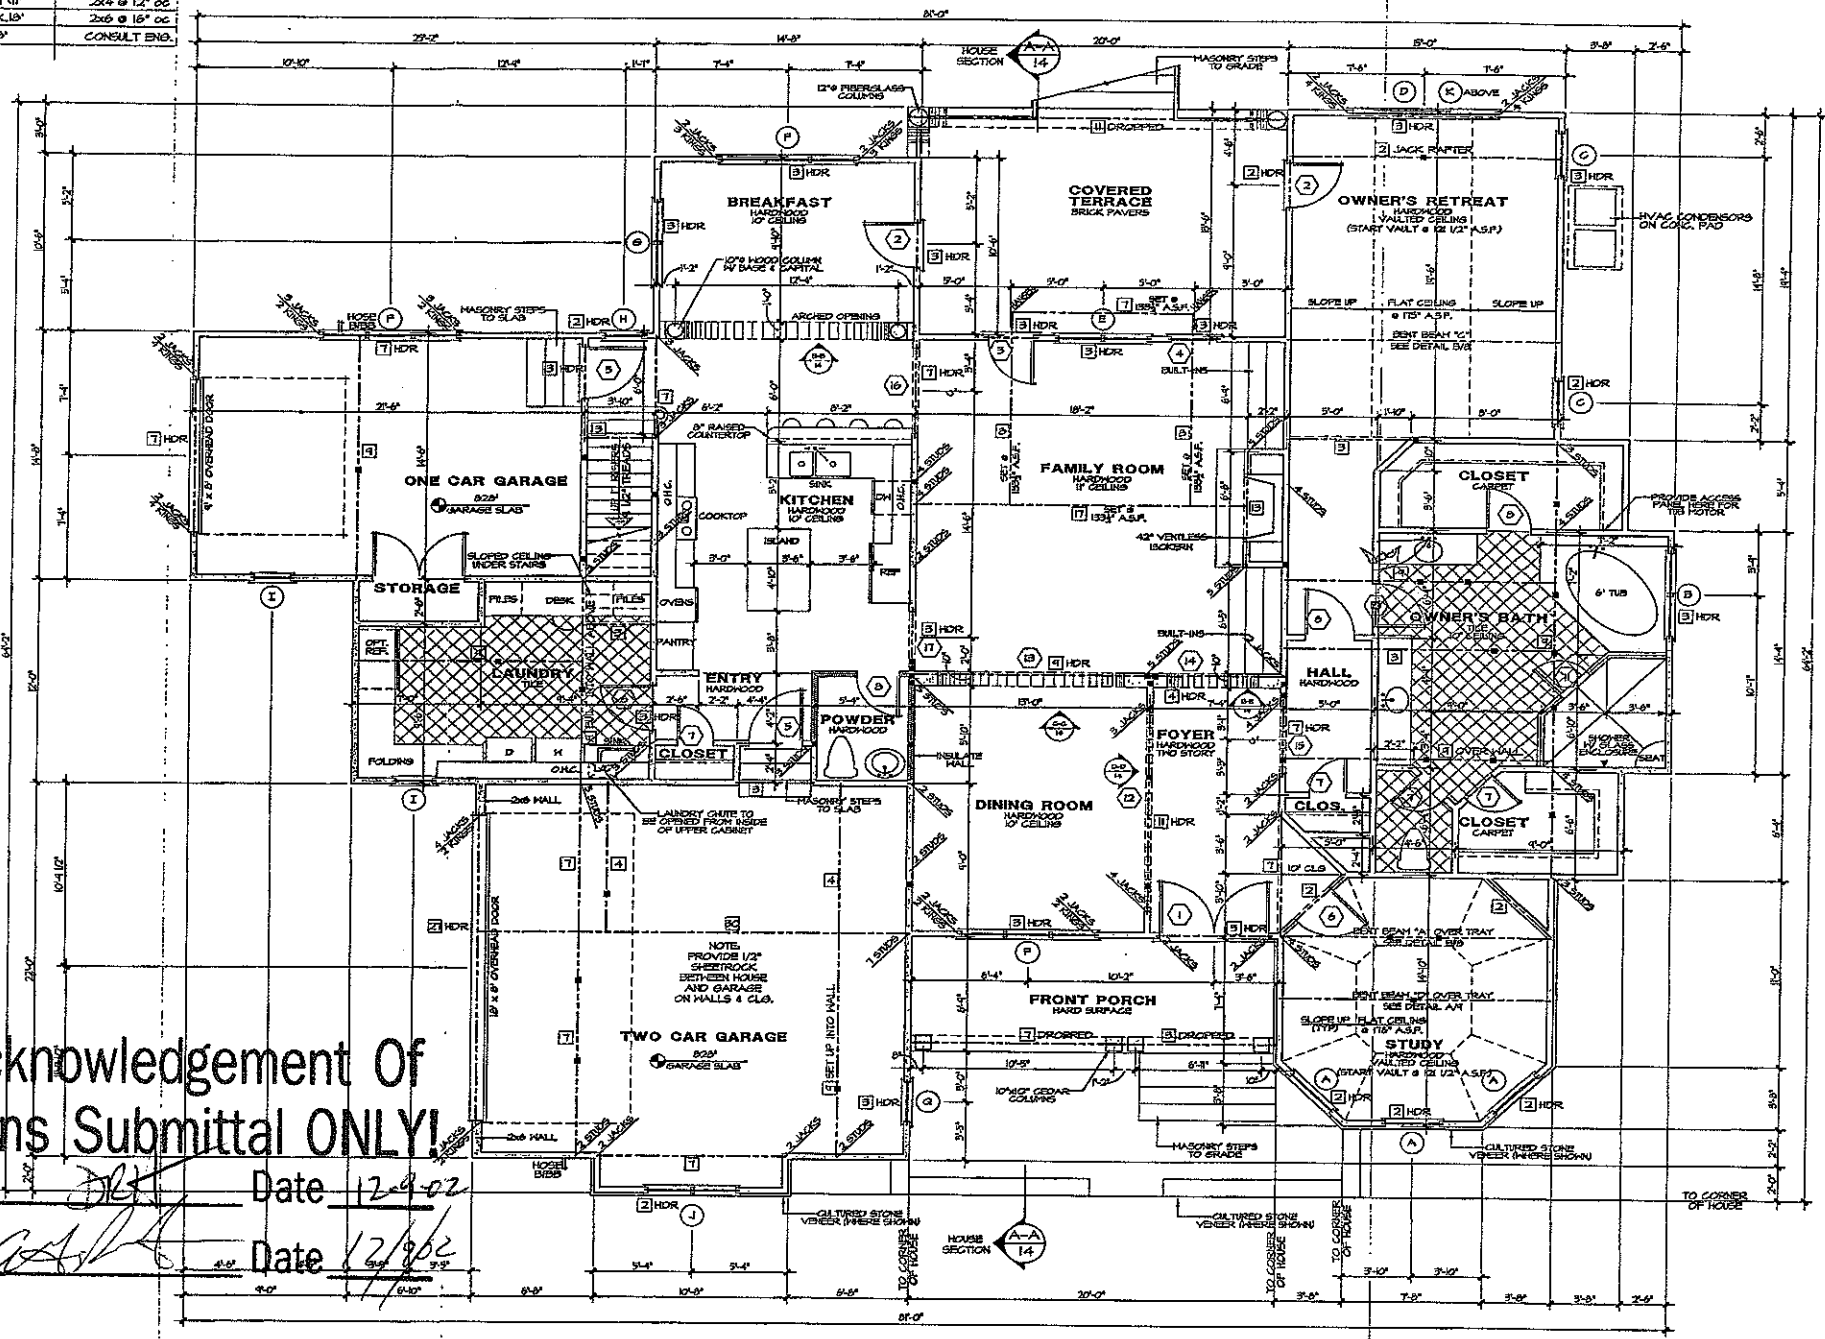

Acknowledgement Of Plans Submittal ONLY!


Date 12-9-02

Date 12/9/02

NOTE: ALL ANGLED WALLS ARE AT 45°

BUILD IN REVERSE

■ INDICATES BLOCKING FOR ABOVE CONCENTRATED LOADS UNLESS NOTED OTHERWISE.

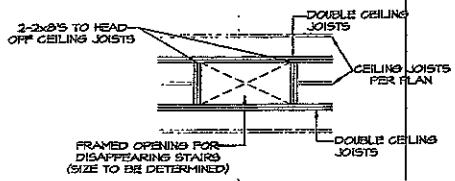


DISAPPEARING STAIR DETAIL (A)

Acknowledgement Of Plans Submittal ONLY!


Date 12-9-02

Date 12/9/02

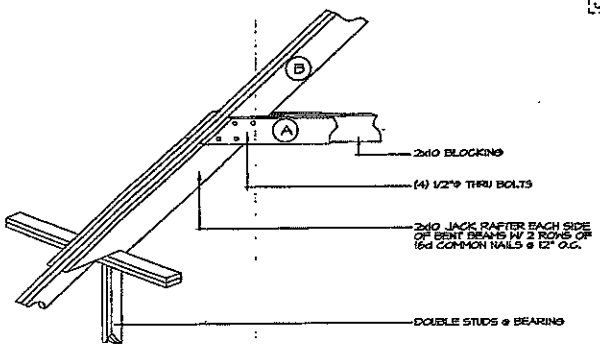

BENT BEAM	A	B
"A"	2-1 3/4" x 9 1/4" LVL	2-1 3/4" x 9 1/4" LVL
"B"	2-1 3/4" x 9 1/4" LVL	2-2x10 S.Y.P.
"C"	2-2x10 S.Y.P.	2-2x10 S.Y.P.

BENT BEAM DETAIL "A", "B", & "C" (B)

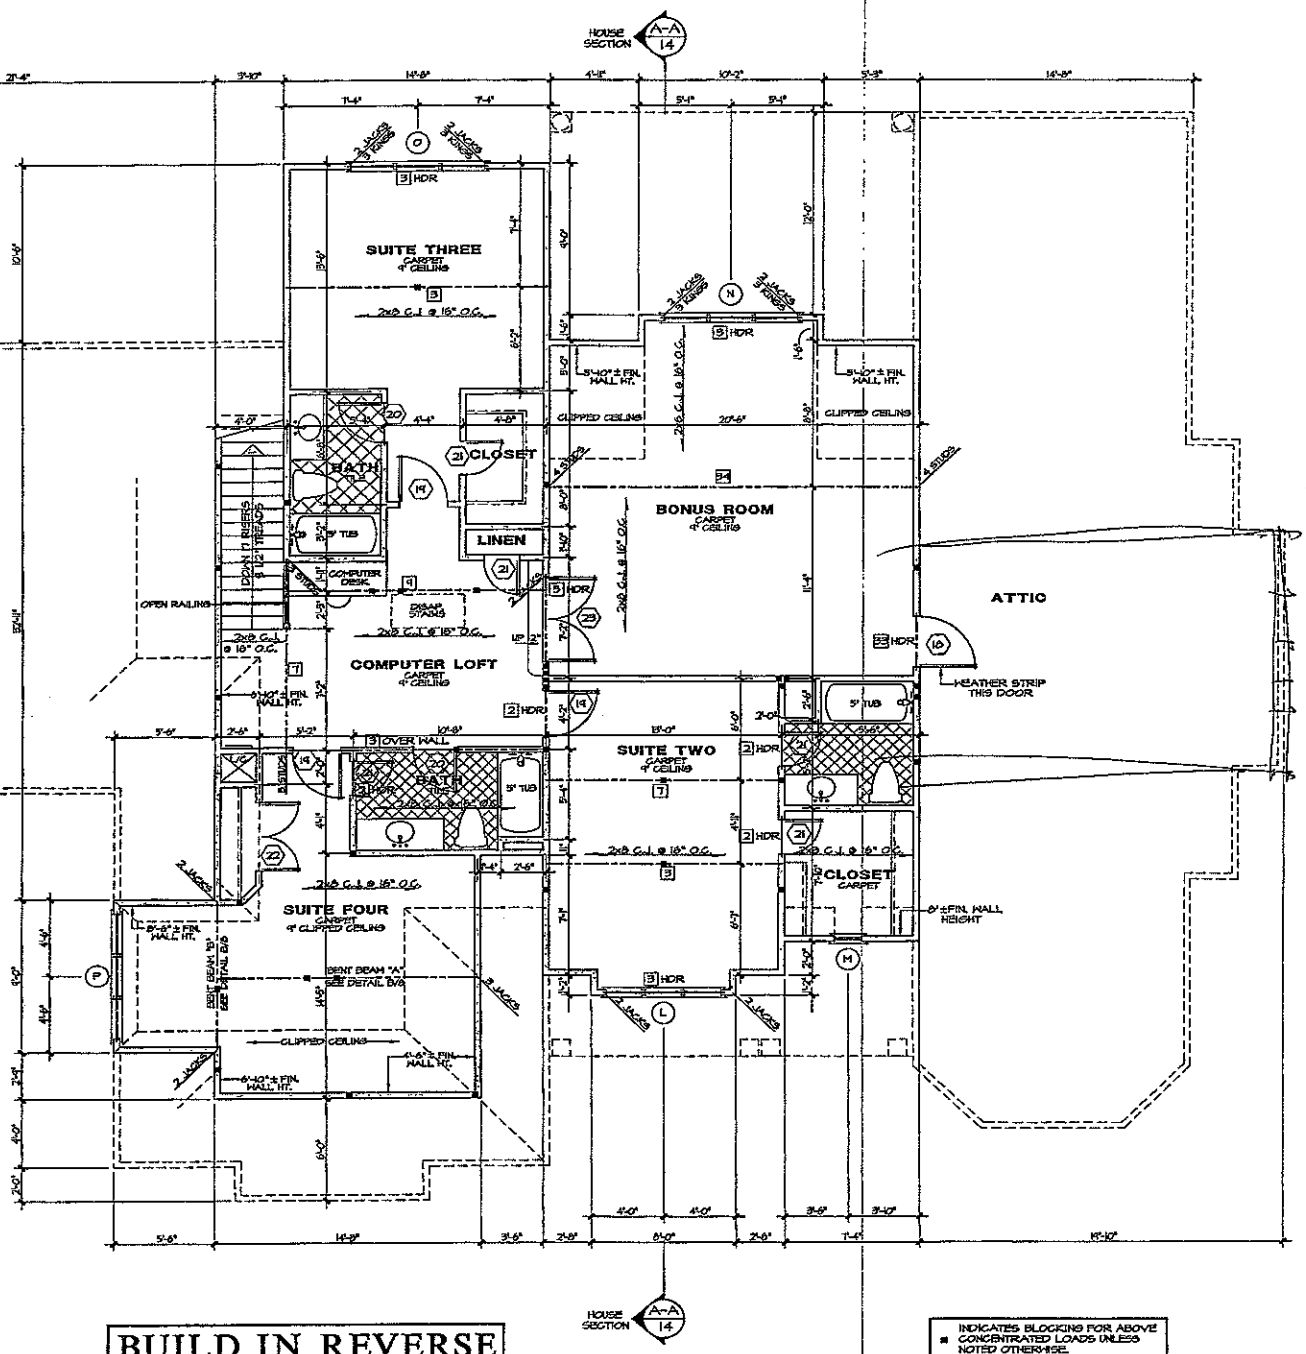

BUILD IN REVERSE

■ INDICATES BLOCKING FOR ABOVE CONCENTRATED LOADS UNLESS NOTED OTHERWISE.

NOTE: ALL ANGLED WALLS ARE AT 45°