DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

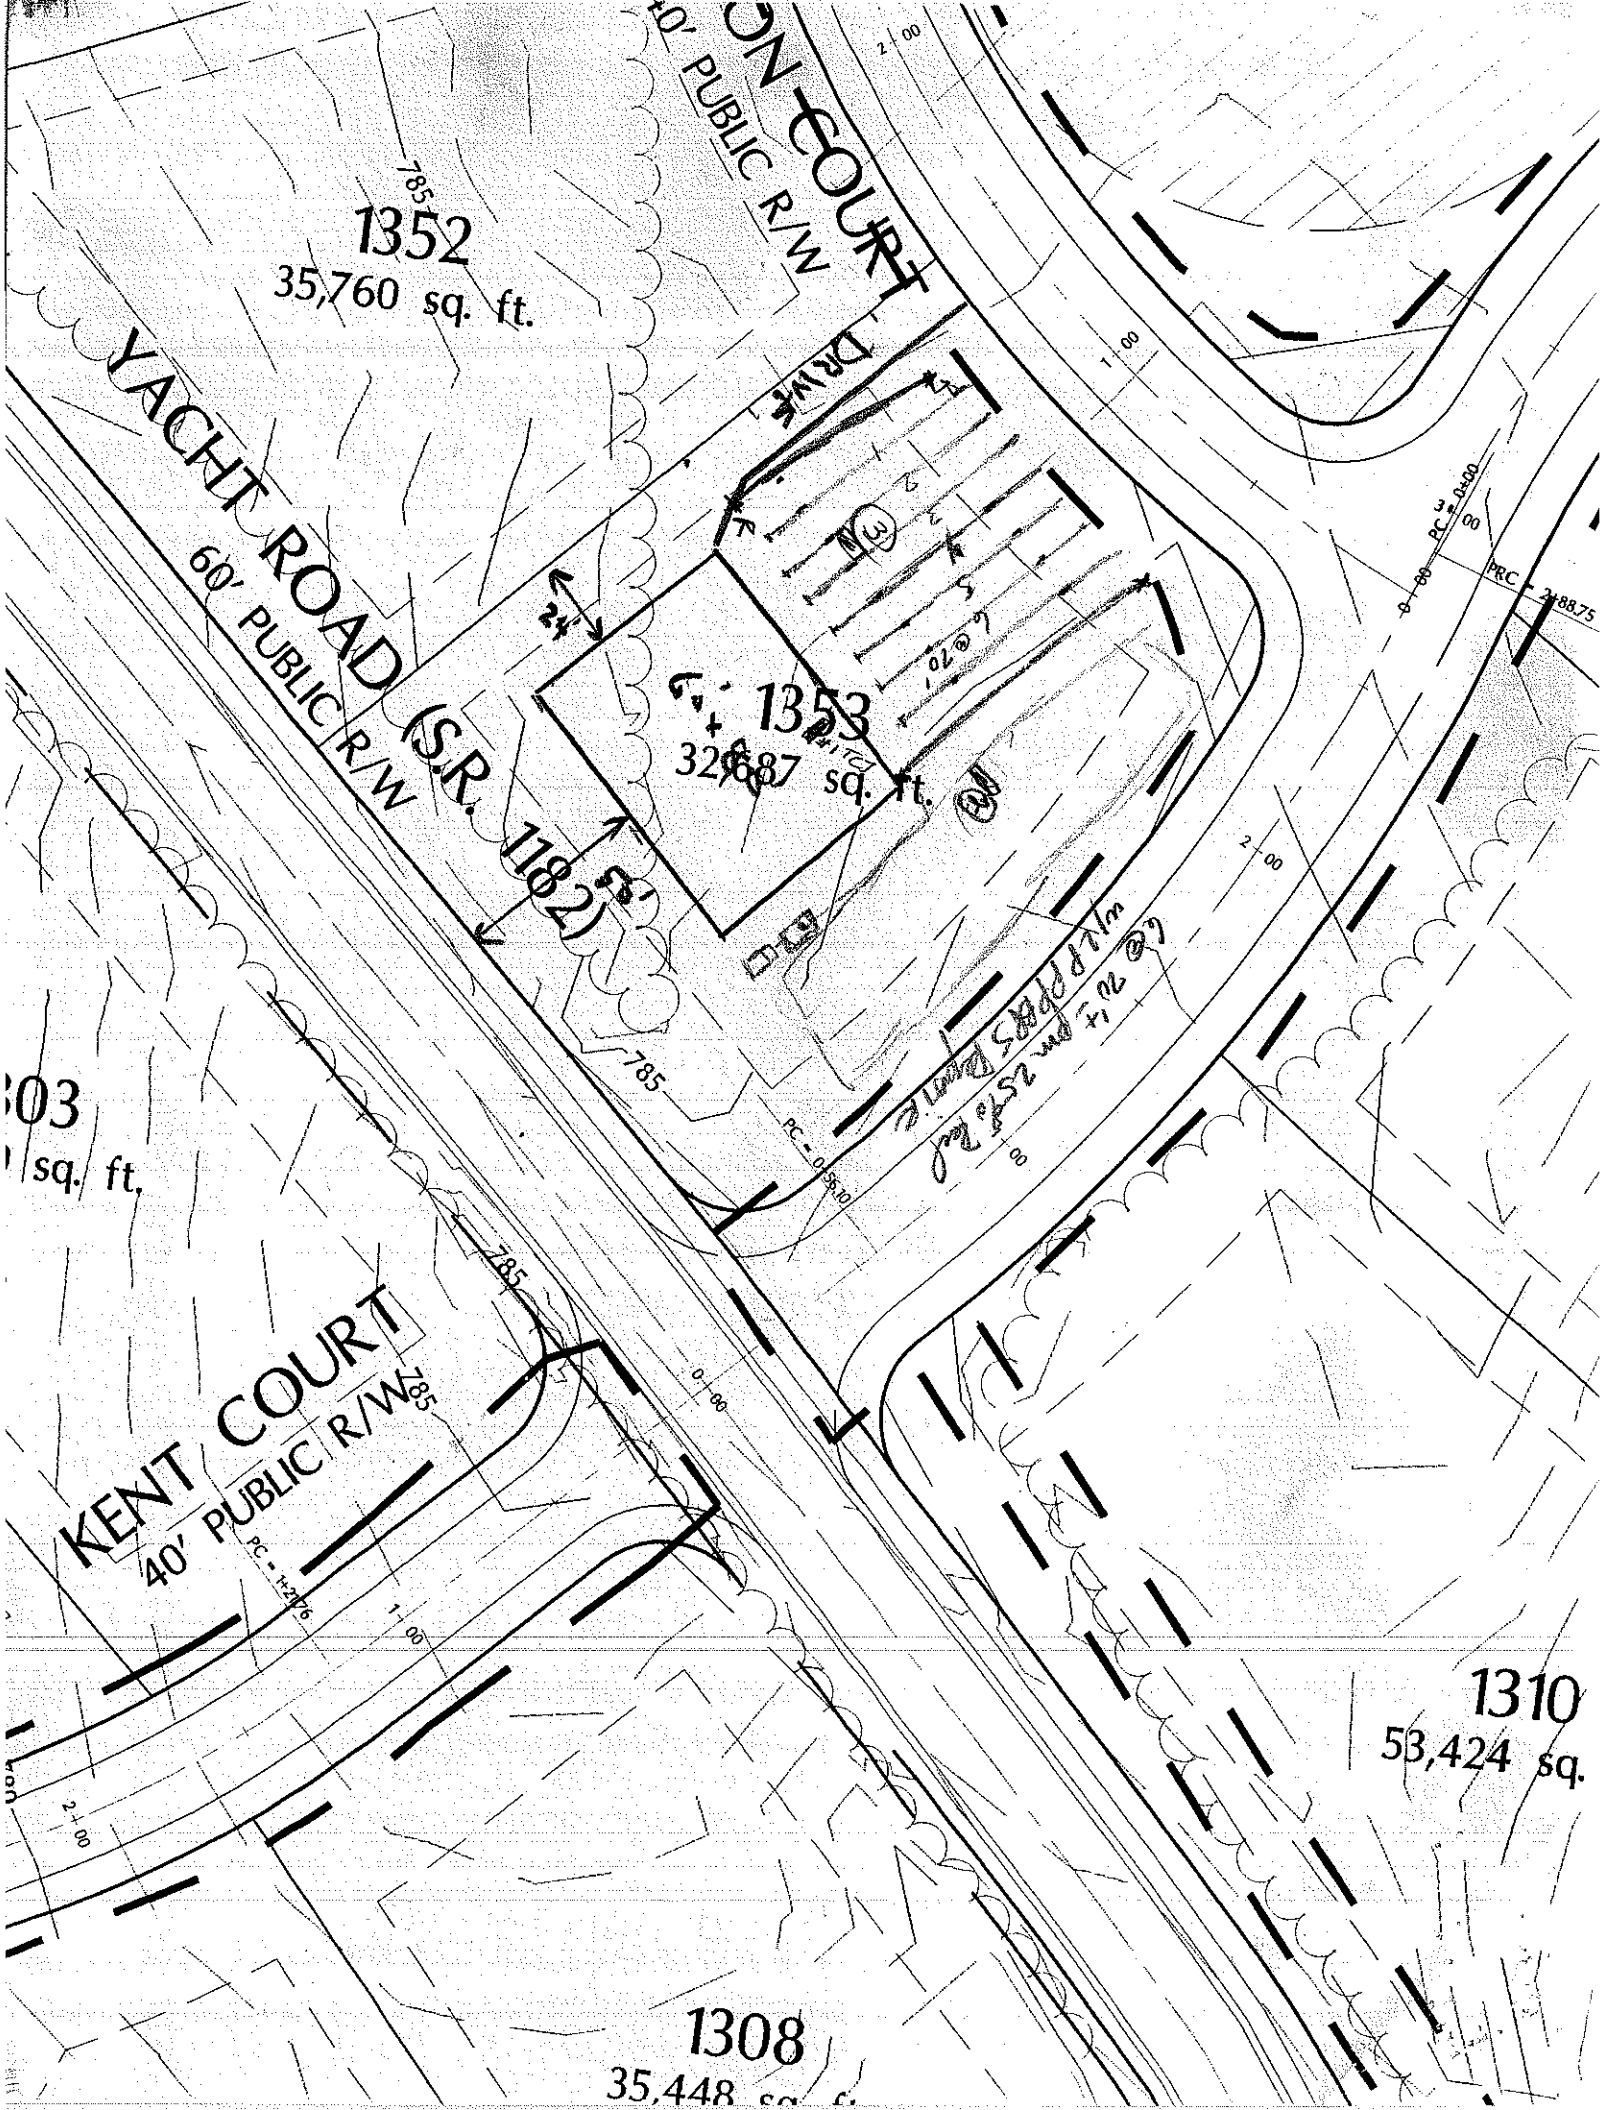
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 3-26-04
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 1353 Phase 13 Trent PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	#1 TOP	0-24	MFABK RC	FI SP SEXP	few-common	mod sap			.25-.3
		24-46	MFSBK YRCL	FRSSSP					
2		0-5	WKSBK RBRNSCL	FRSSSP					
		5-22	MFSBK RC	FR SP SEXP					<.3
		22-54	WKFSBK YRCL	FRSSSP	few-common	mod sap			
3	3% ±	0-8	WKFSBK BRNSCL	FRSSSP					<.27"; .25
		8-27	MFABK RC	FR SP SEXP	few-common	yb brn mottles			
		27-55	WK-MASS YRCL	FRSSSP	few mod SAP				.37 .27"
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Conv 25% Red	LPPBPS
Site LTAR	.25-.3	.25-.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: _____
OTHER(S) PRESENT: Paul Pennington


1352
35,760 sq. ft.
YACHT ROAD (S.R. 1182)
60' PUBLIC R/W
ON COURT
40' PUBLIC R/W
1353
32,687 sq. ft.
DRIVE
24'
785
PC = 0+58.10
PRC = 2+88.75
KENT COURT
40' PUBLIC R/W
PC = 1+27.76
1310
53,424 sq.
1308
35,448 sq. ft.
303
sq. ft.