DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

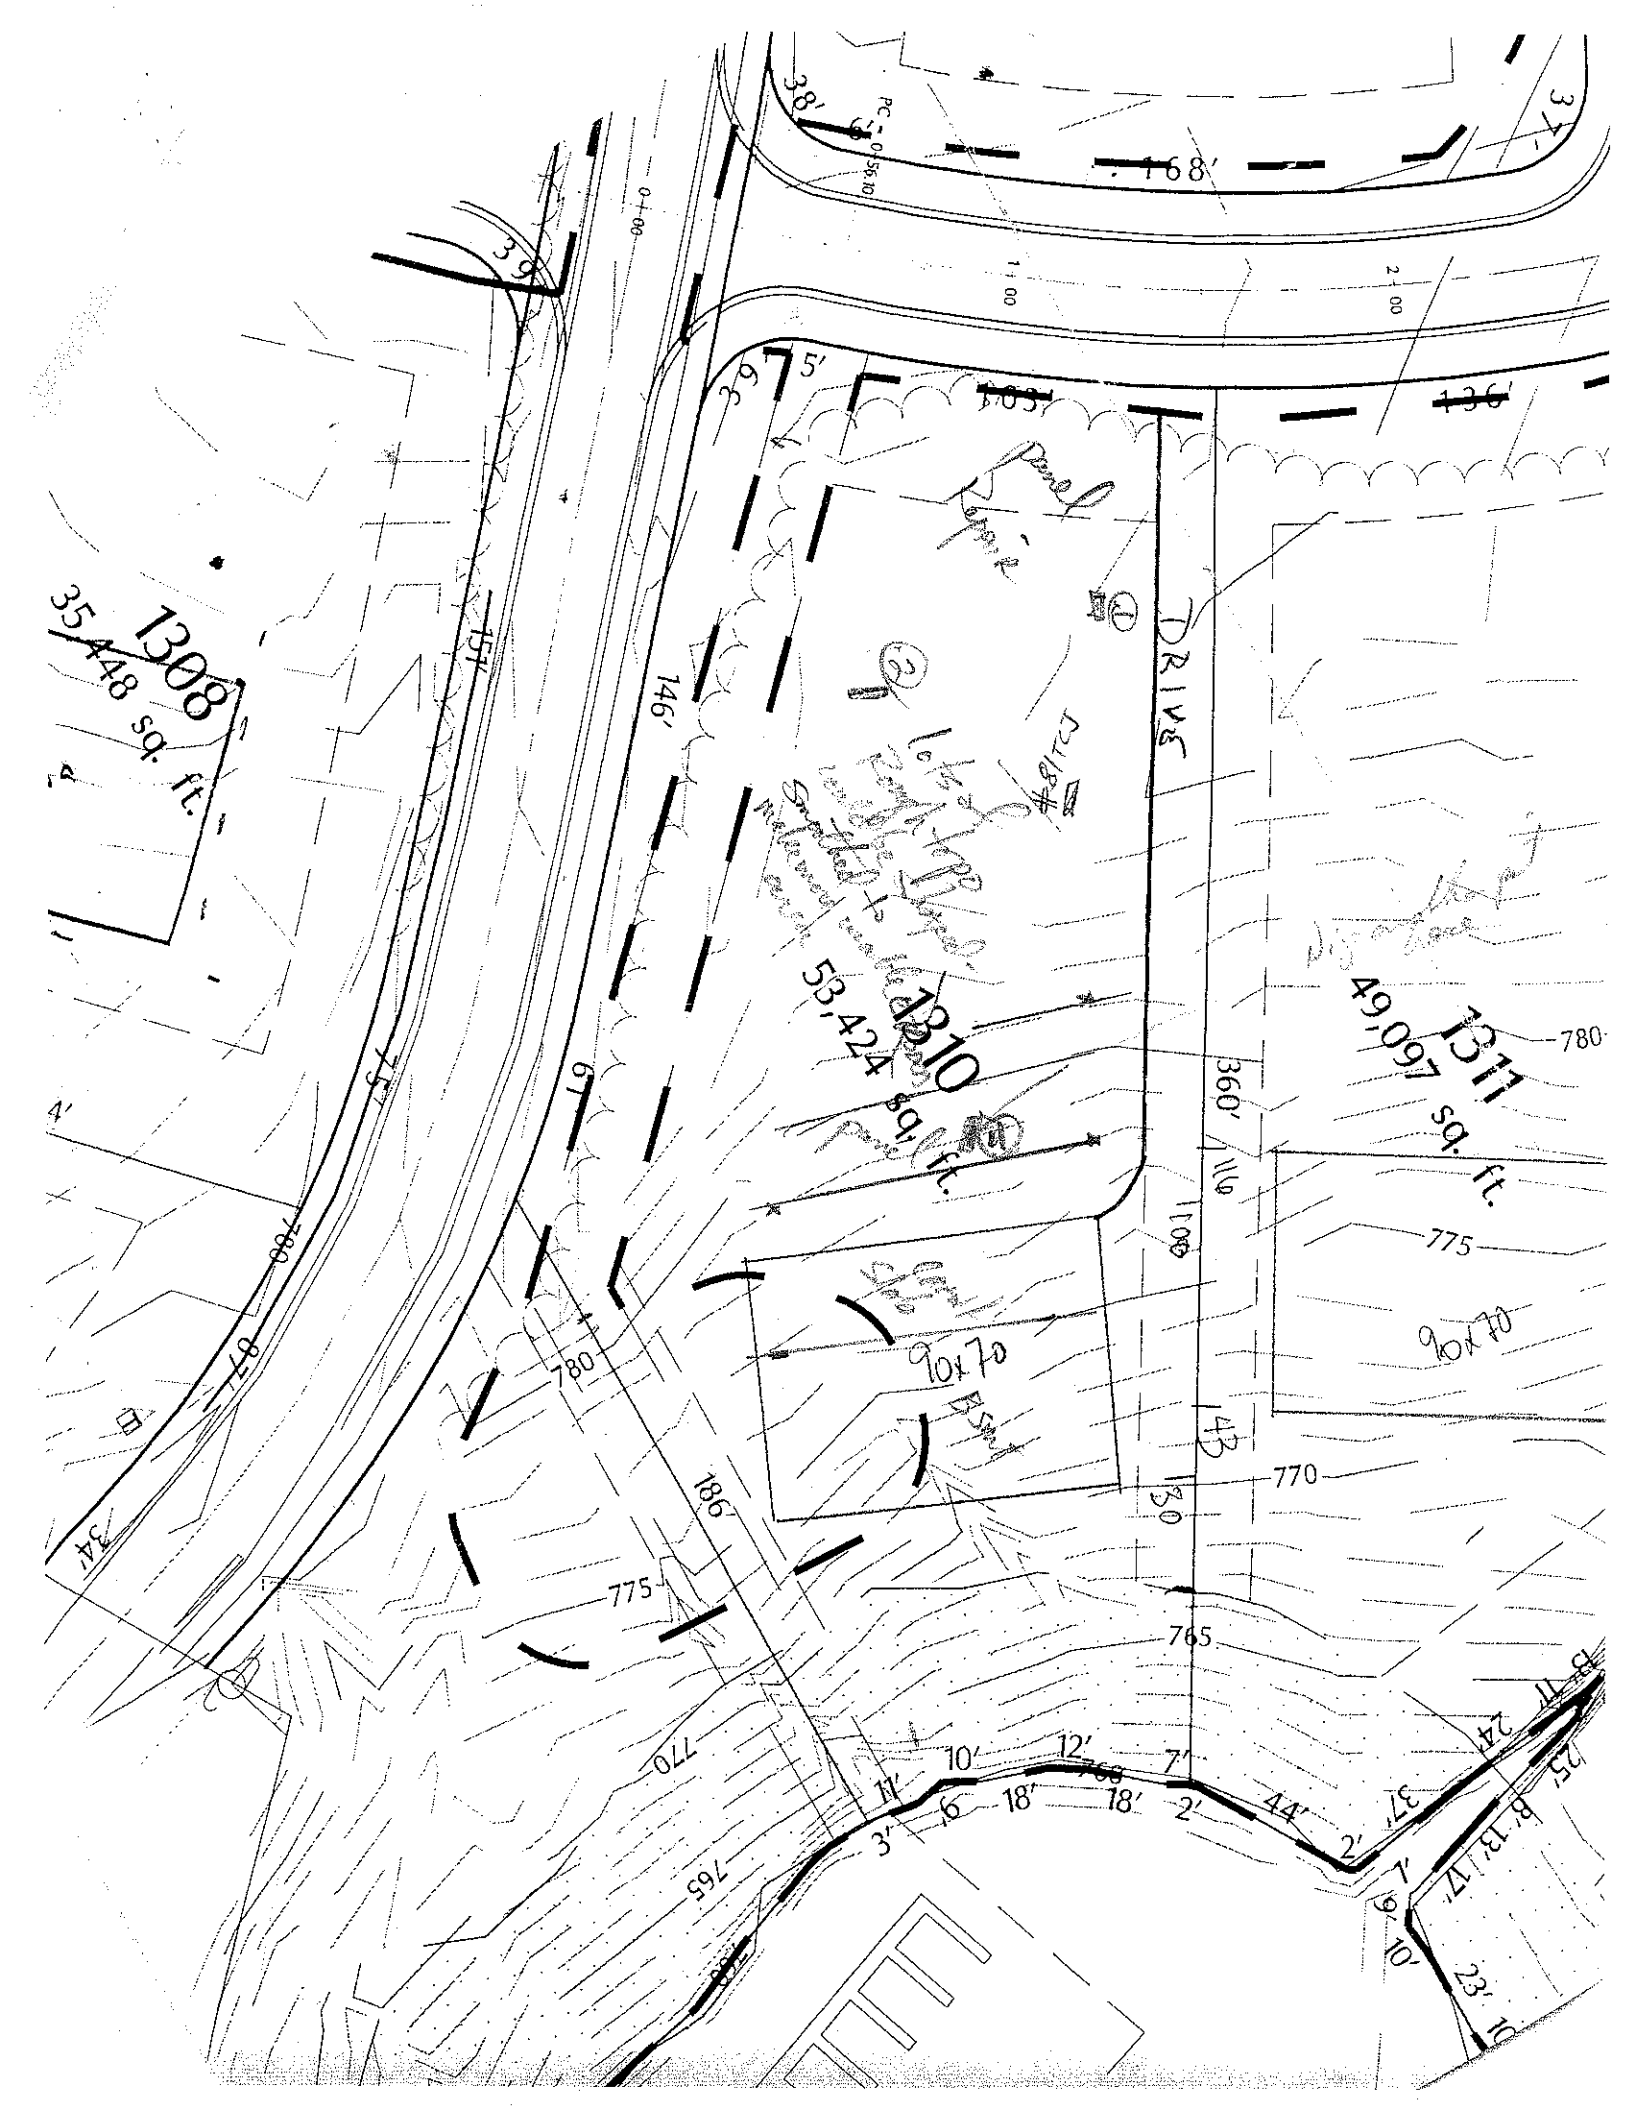
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 3-26-04
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: lot 1310 plus 13 The Pt. PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-13	wk-m fsbk/sbk RC/cl	fi-fr ss-ps-p					.3
		13-47	wk fsbk-massive LS	fr ss-p					
2		0-6	wk fsbk RC/vcl	fr ss-p					.3
		6-38	m-wk fsbk RCl	fr ss-p					
		38-56	massive RY LS	fr ss-p					
3	#81 TCJ	0-36	mm sbk RC	fr ss-p					.25-.3
		36-46	wk sbk RCl	fr ss-p					
4	4804 7%±	0-12	gr sbk	fr ss-p					.3
		12-36	m fsbk/sbk RC	fr so ss-p					
		36-60	wk sbk up-parent matl	fr ss-p					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	LP PP BPS	LP PP BPS
Site LTAR	.125-.3	.25-.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
OTHER(S) PRESENT: DHT Paul Pennington
Lots of complex topo - with shapings other system options may exist.


1308
35,448 sq. ft.
1310
53,424 sq. ft.
1311
49,097 sq. ft.
DRIVE
90x70
90x70
780
775
770
765
760
146'
186'
168'
136'
105'
39'
38'
34'
75'
87'
360'
116'
100'
130'
143'