DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

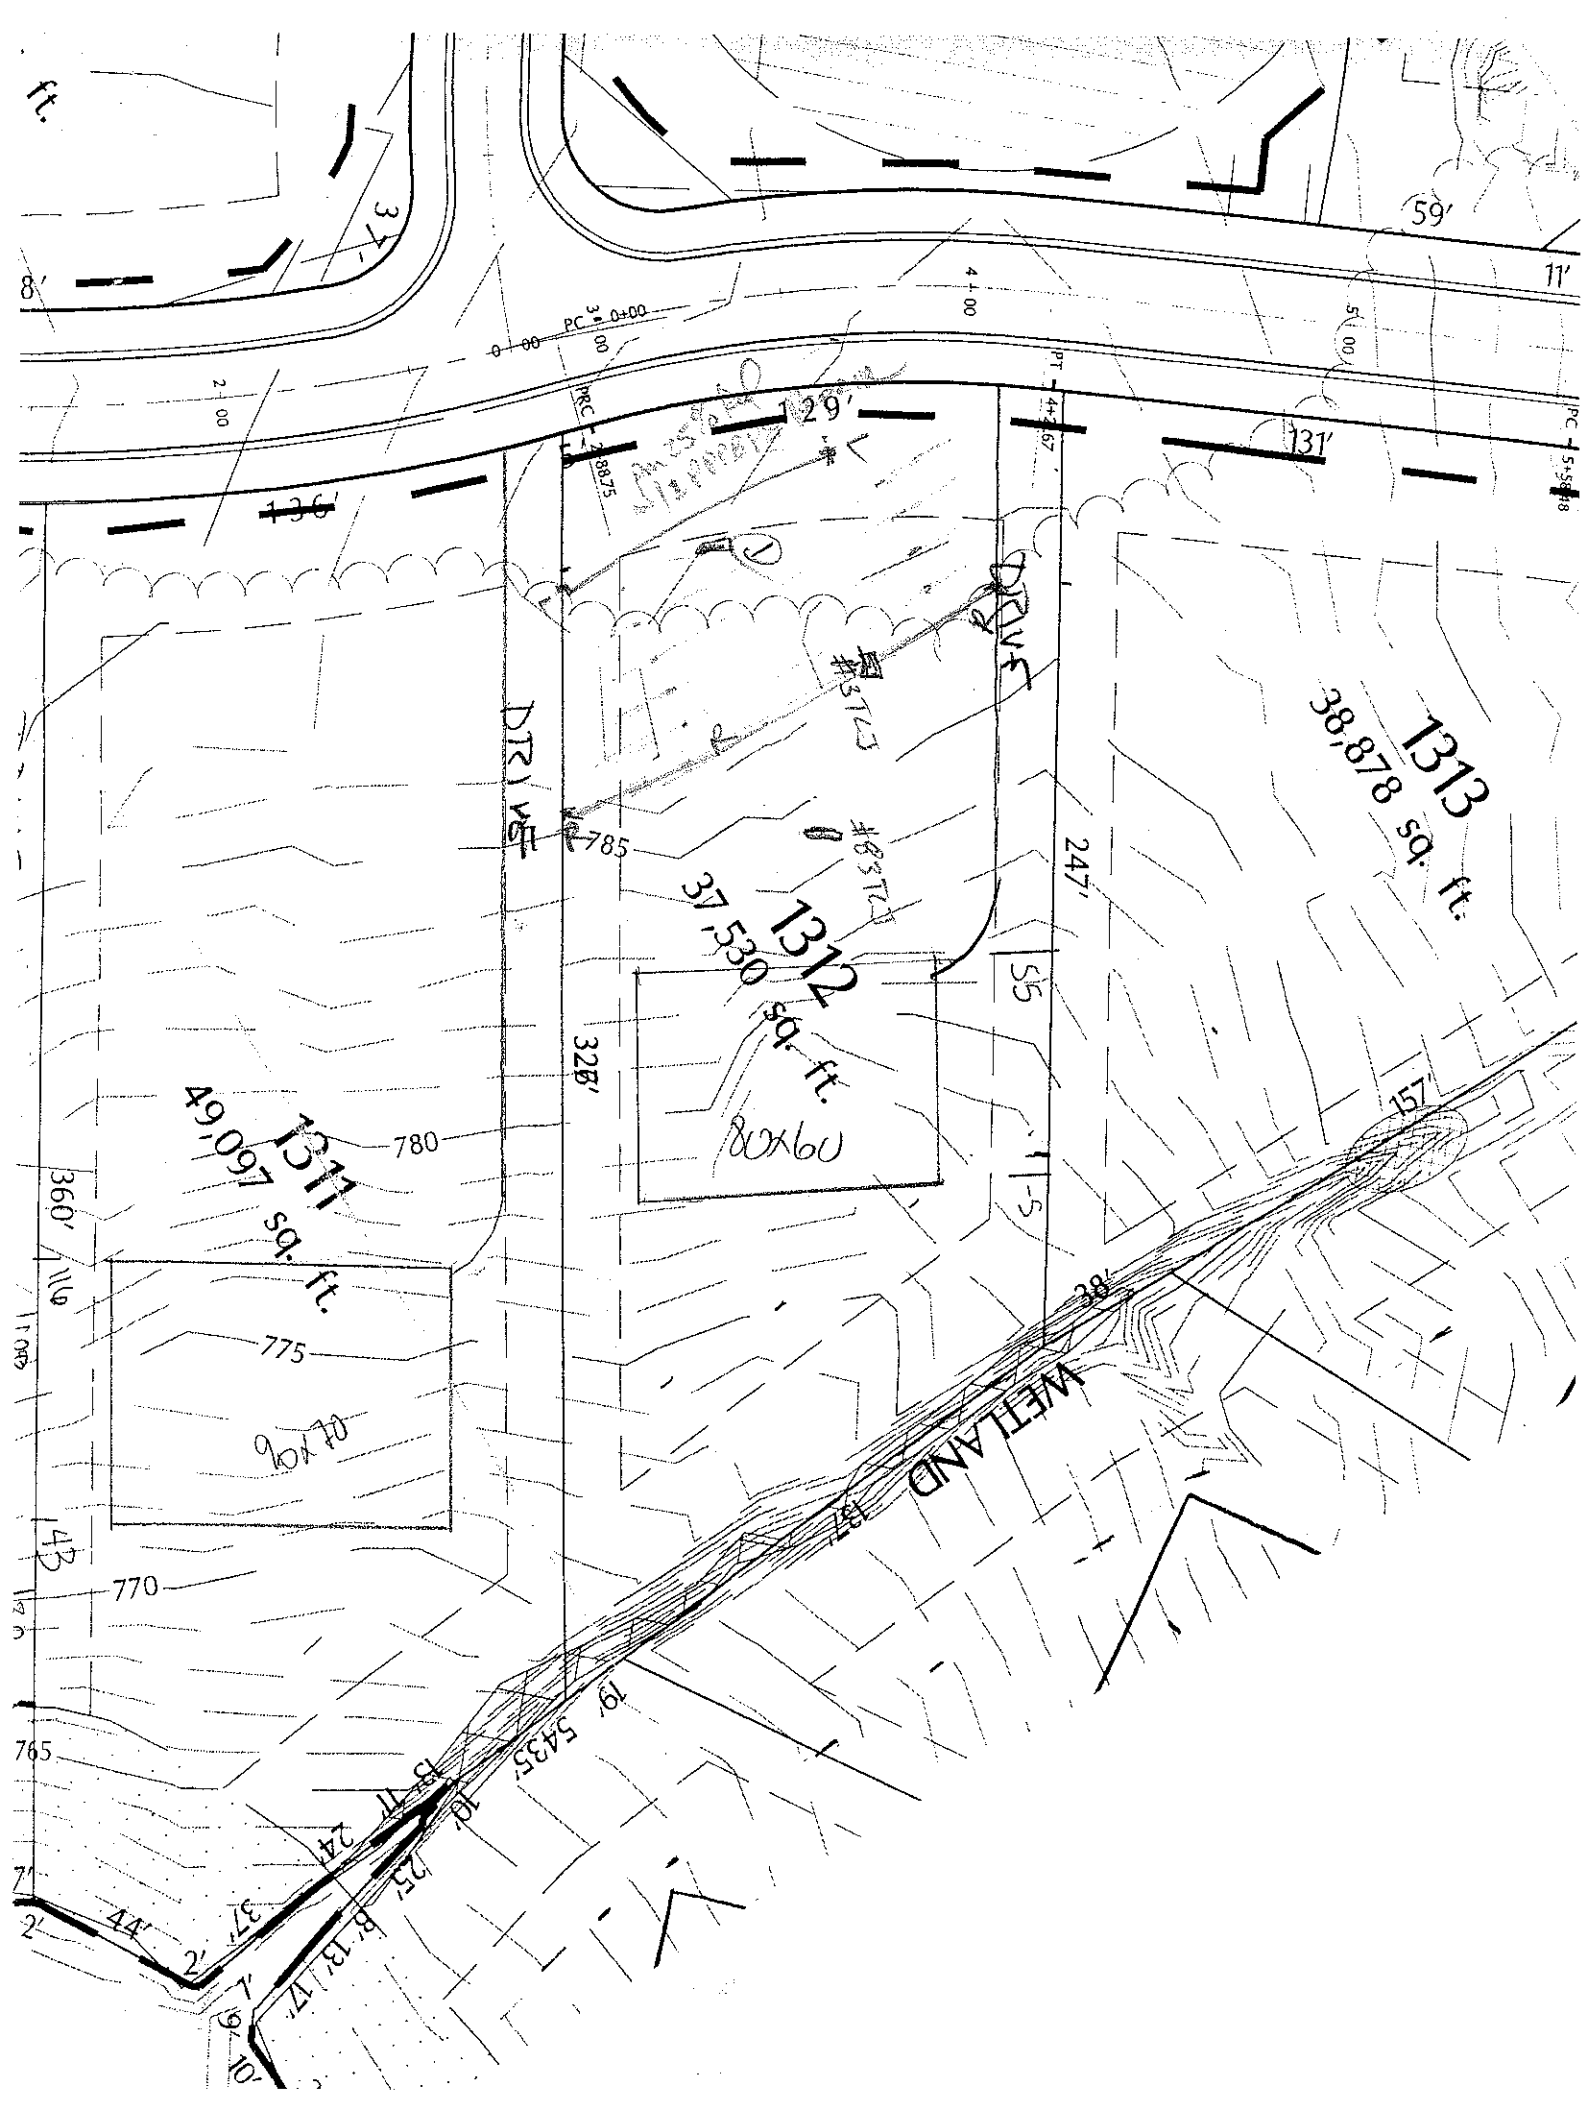
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 3-26-04
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4 bdrm PROPERTY SIZE: _____
LOCATION OF SITE: Lot 132 Phase 15 Dept PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	wk sbk r bk sl	fr sss p	common mid sap				.3
		6-25	wk m sbk rel cl	fr fp-ss p					
		25-59	massive L/SiCl sap	fr sss p					
2	#3 TCS 4-6% L	0-10	gr bk sl cl	fr sss p	common mid cl sap				.3
		10-42	wk sbk - d/sbk cl	fr ss p					
3	#83 TCS	1-38	wm sbk rc	fr sss p	mid sap				.3
		38-48	(b-c) wk sbk rel	fr ss p	common mid sap				
		48+	massive gr L sap	fr sss p					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	RS	RS
System Type(s)	gravel 35% Red	LPP 25-50% Red
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): B
EVALUATED BY: DRH
OTHER(S) PRESENT: Kent Hannegan


PC 0+00
PT 4+67
PC 5+58
59'
11'
131'
129'
136'
DRIVE
DRIVE
#3743
#3737
1313
38,878 sq. ft.
1312
37,530 sq. ft.
80x60
1311
49,097 sq. ft.
90x70
247'
55
32B'
157'
WETLAND
137'
785
780
775
770
765
360'
114'
43'
38'
79'
54.35'
18'
11'
10'
25'
24'
37'
44'
2'
7'
9'
10'