DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___


SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: The Point on Norman APPLICANT: ___
ADDRESS: ___ APPLICATION DATE: ___ DATE EVALUATED: 6/25
PROPOSED FACILITY: House PROPOSED DESIGN FLOW (.1949): 480 PROPERTY SIZE: ___
LOCATION OF SITE: ___ PROPERTY RECORDED: ___
WATER SUPPLY: ☐ Private ☒ Public ☐ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed
1374

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	Linear 2-4%	0-2	Mo GR SL	SS SP FR	Br				.3
		2-17	Mo SBK C	SS SP FR	Red				
		17-29	Mo SBK CL	SS SP FR	Red; F sap				
		29-48	WK SBK CL	SS SP FR	Red; F sap				
2	Linear 2-4%	0-4	Mo GR SL	SS SP FR	Br				.3
		4-26	Mo SBK C	SS SP FR	Red				
		26-31	Mo SBK CL	SS SP FR	Red; F sap				
		31-48	WK SBK CL	SS SP FR	Red; F sap				
3	SLK 8-8-05 8% L	0-17	wk sbk brn sl	fr ss sp					.3
		17-35	SBK RC	fr ss so sp					
		35-54	wk SBK Rd	fr ss sp mic sap					
4	~6½% L	0-7	wk sbk brn sl/sl	fr ss sp					.3
		7-41	SBK RC	fr ss so sp					
		41-54	wk SBK Rd	fr ss sp mic sap					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): ___
EVALUATED BY: ___

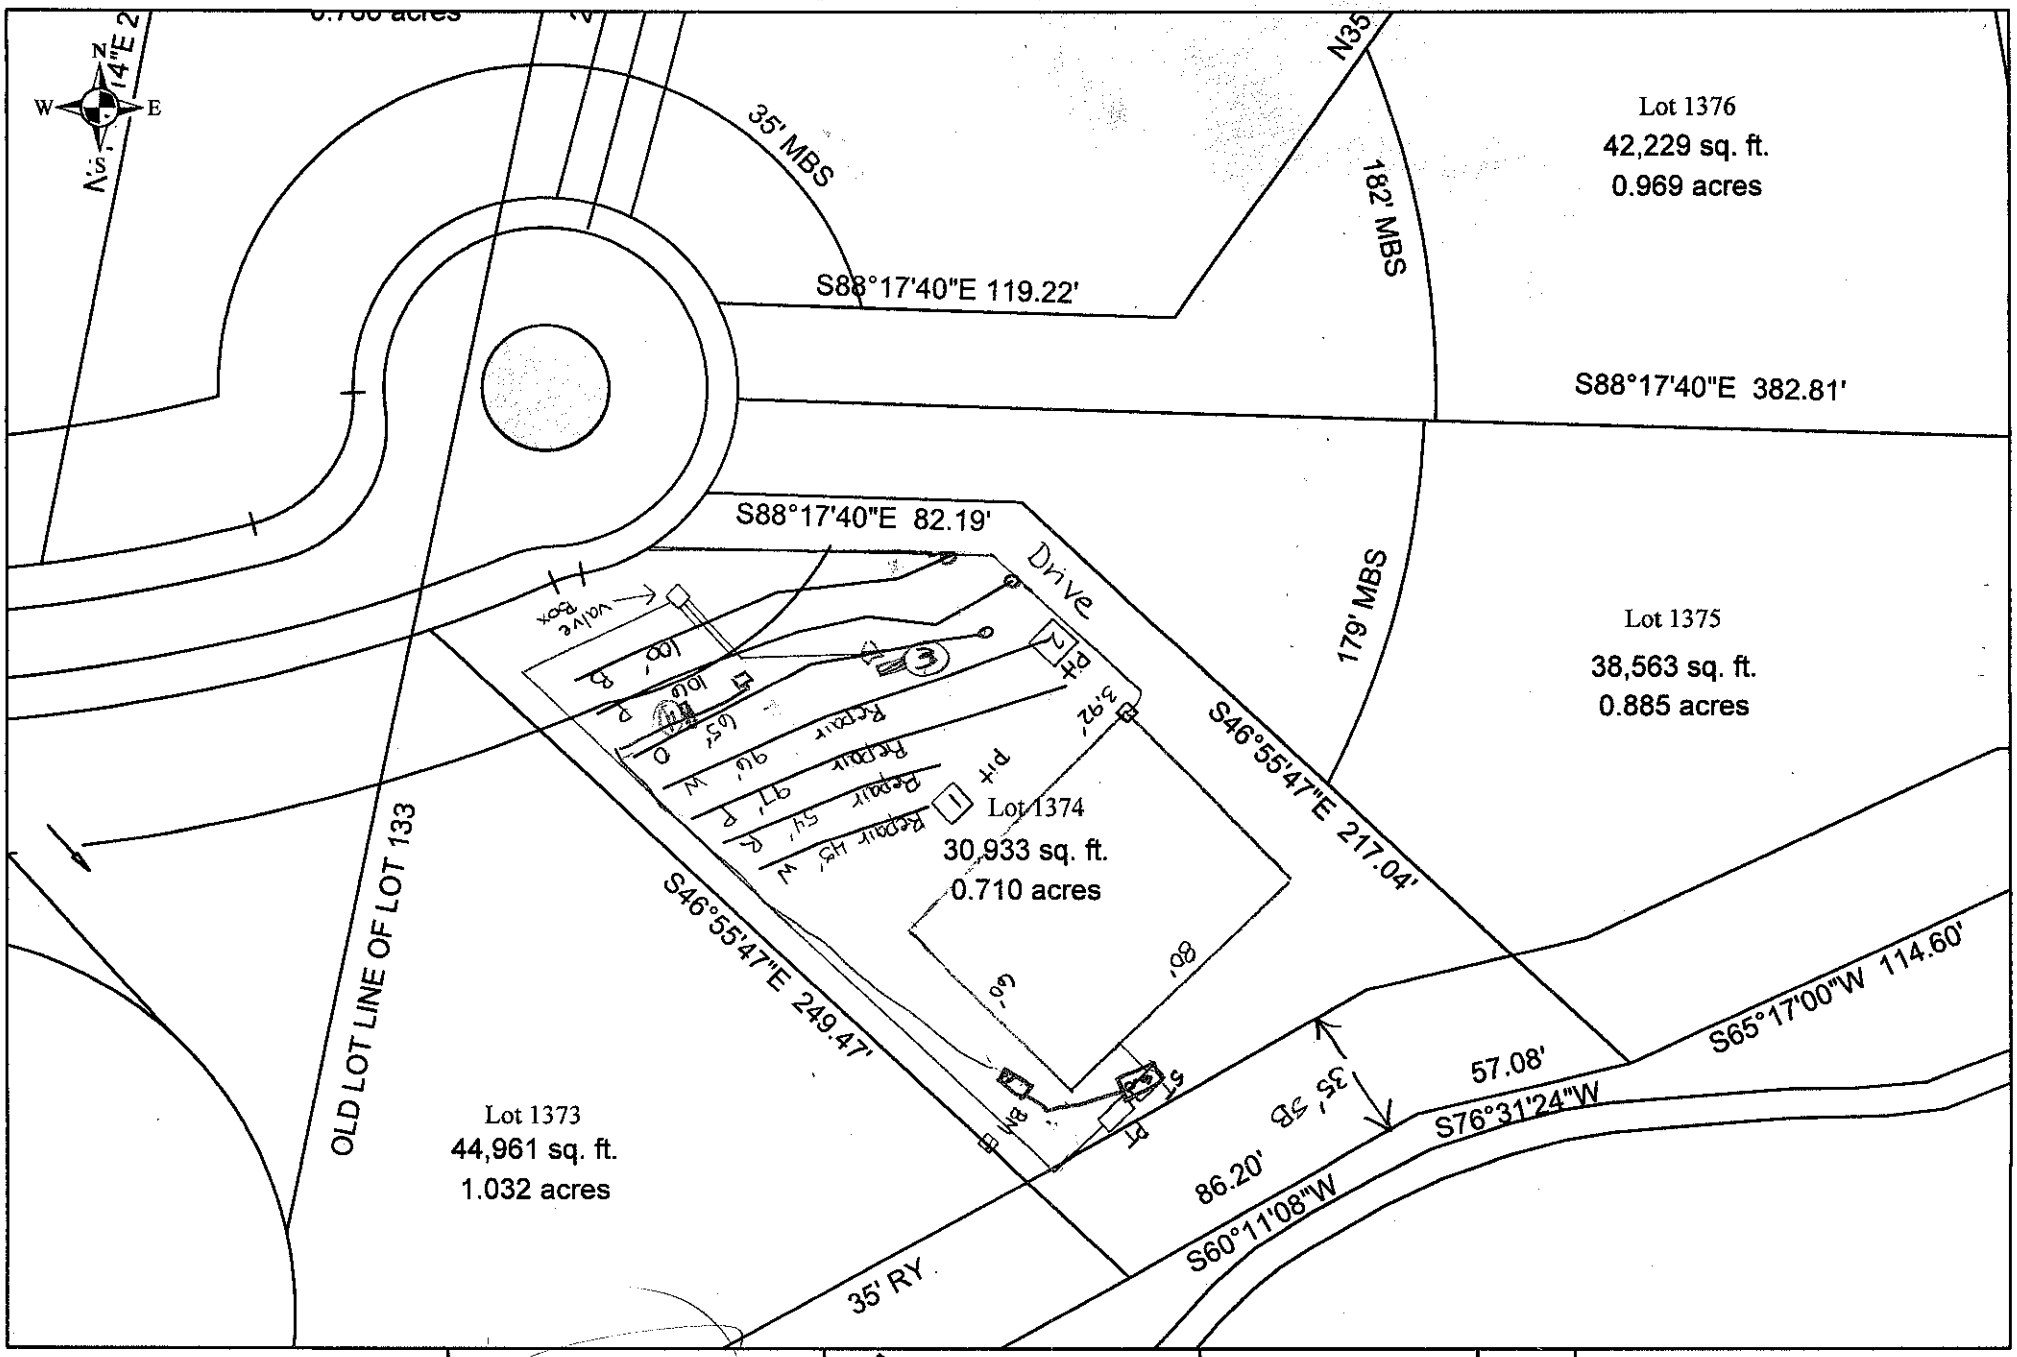

Scale: 1 inch equals 50 feet	S&ME ENVIRONMENTAL SERVICES · ENGINEERING · TESTING	The Pointe Phase 13	FIGURE
Drawn by: JBP		Lot 1374	1
Reviewed by: P_P		Iredell County, NC	
Date: July, 2005			