DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

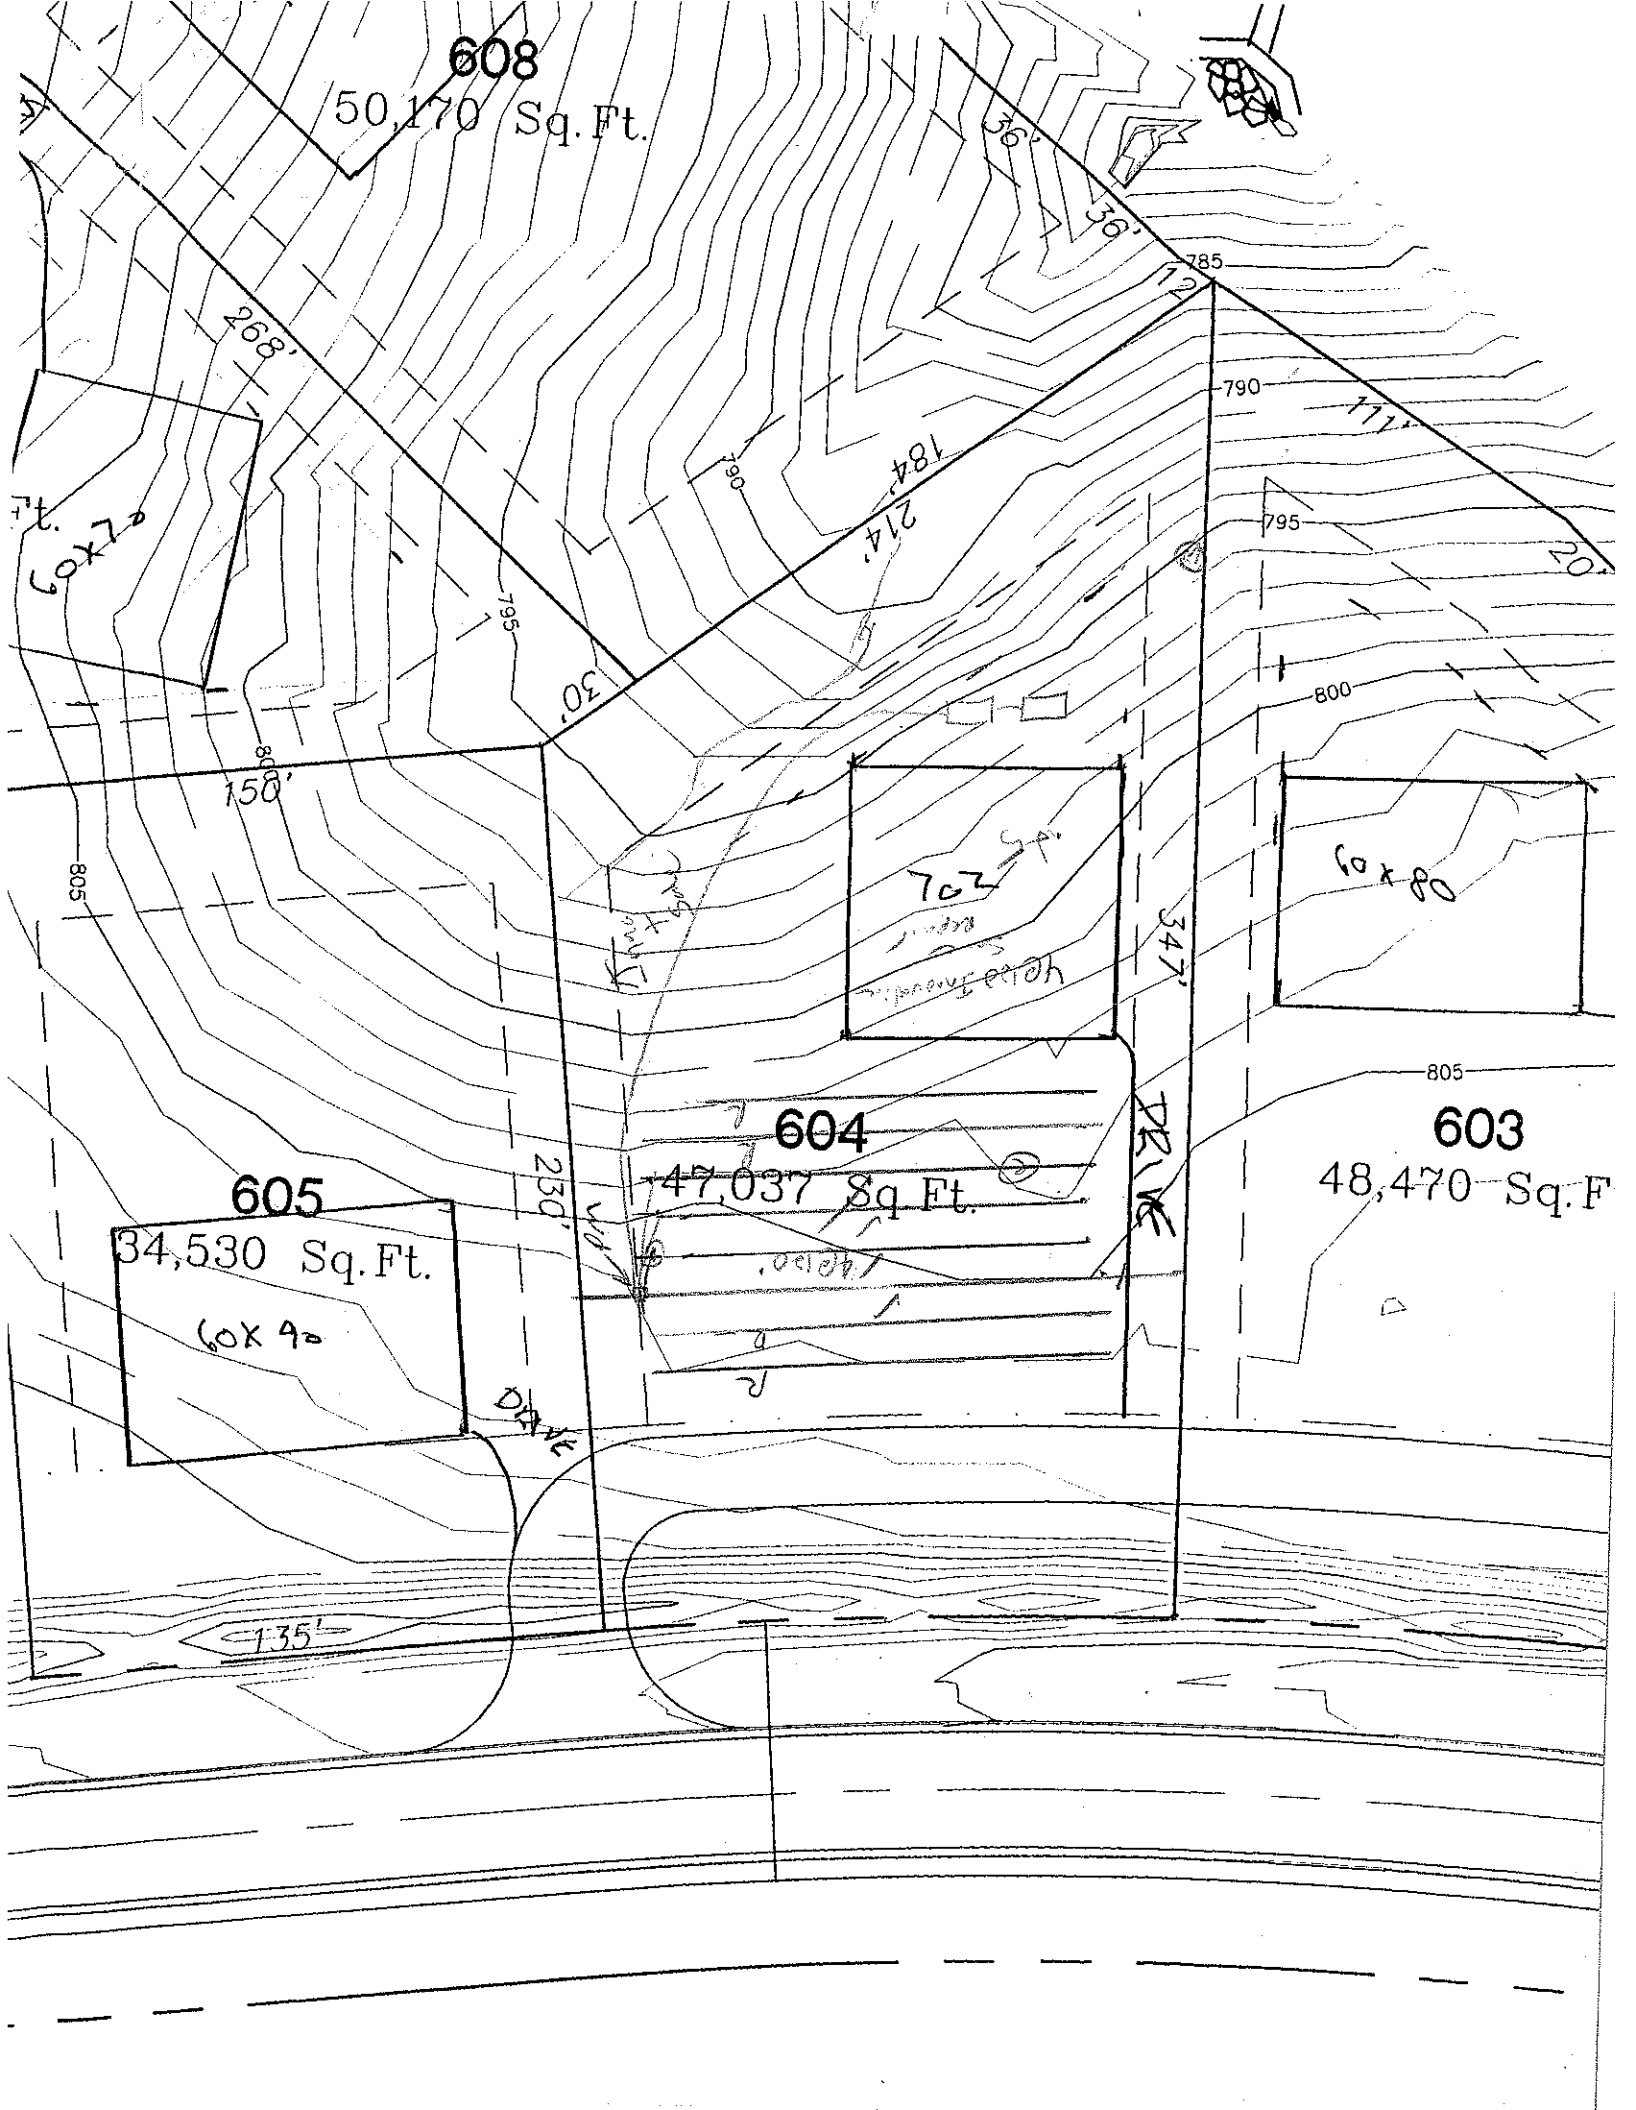
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: 604 Point PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-8	RBSCL m/comp	FI SSSP					PS .25
		8-32	YRC ABK/SBK	FI SP	- common LB				
		32-46	YRCL wSBK	ST/MI SSSP			36"	TB	
2		0-7	RBSCL m/comp	FR SP					PS .3
		7-29	YRC SBK	FRI SSSP	- few f. to c. of SAP				
		29-50	CL wSBK	FRI SSSP	- many SAP				
3		0-16	RBSL SBK	FRI SP					PS .3
		16-46	CL wSBK	FRI SSSP	common SAP				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


608
50,170 Sq.Ft.
268'
795
790
184'
214'
785
790
795
800
805
36'
36'
30'
158'
60x70
60x80
702 Sq.
Horse Barn
347'
604
47,037 Sq Ft.
230'
Drive
605
34,530 Sq.Ft.
60X90
135'
603
48,470 Sq.F