DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

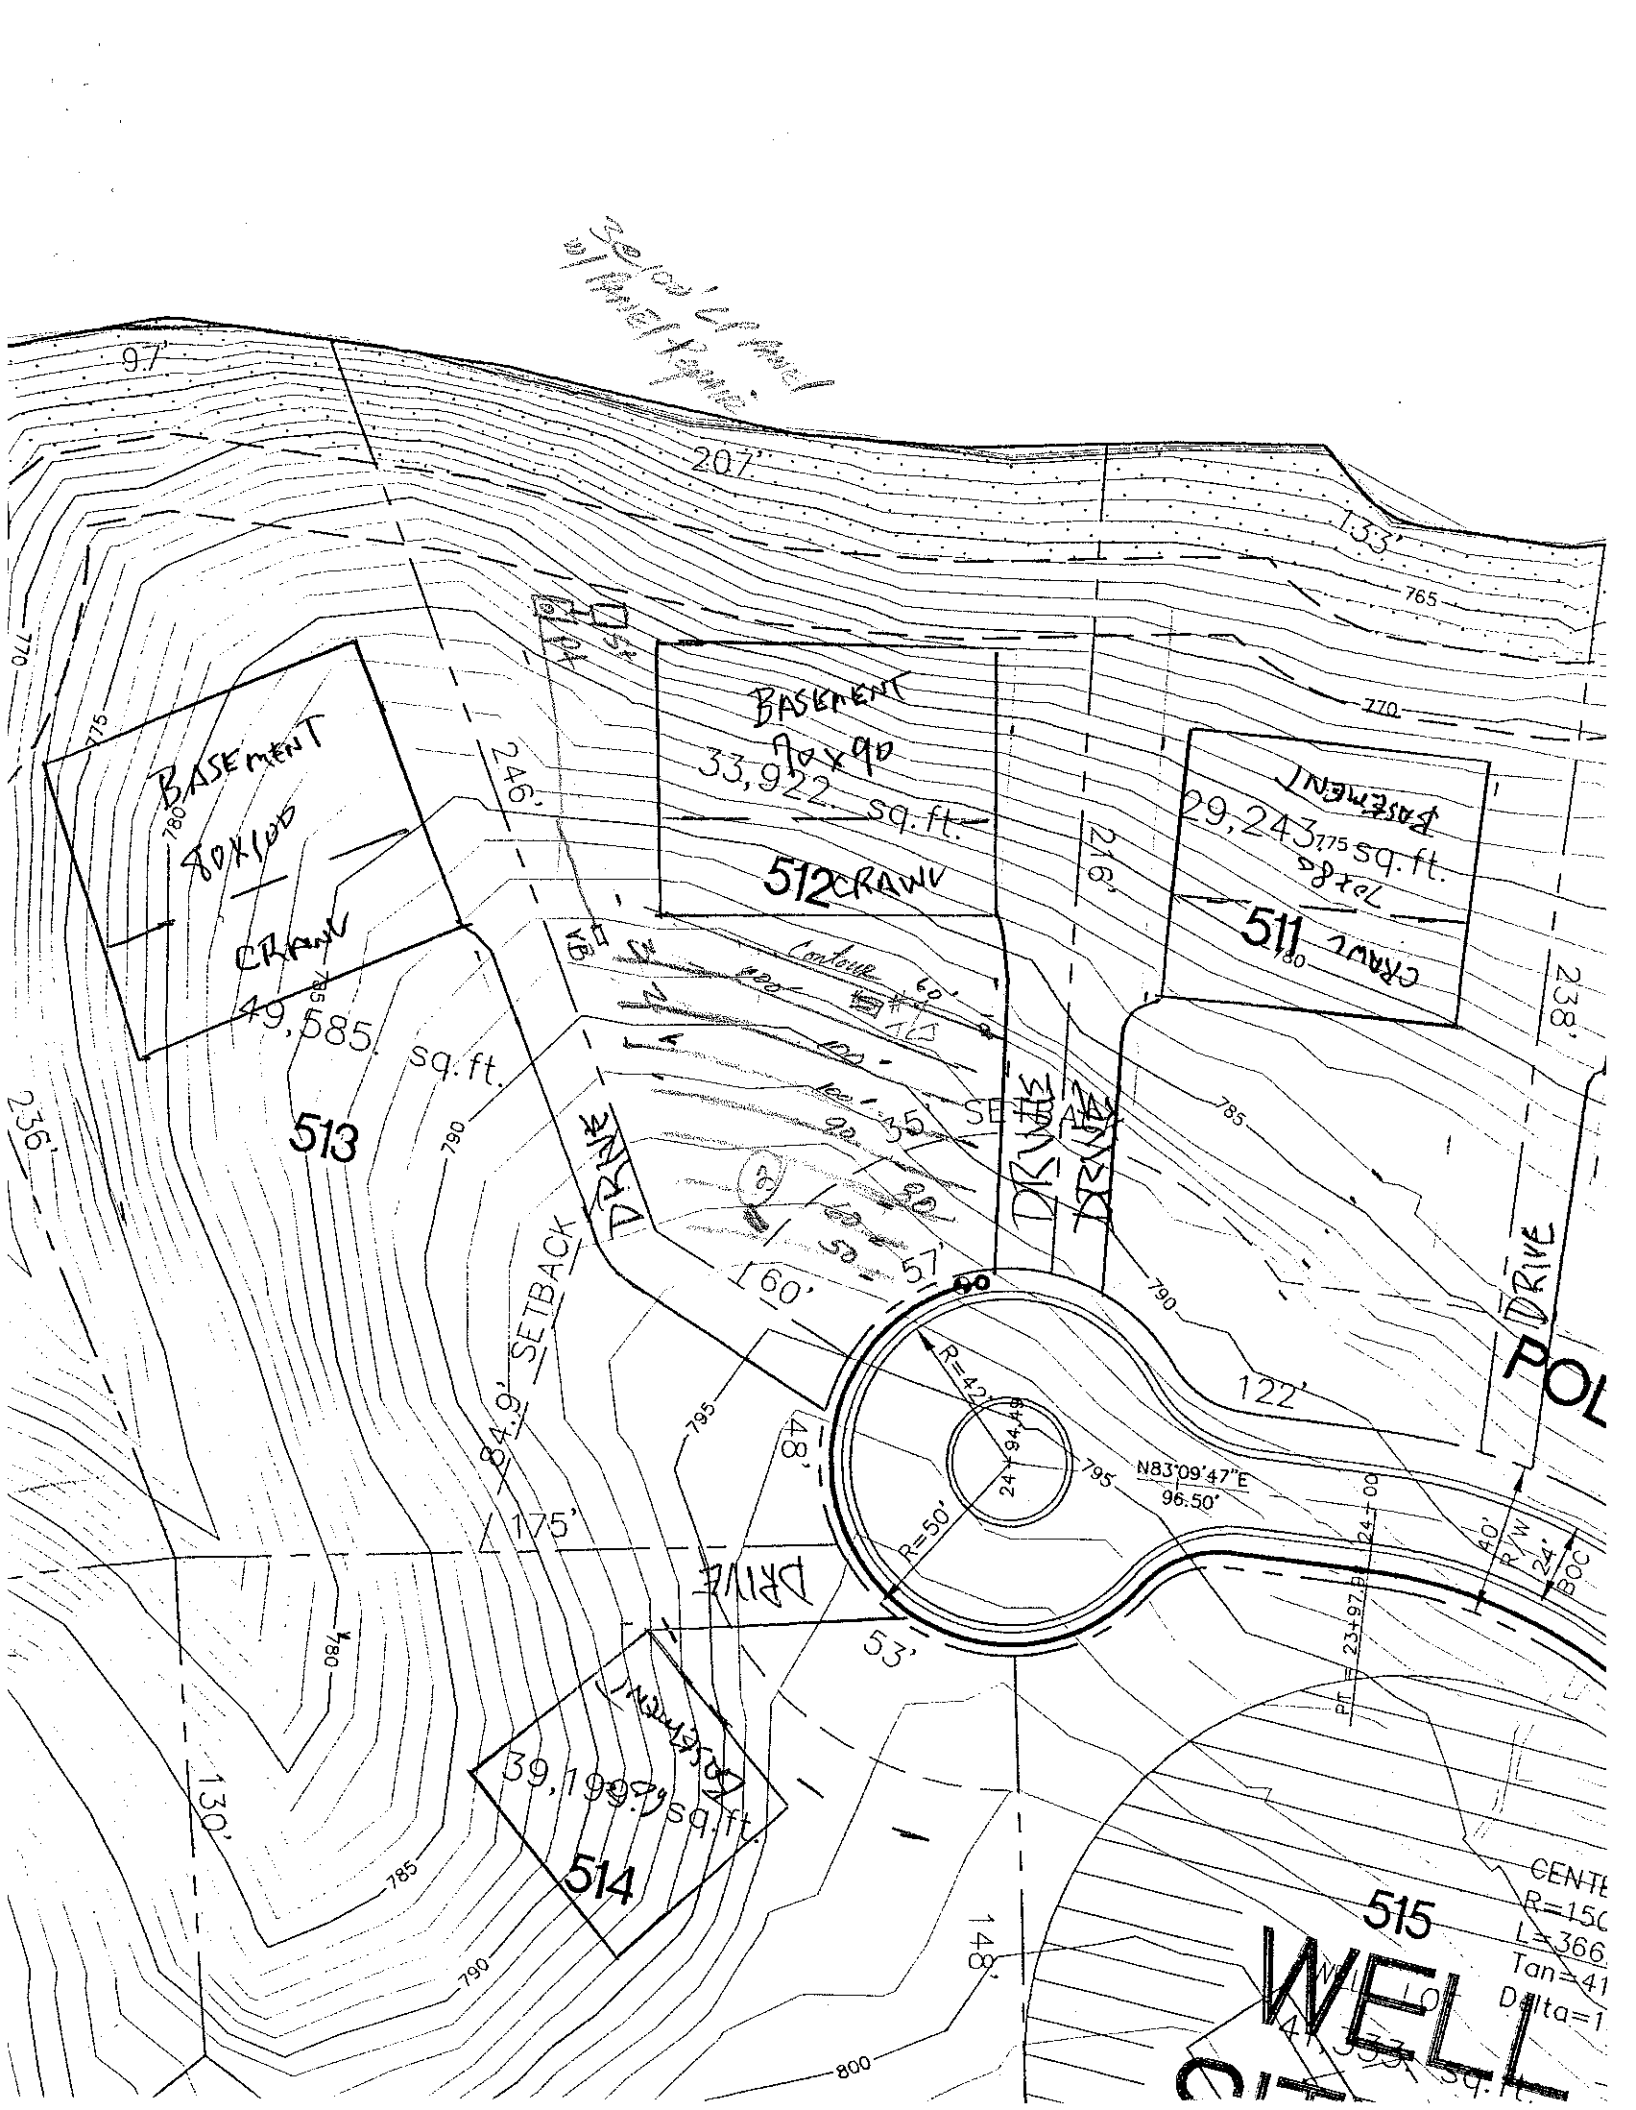
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: ORT APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 5-18-99
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 512 phase 5 Heaf PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	#7 TCD	0-7	gr brn sl	fr					B .3
		7-32	sbk gr sc	fr sss p					
		32-54	mott gray	fr sss p					
2		0-6	gr brn sl	fr					B .3
		6-31	sbk gr sc	fr sss p few fine rds					
		31-57	massive	fr sss p few fine rds					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


Below Contour Elevation 770'
97'
207'
133'
765
770
775
780
785
790
795
800
BASEMENT
80x100
CRAWL
49,585 sq. ft.
513
246'
BASEMENT
90x90
33,922 sq. ft.
512 CRAWL
276'
BASEMENT
29,243 sq. ft.
511 CRAWL
238'
236'
Contour
SETBACK
DRIVE
160'
84.9' SETBACK
175'
130'
39,199 sq. ft.
514
148'
122'
R=42'
R=50'
N83°09'47"E
96.50'
24+94.49
24+00
23+97.51
40' R/W
24' BOC
53'
515
WELL
CENTE
R=150
L=366
Tan=41
Delta=1