DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

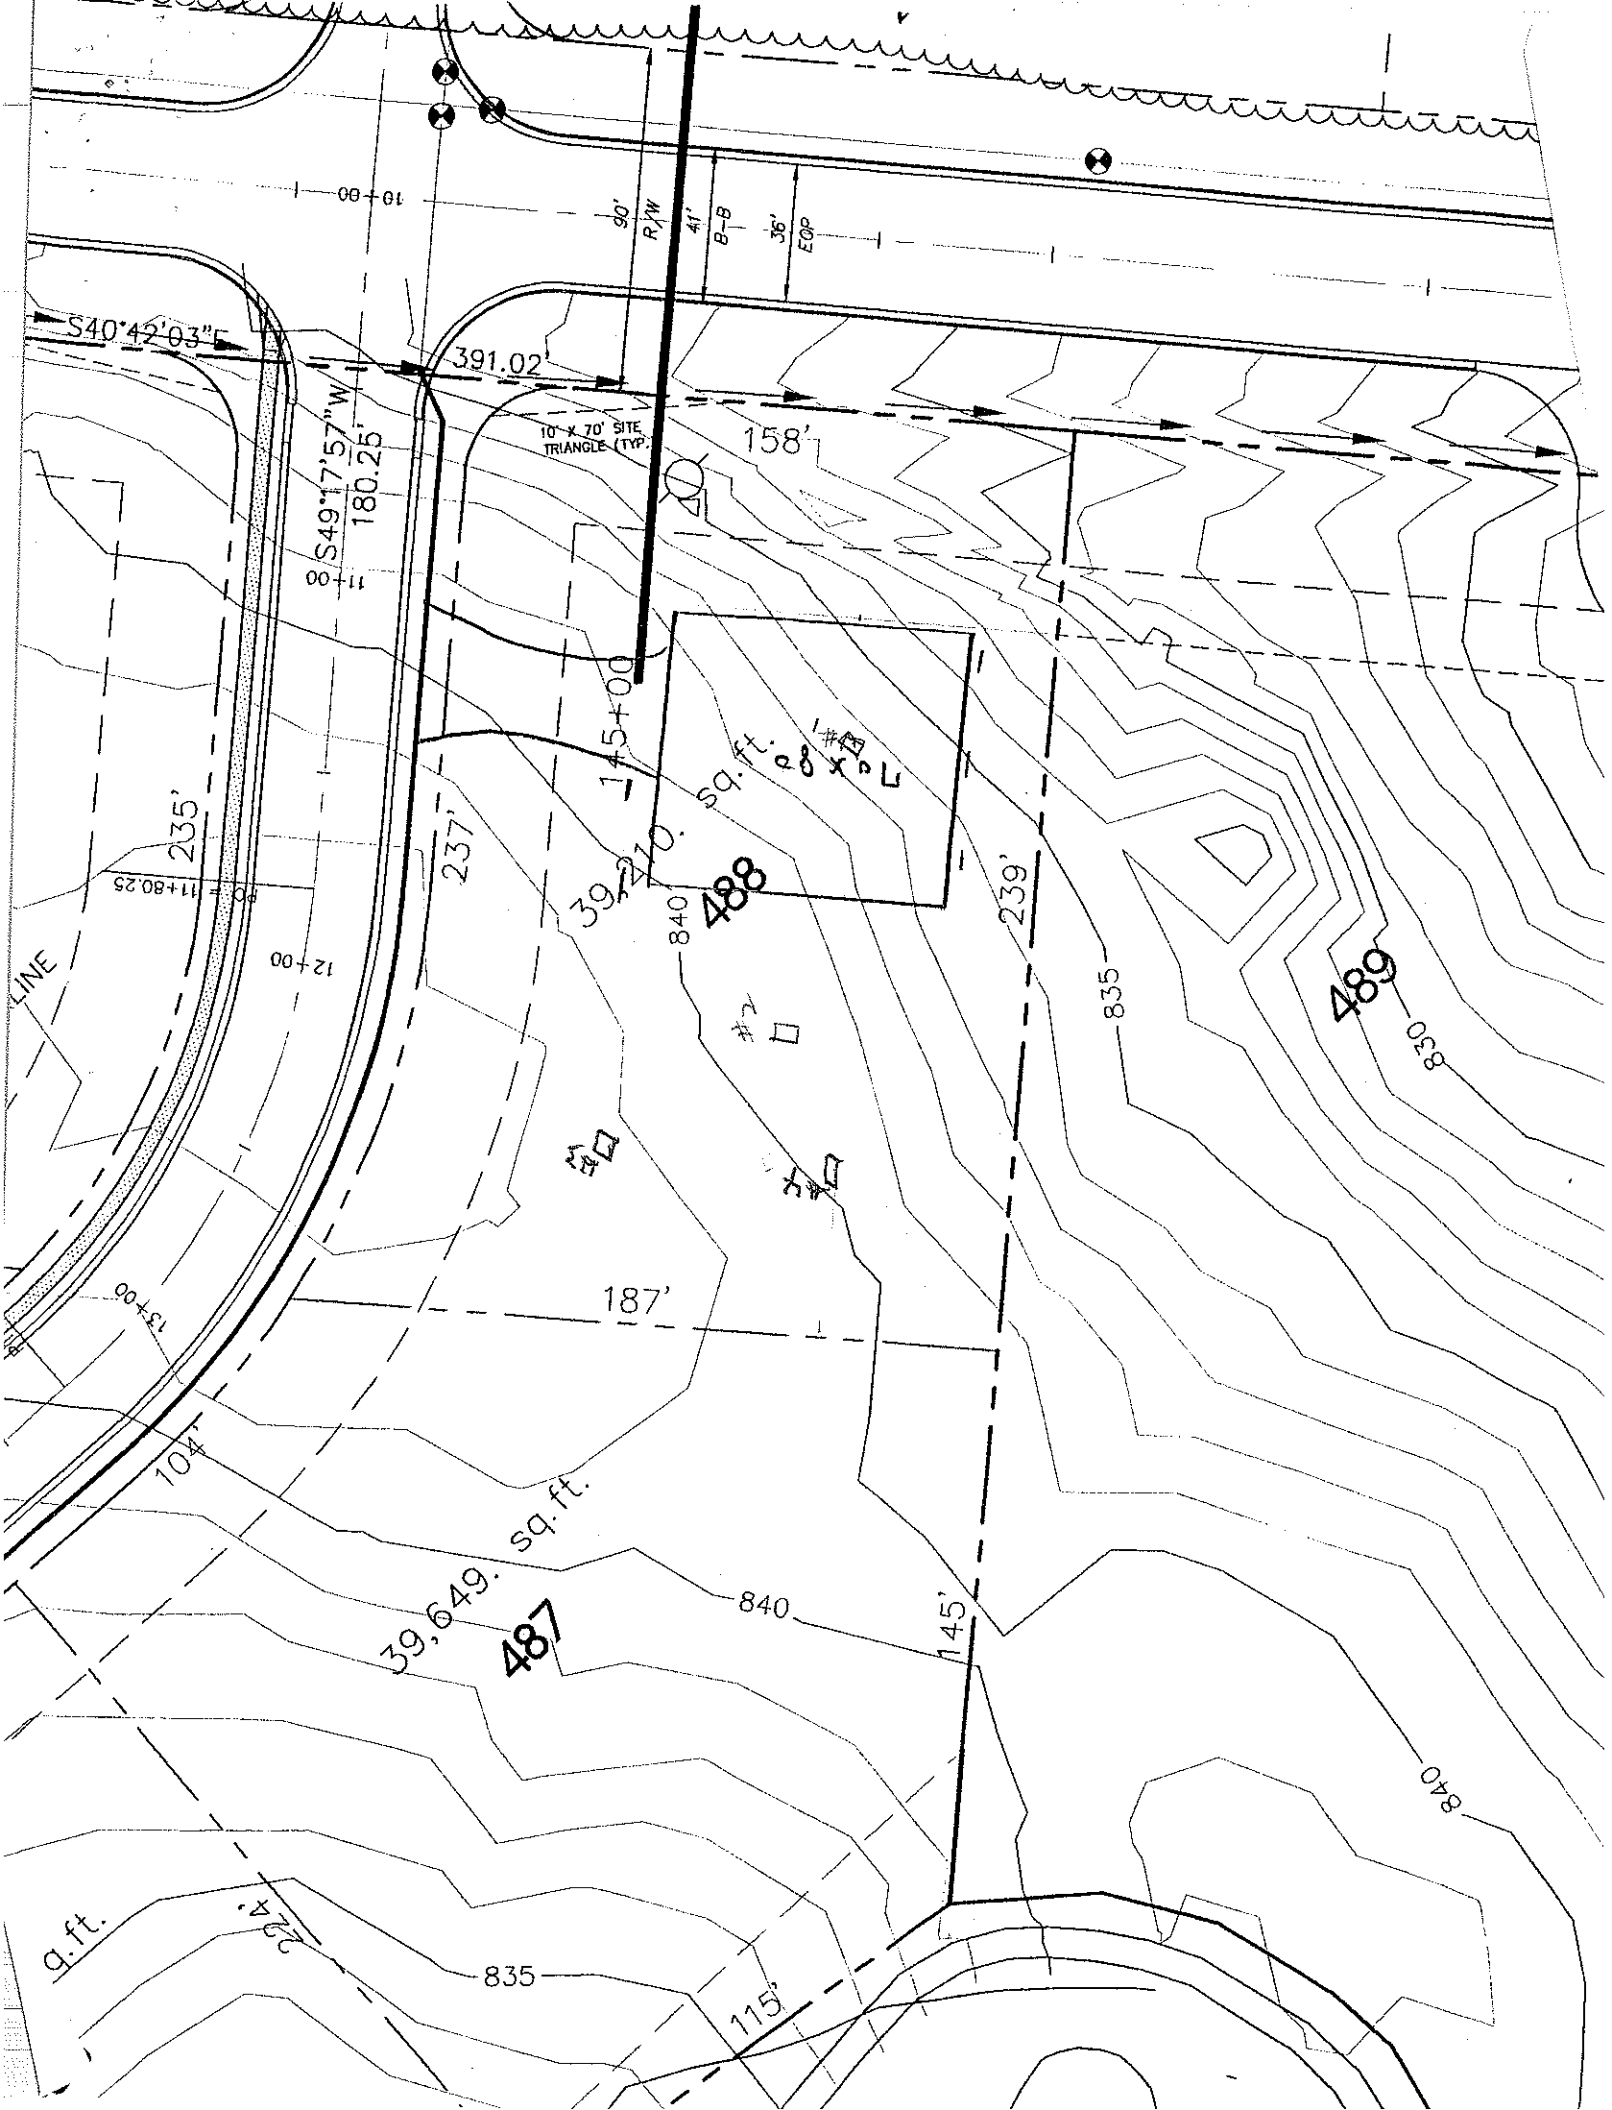
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

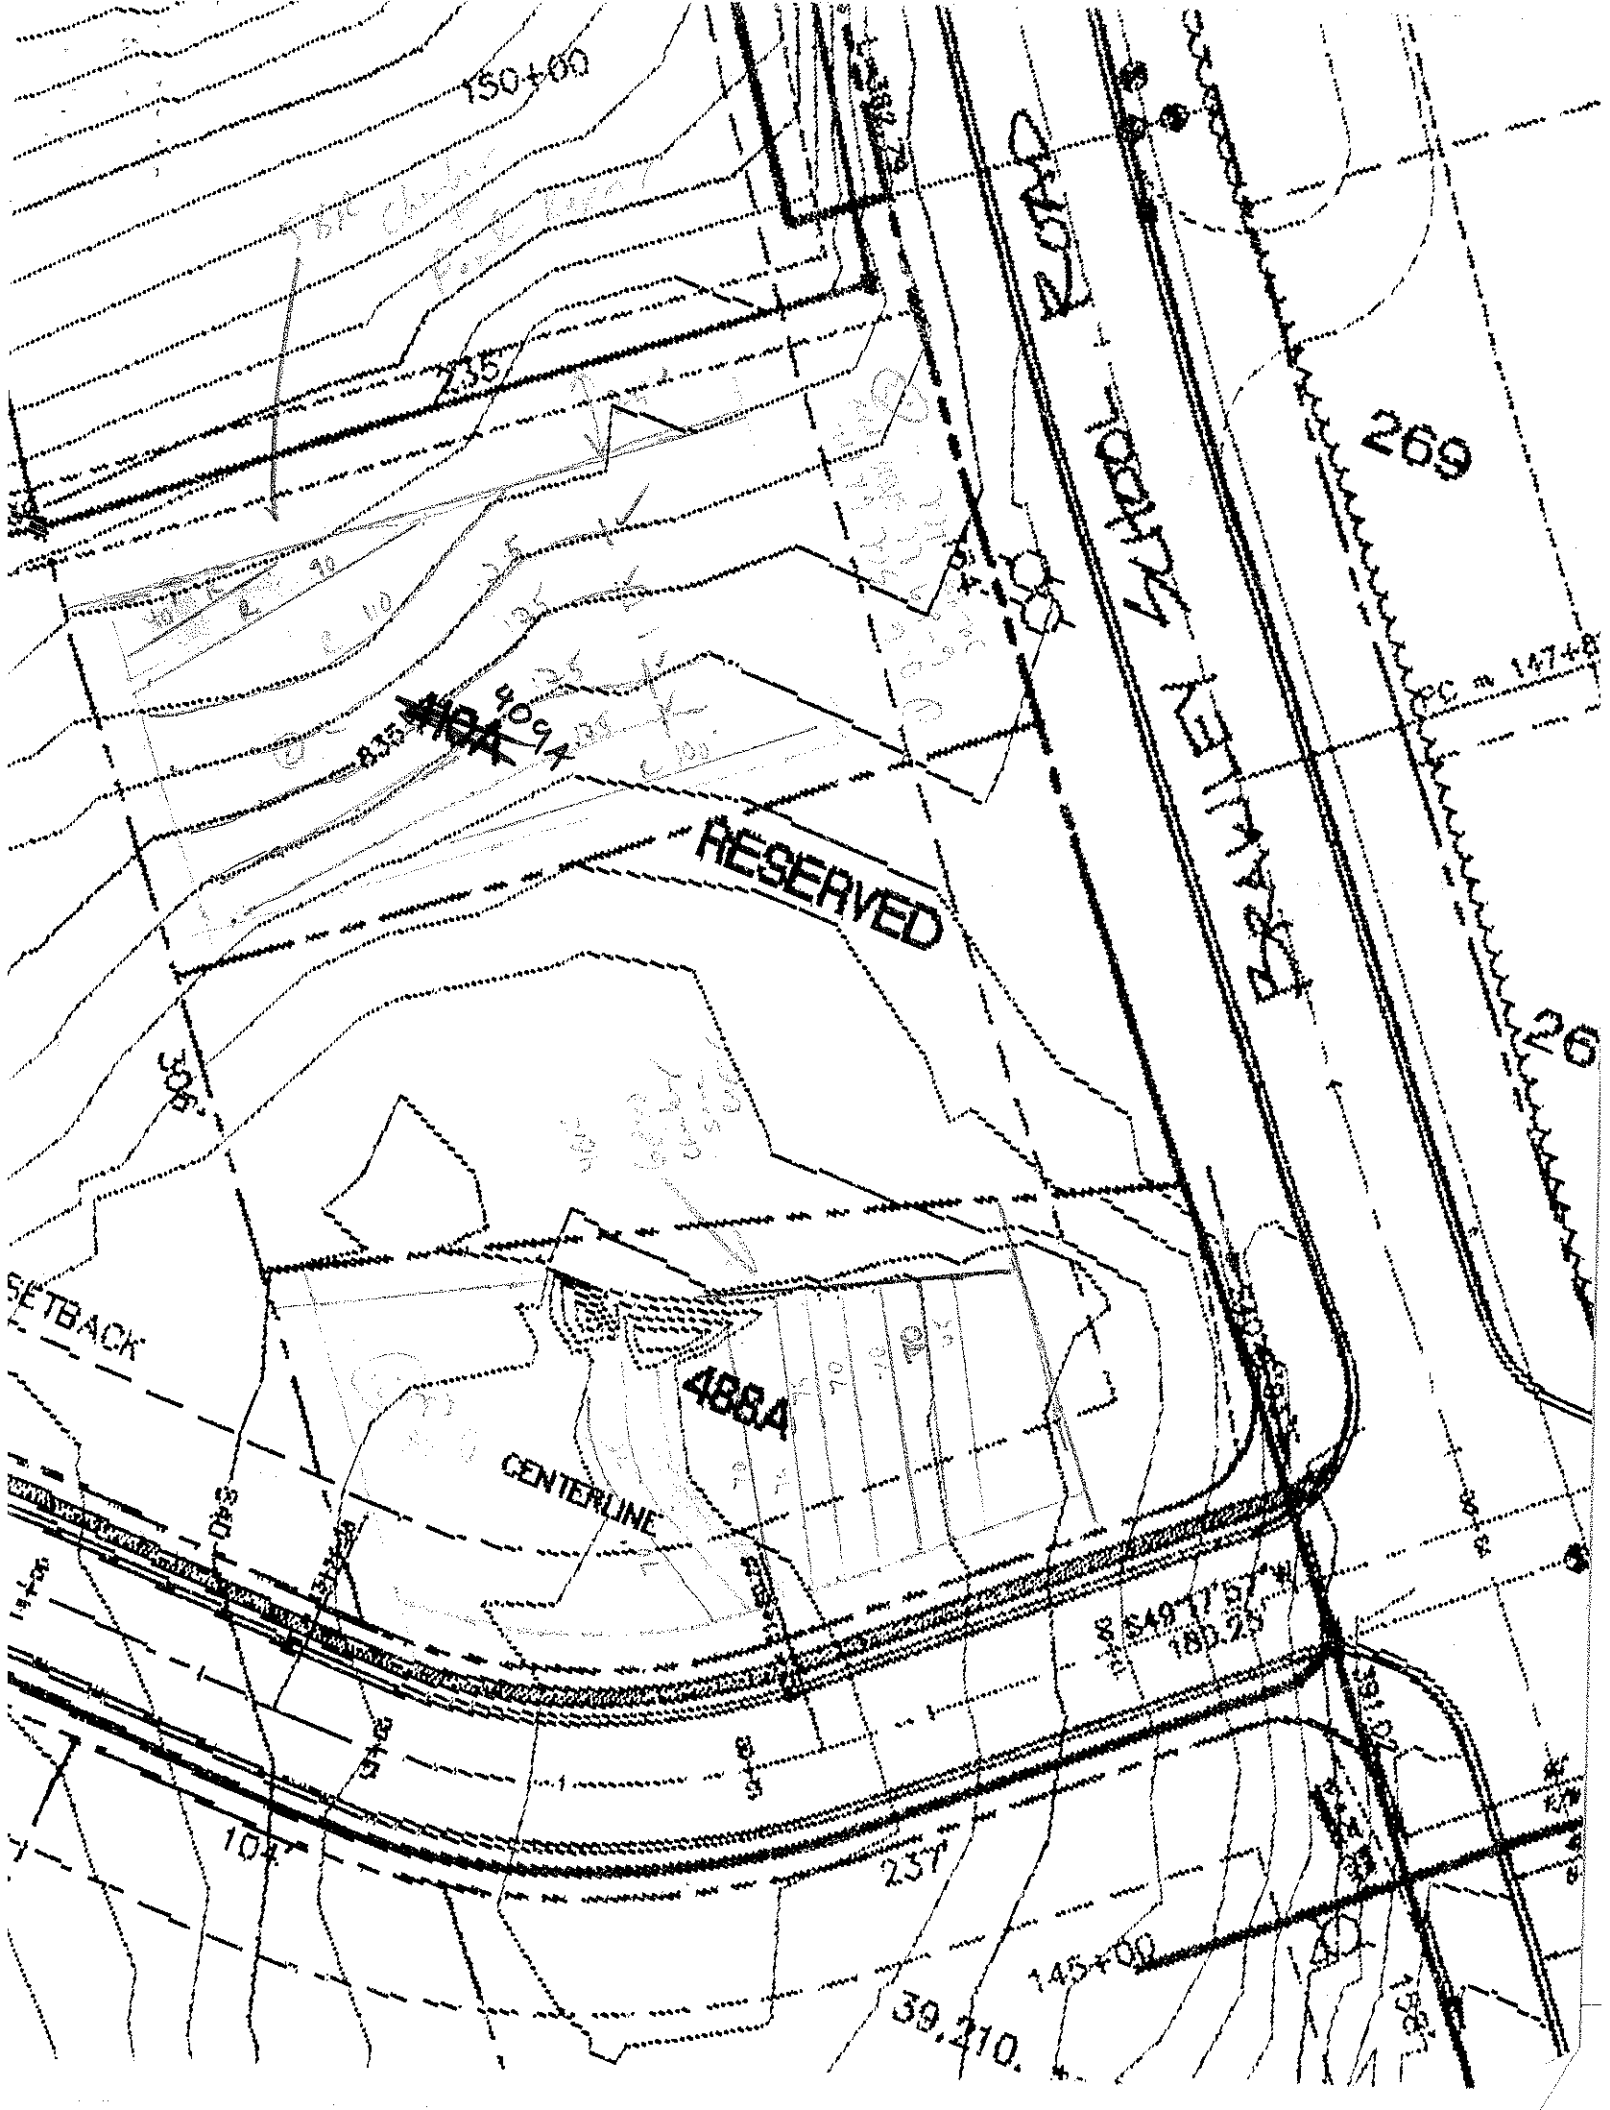
OWNER: Grant Resources APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 488 - Phase (4) PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	SL GR	FRI SS,SP					PS .25 to .33"
		6-32	RCL MPSBK	FI S,P					
		32+	Y Brown Mottles	low chroma mottles					
2		0-5	SL GR	FRI SS,SP					S .2
		5-42	RC YB Mottles	FI SP	low Chroma/tiger stripe				
3		0-11	SL GR	FRI SS,SP					4
		11-19	SCL/RY WSBK	FRI SS,SP					
		19+	Tiger stripe / Saprolite	common yellow browns					
4		0-14	SL GR	FRI SS,SP					PS .2-.25 to >.33"
		14-37	RCL MSBK	FRI SS,SP					
		37+	Chroma 6	FI S,P					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


10+00
90' R/W
41' B-B
36' EOP
S40°42'03"E
391.02'
10' X 70' SITE TRIANGLE (TYP.)
158'
S49°17'57"W
180.25'
11+00
145+00
235'
237'
39,210. sq.ft.
488
840
239'
835
489
830
12+00
LINE
187'
104'
39,649. sq.ft.
487
840
145'
840
835
115'


150+00
235'
269
RESERVED
306'
SETBACK
4884
CENTERLINE
S49°17'57"W
180.25'
104'
237'
145+00
39,210.