DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

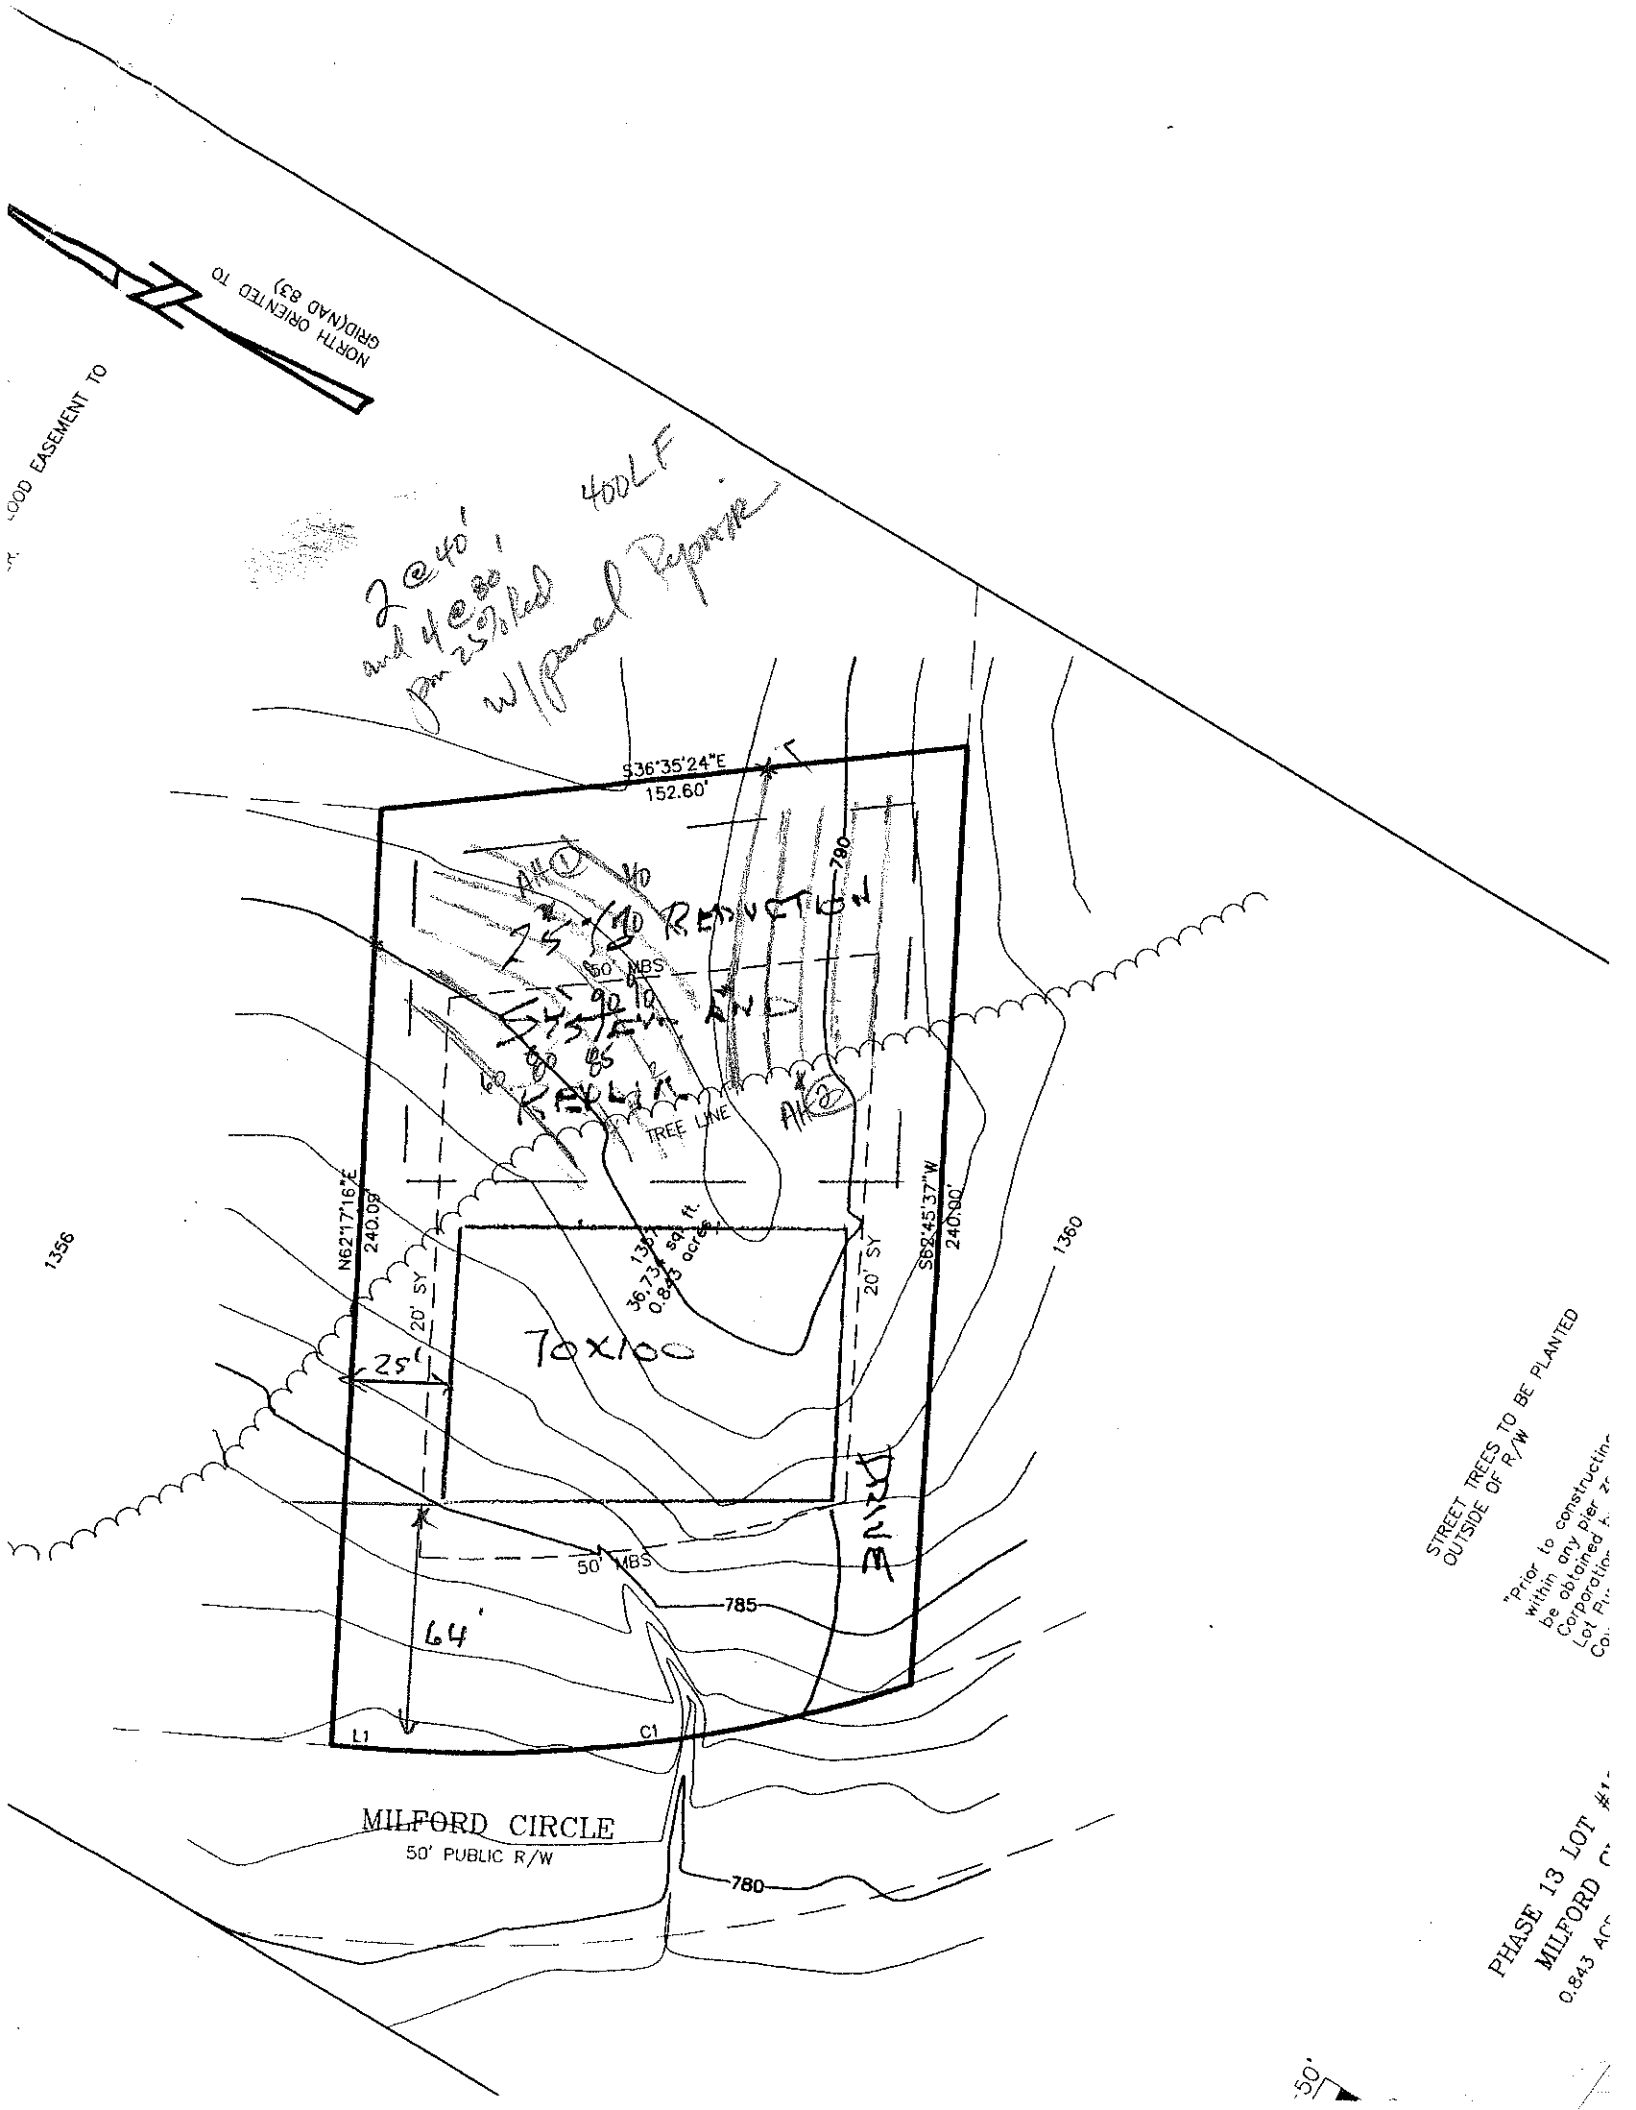
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: CRL _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 4-27-04
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 4Bdrm PROPERTY SIZE: _____
LOCATION OF SITE: lot 13557 the 13th Pt PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☑ Public ☑ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☑ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	3% ft	0-10	wk fgr sbk	fri sp					
		10-38	mfsbk RC	fri sp SEXP					⊜3
		38-48	MwkSbk Rcl	fri sp	few fine mod Sapp				
2	3% ft	0-11	wk fgr sbk	fri sp	few fine prom mottles				
		11-27	mfsbk RC	fri sp					⊜3
		27-47	mwsbk Rcl	fri sp	few fine mod Sapp				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	pm25%Red	LPP/PRS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: _____
ACCEPTED BY: Paul Pennington


NORTH ORIENTED TO GRID(NAD 83)
S36°35'24"E
152.60'
N62°17'16"E
240.08'
S62°45'37"W
240.00'
TREE LINE
50' MBS
20' SY
25'
70x100
64'
MILFORD CIRCLE
50' PUBLIC R/W
1356
1360
785
780
STREET TREES TO BE PLANTED OUTSIDE OF R/W
PHASE 13 LOT
MILFORD