ON OF ENVIRONMENTAL HEALTH
TE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

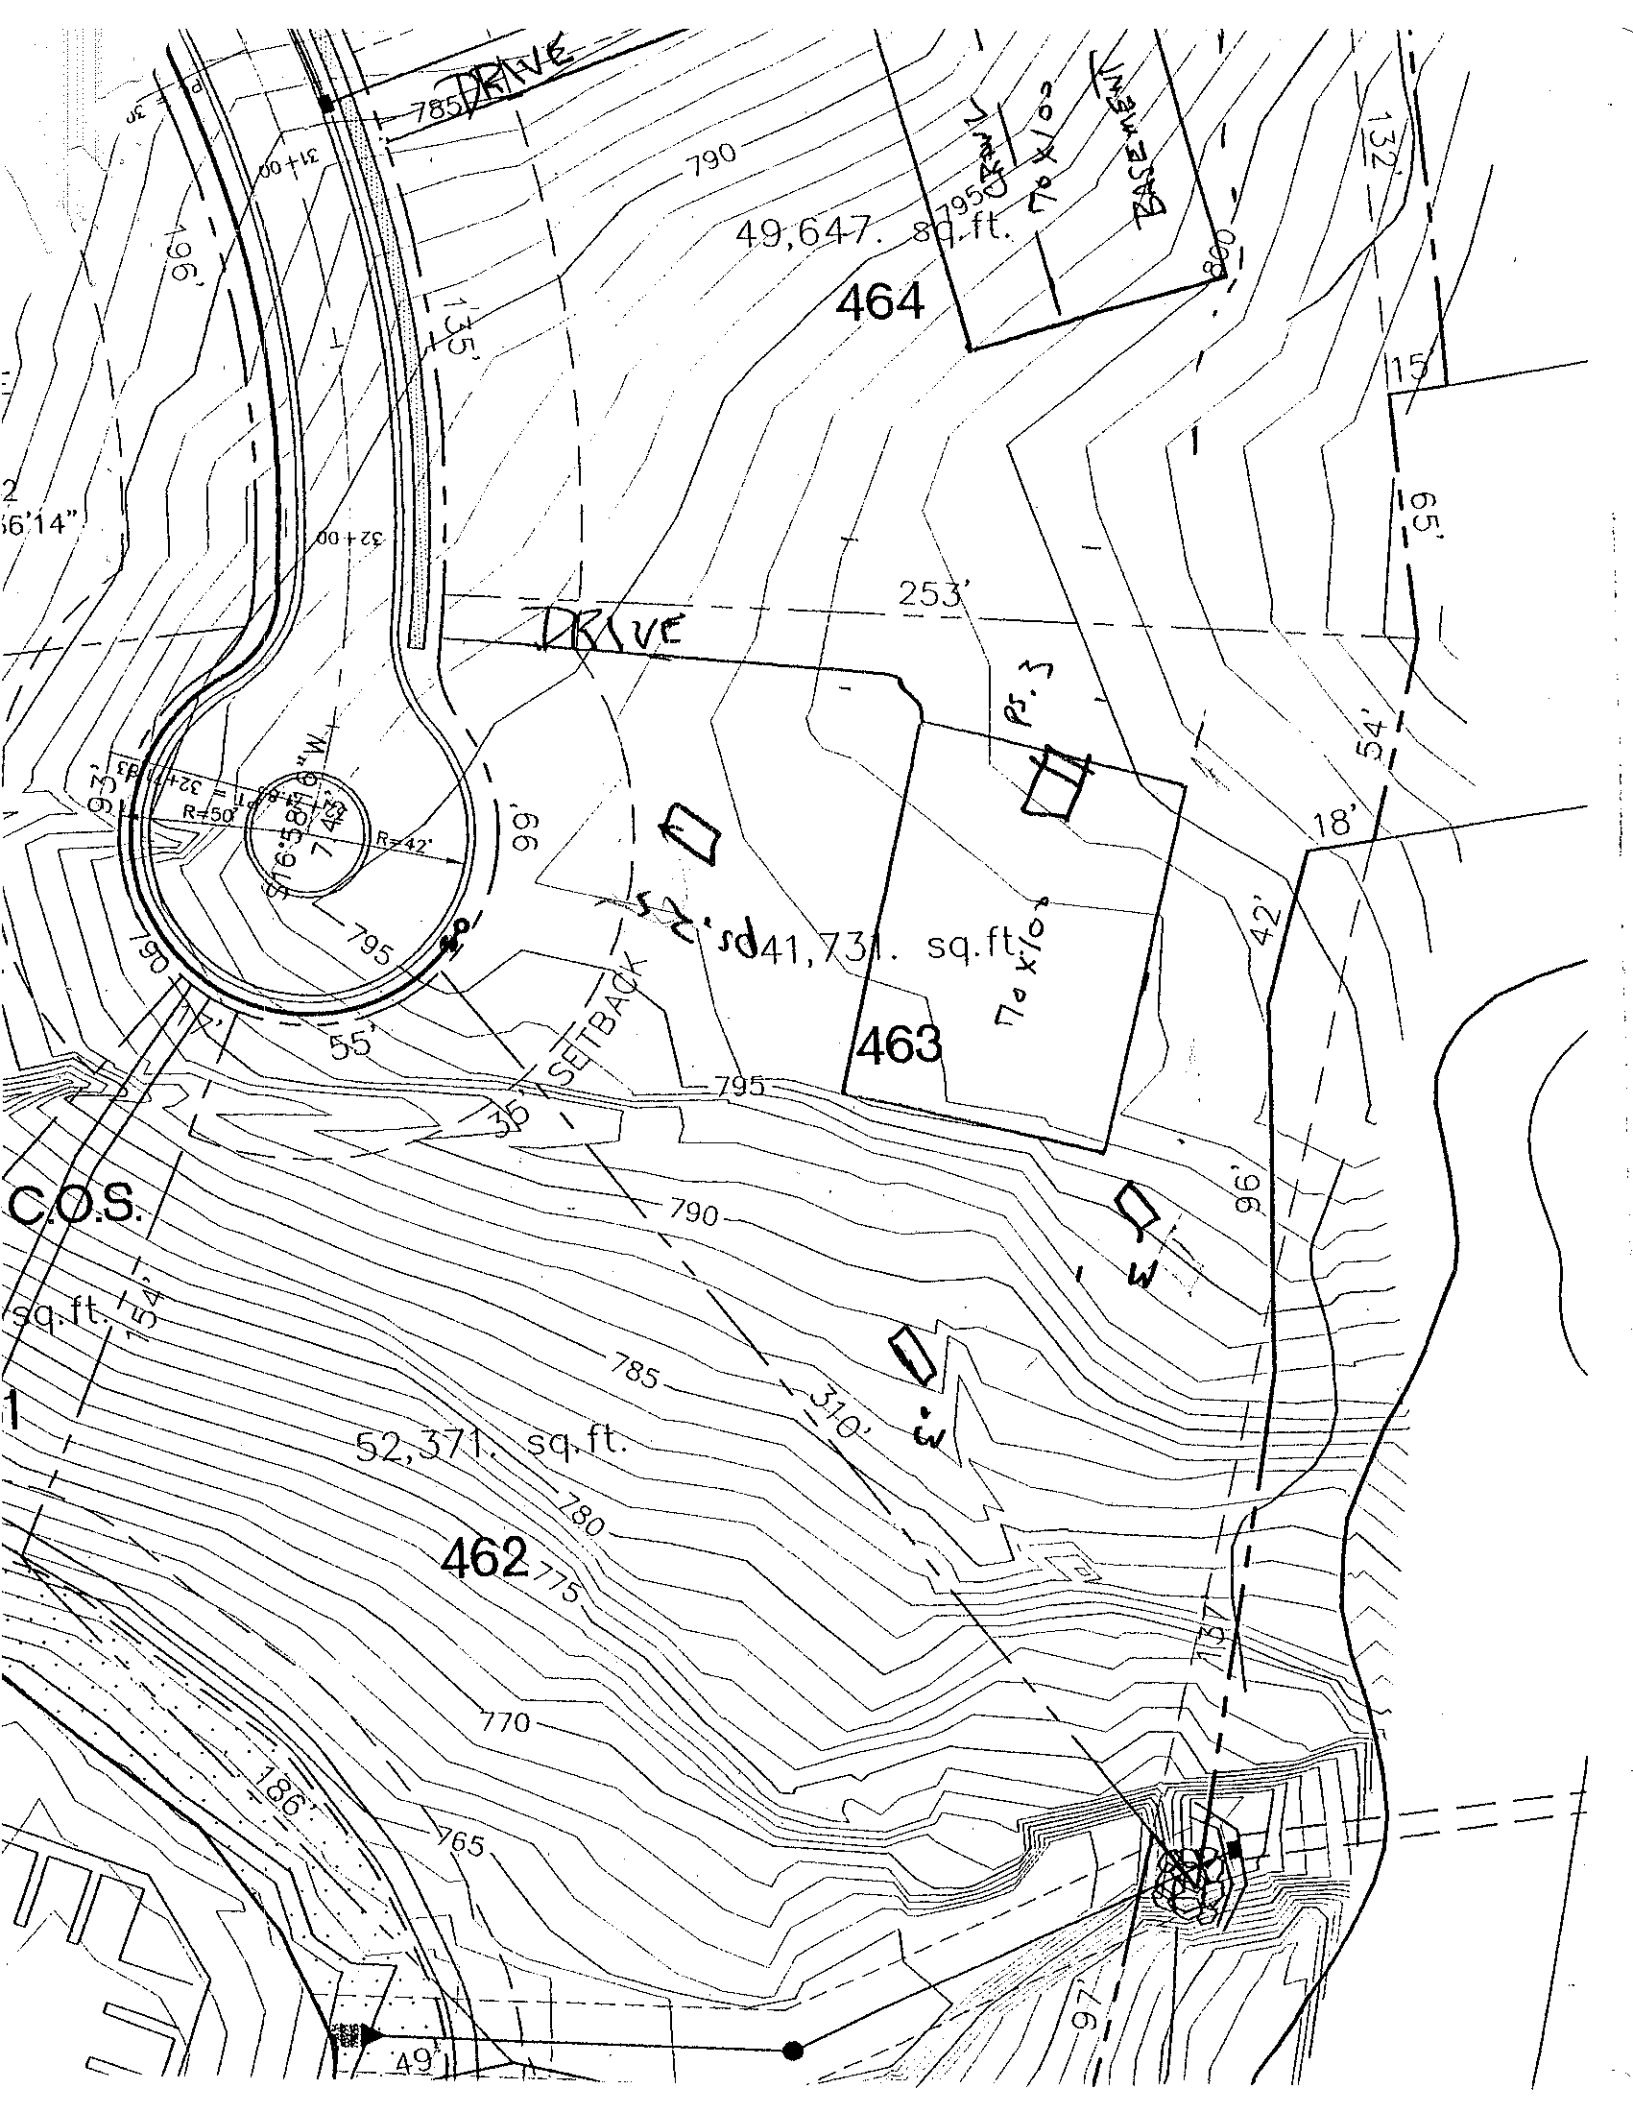
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

O R: _____ APPLICANT: _____
ADD ESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: 463 PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-19	RB SL GR	FR SS SP					RS .3
		19-50	RCL MPBK	FR SS SP					
2		0-30	SCL GR	FR SS SP	P/A Pan				AS .3
		30-54	RCLC MSBK	FM SS SP					
3		0-6	RSL GR	FR SS SP	one of each				RS .3
		6-48	RCLC ABK	FM SS SP					
4		0-36	RCLC MSBK	FM SS SP					RS .2
		36-60	RCL/SPM MSBK	FM SS SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
ailable Space (.1945)		
tem Type(s)		
LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


DRIVE
785
790
795
49,647. sq.ft.
464
70 x 100
BASEMENT
132'
15'
65'
253'
DRIVE
54'
18'
42'
41,731. sq.ft.
463
70 x 100
SETBACK
35'
55'
96'
C.O.S.
sq.ft.
52,371. sq.ft.
462
310'
780
775
770
765
186'
49'
97'
137'