DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

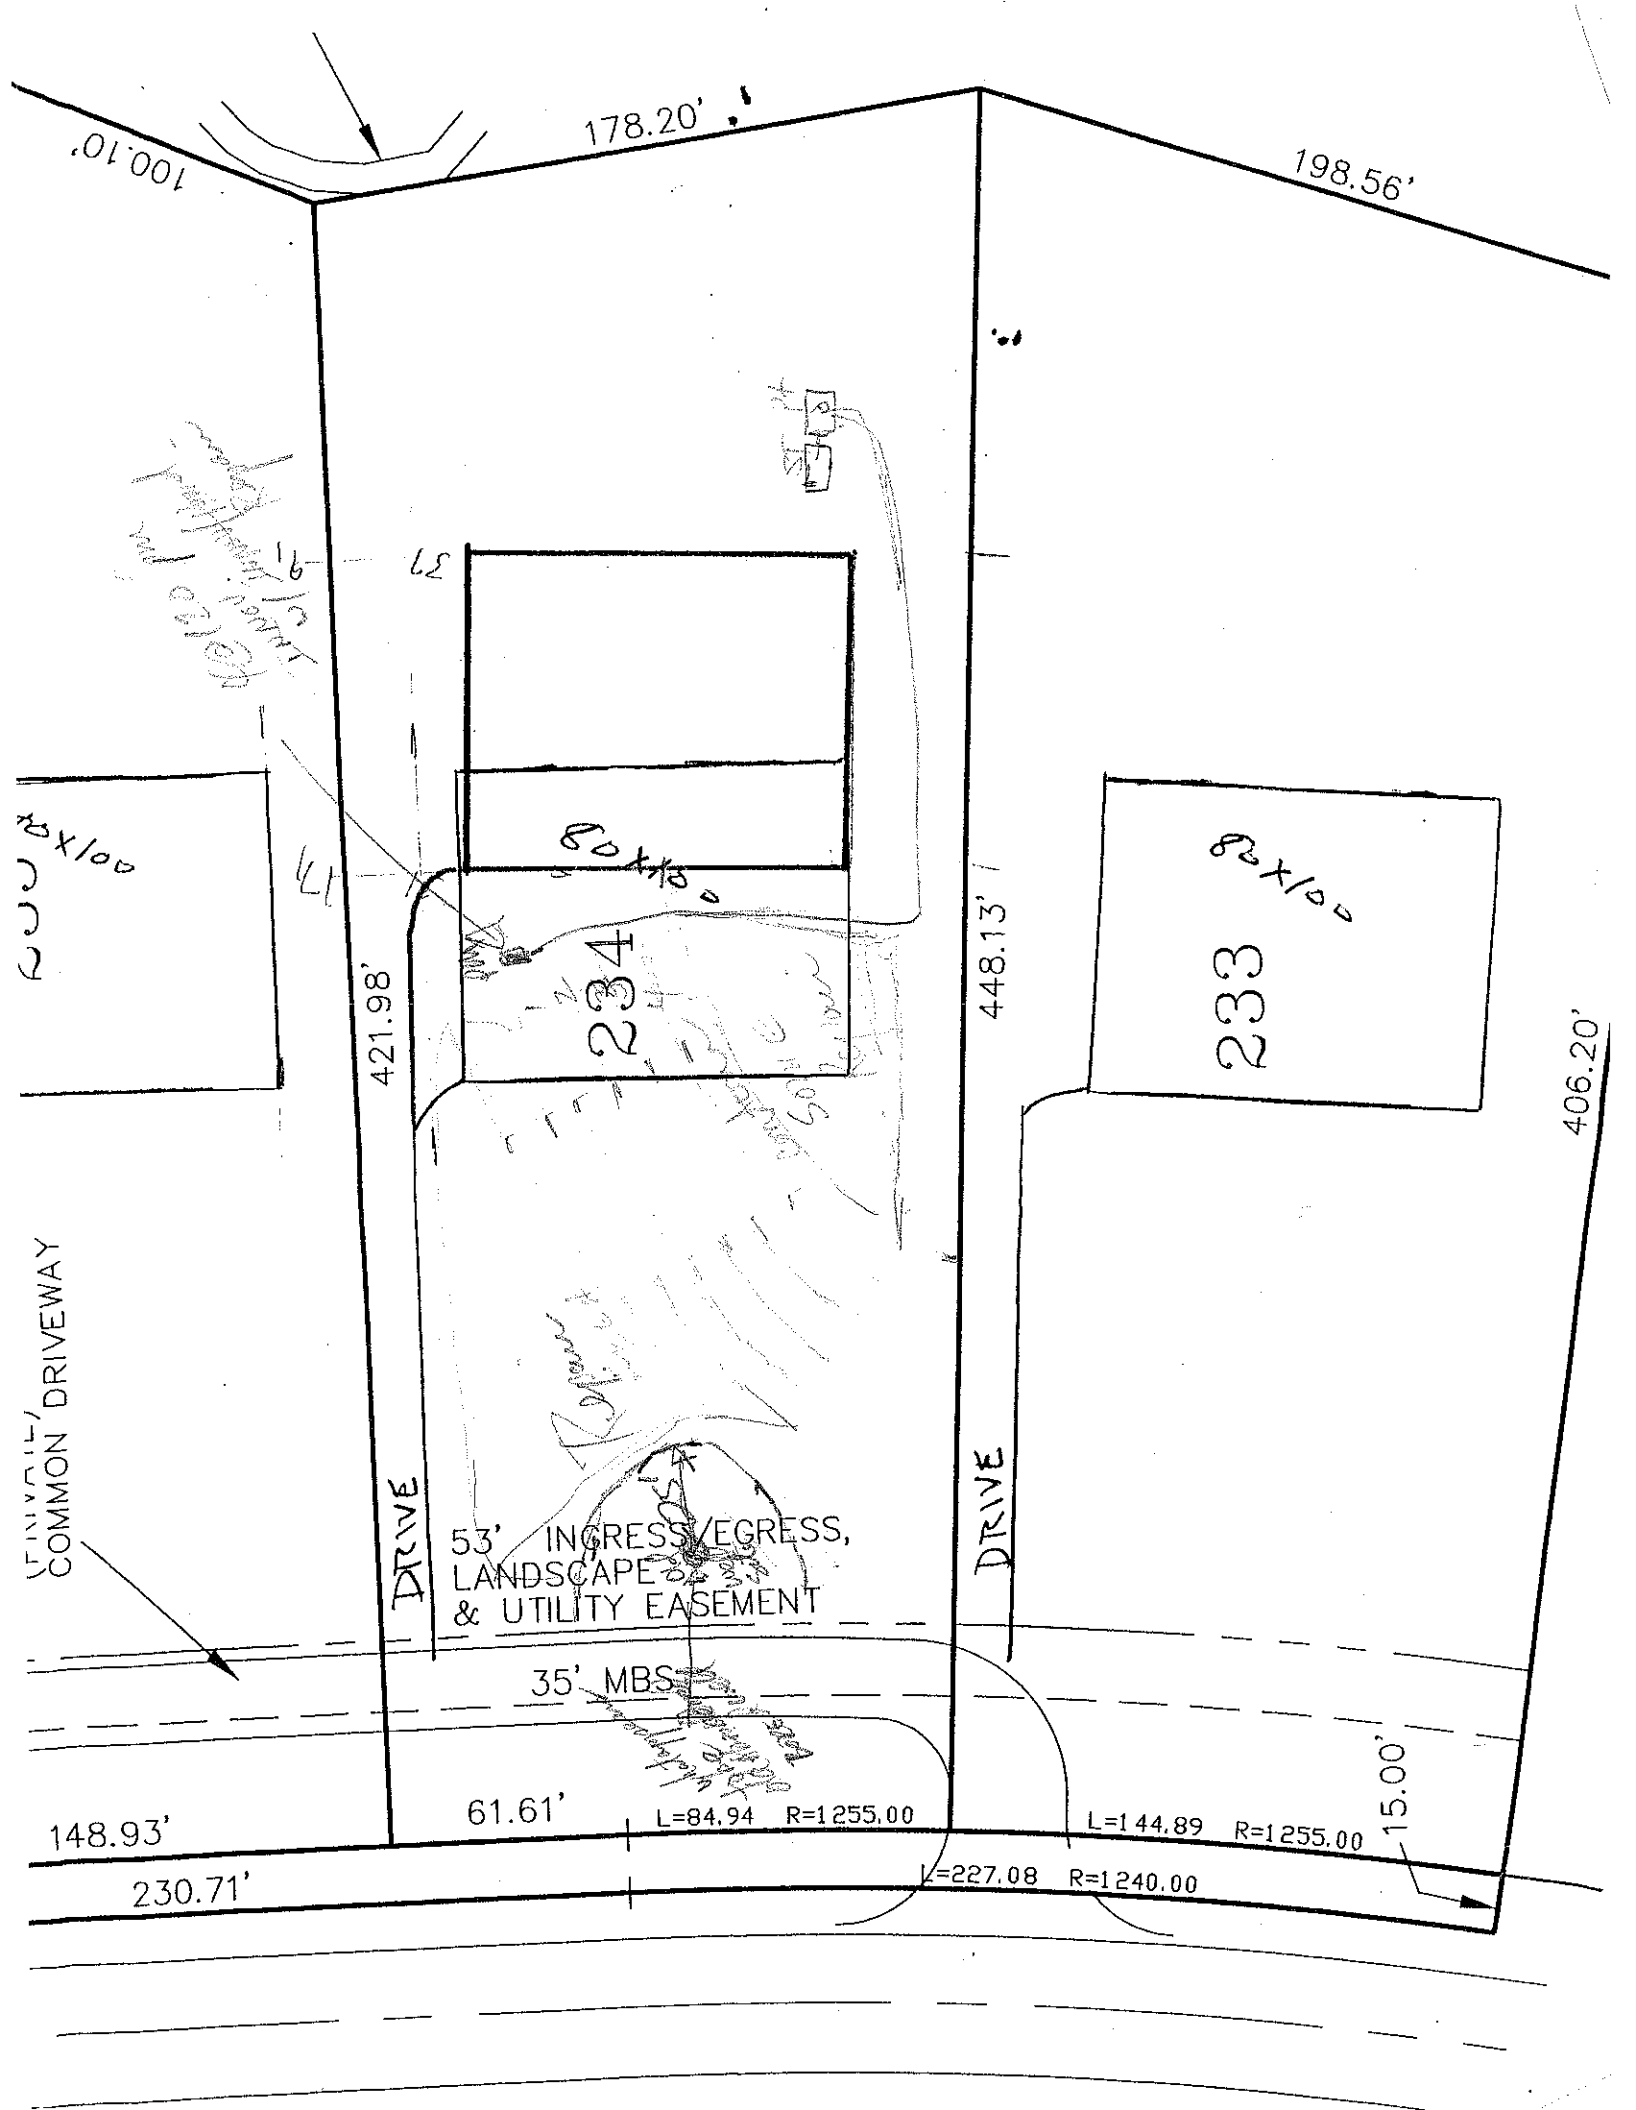
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: CRT APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 2-11-99
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 234 phase 2 the RT. PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-8	gr brn sl	fr					PS .3
		8-32	ssab rc	fr sp					
		32-54	wk sbk rct	fr sss p					
2		0-9	gr brn sl	fr					PS .3
		9-19	wk sbk mod rct	fr sss sp					
		19-32	sbk yr cpt	common brn mottles fr sp - sp					36" min to depth
		32-54	wk sbk mod rct	fr ss sp - sp					
			fine clay						
3		0-12	mod sl	fr					PS .3
		12-46	m sbk & lmpt						
		46-60	(BC) st lcse	fr sss p - np					
4		0-9	gr brn sl	fr					PS .25-.3
		9-41	sbk rct common brn mottles fr sp						
		41-57	wk sbk rct	fr ss p sp					36" min to depth
			fine clay						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


100.10'
178.20'
198.56'
80x180
234
80x100
233
421.98'
448.13'
406.20'
DRIVE
DRIVE
53' INGRESS/EGRESS,
LANDSCAPE
& UTILITY EASEMENT
COMMON DRIVEWAY
35' MBS
148.93'
61.61'
L=84.94 R=1255.00
L=144.89 R=1255.00
15.00'
230.71'
L=227.08 R=1240.00