IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR R. D. Whitaker DATE 6-16-78 PERMIT NO. ____________

PHONE: Business ____________ Home ____________

LOCATION [illegible] TR on 1177 TR on 1238 [illegible] mi on left S. R. No. ____________

SUBDIVISION NAME Lake Norman LOT NO. 46 SECTION OR BLOCK NO. 7


House (✓) Mobile Home ( ) Business ( ) Other ____________

No. Bedrooms 4 No. Bathrooms 2½

Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Lot Area .93 acre

Character & Porosity of Soil Clay loam
Percolation Rate 60 min/in
Topography [illegible]
Depth to Water Table [illegible]
Rock or other impervious formations None

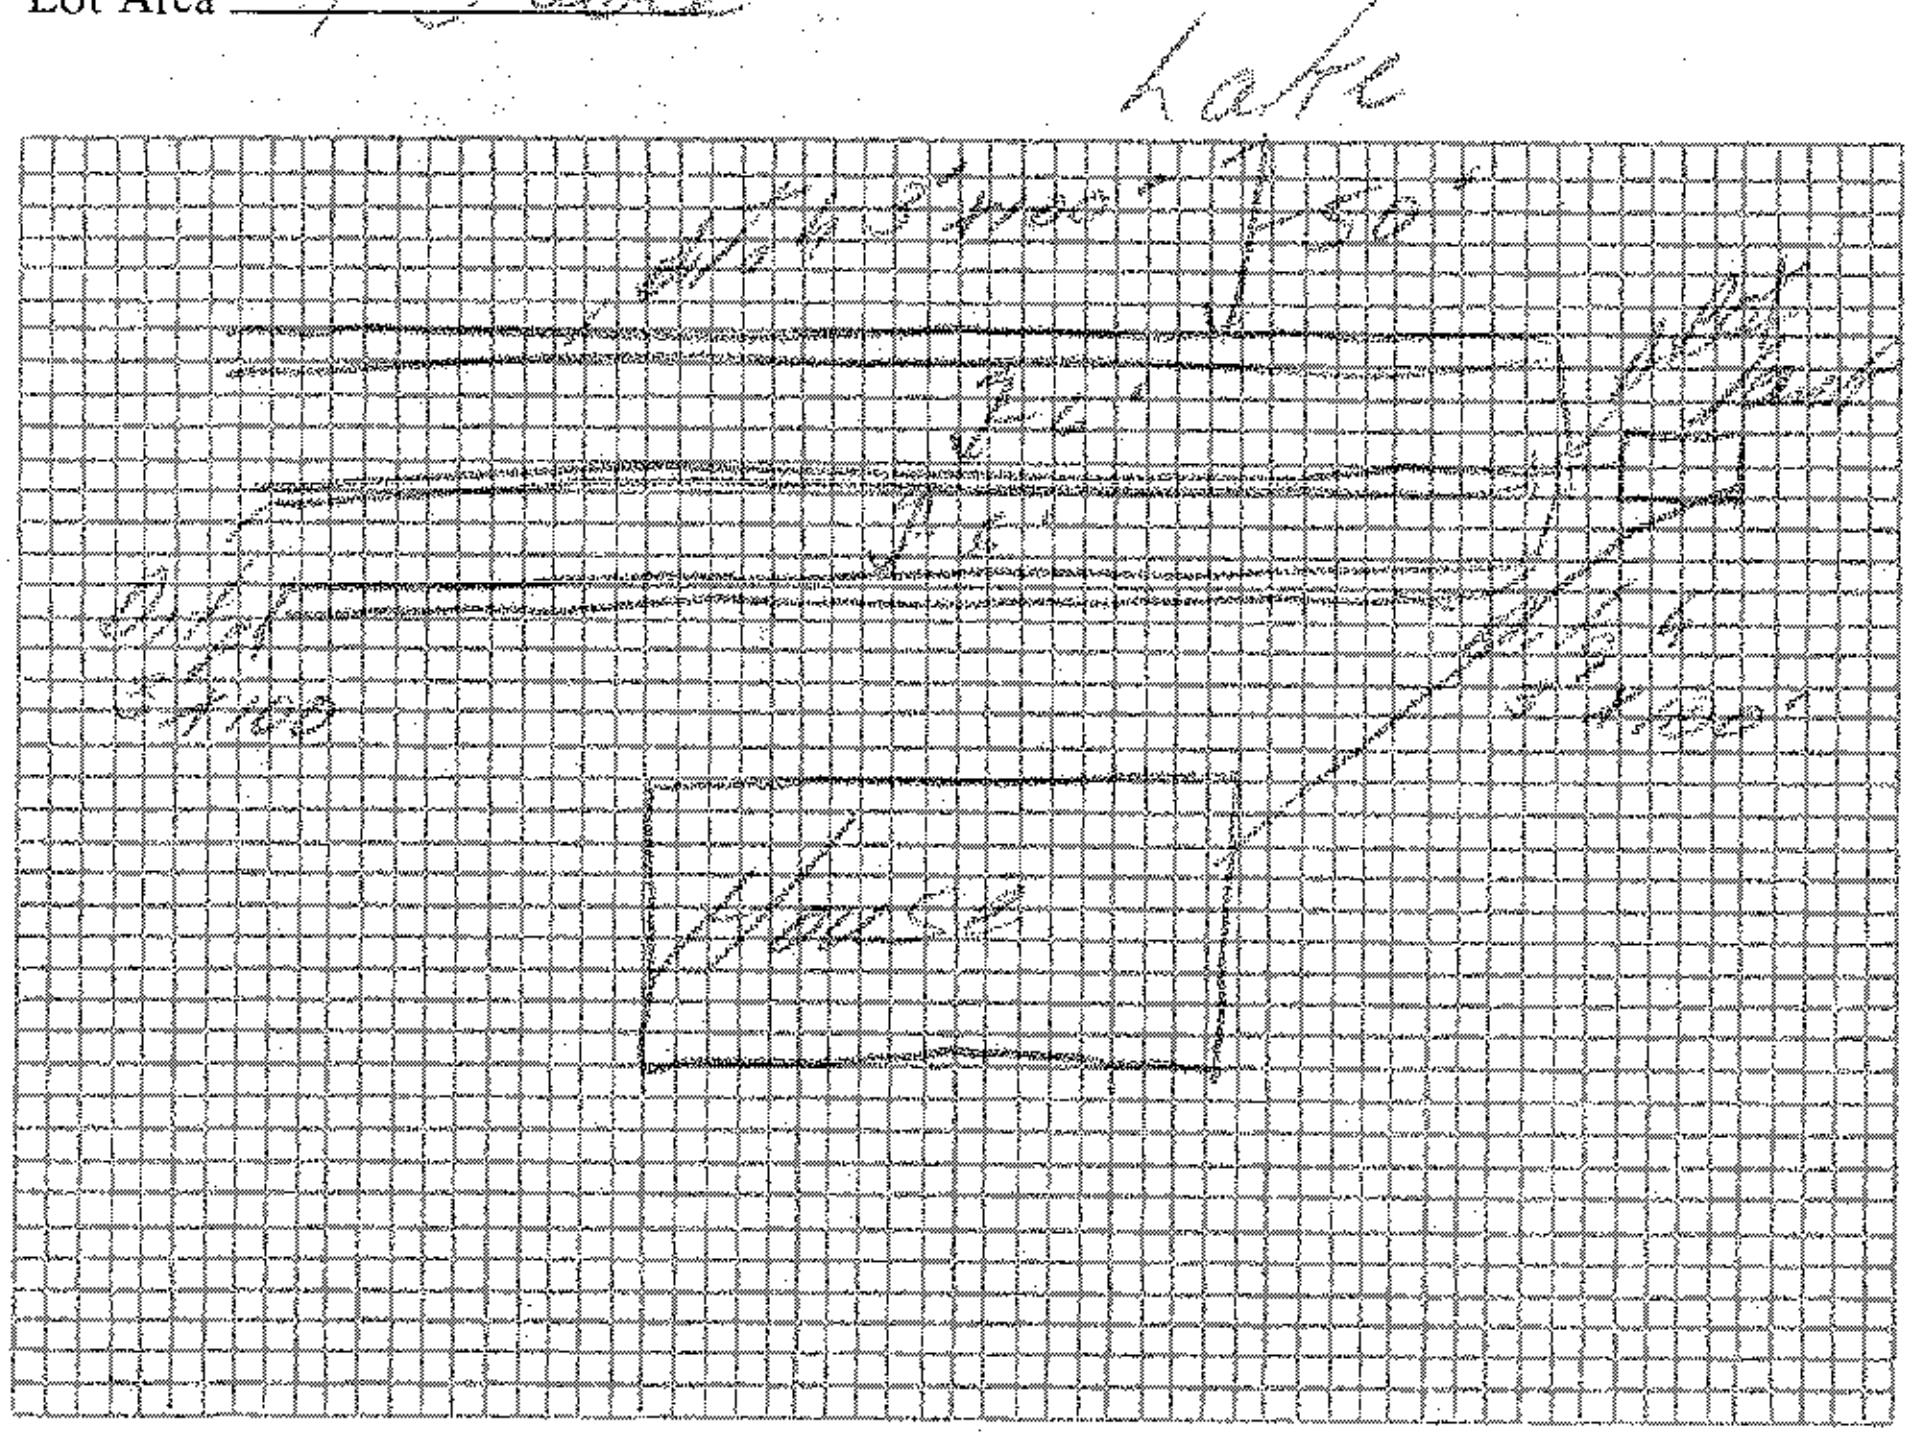

Plot of System

Size of Tank 1500 Gals.

Nitrification Field:
No. of Lines 1
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Ray Barney

IMPROVEMENTS PERMIT BY ____________

COMMENTS: ____________

CERTIFICATE OF COMPLETION BY [illegible signature] DATE [illegible]

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold