DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ____ *of* ____
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

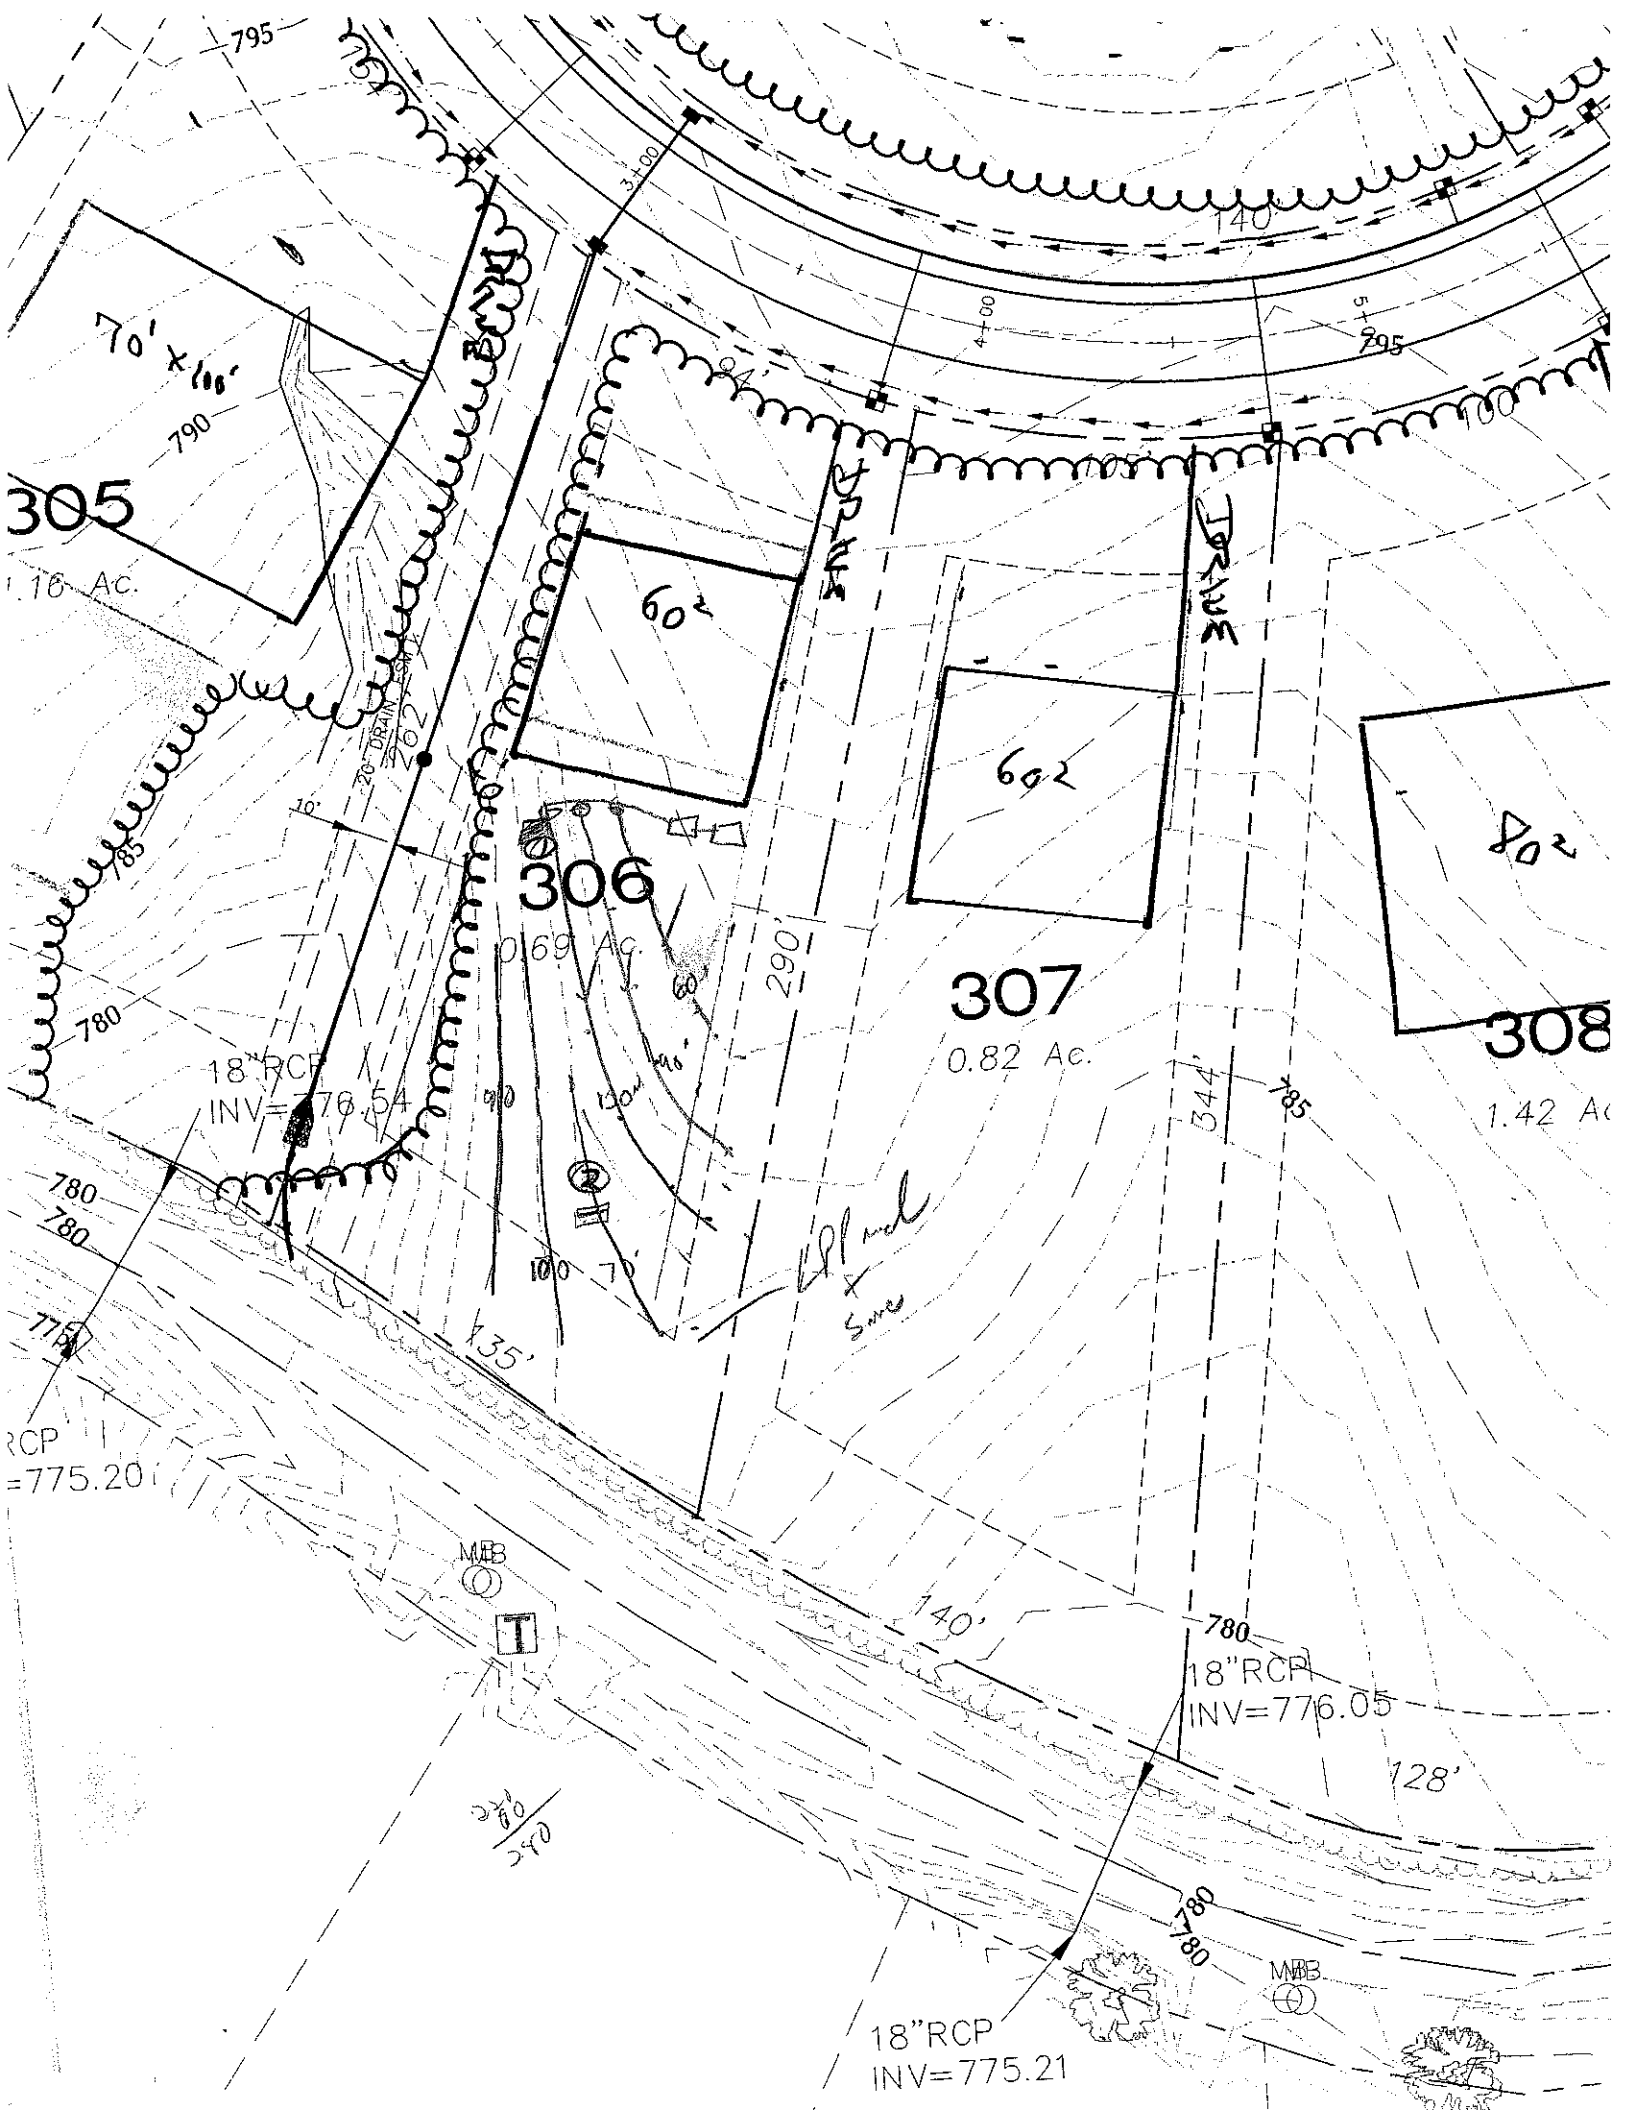
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 306 Farms PROPERTY RECORDED: _____
WATER SUPPLY: ❑ Private ❑ Public ❑ Well ❑ Spring ❑ Other _____
EVALUATION METHOD: ❑ Auger Boring ❑ Pit ❑ Cut
TYPE OF WASTEWATER: ❑ Sewage ❑ Industrial Process ❑ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	RDLR WFSBK	fri SSSP	Relic Mottles				PS 3
		6-24	RC MFSBK	fri SSSP					
		24-56	VFLR WFSBK	fri SSSP-fw Comm SAP					
2		0-23	RC SBK	fri SSSP					PS -3
		23-53	RLR MFSBK	fri SSSP					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


795
790
785
780
775
3+00
4+00
5+00
140'
70' x 100'
305
1.16 Ac.
60'
DRIVE
60'
DRIVE
20' DRAINAGE EASEMENT
10'
306
0.69 Ac.
290'
307
0.82 Ac.
308
1.42 Ac
344'
18"RCP
INV=778.54
18"RCP
INV=775.20
18"RCP
INV=776.05
18"RCP
INV=775.21
135'
140'
128'
100'
70'
150'
MBB
T
Pond
Swale