DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

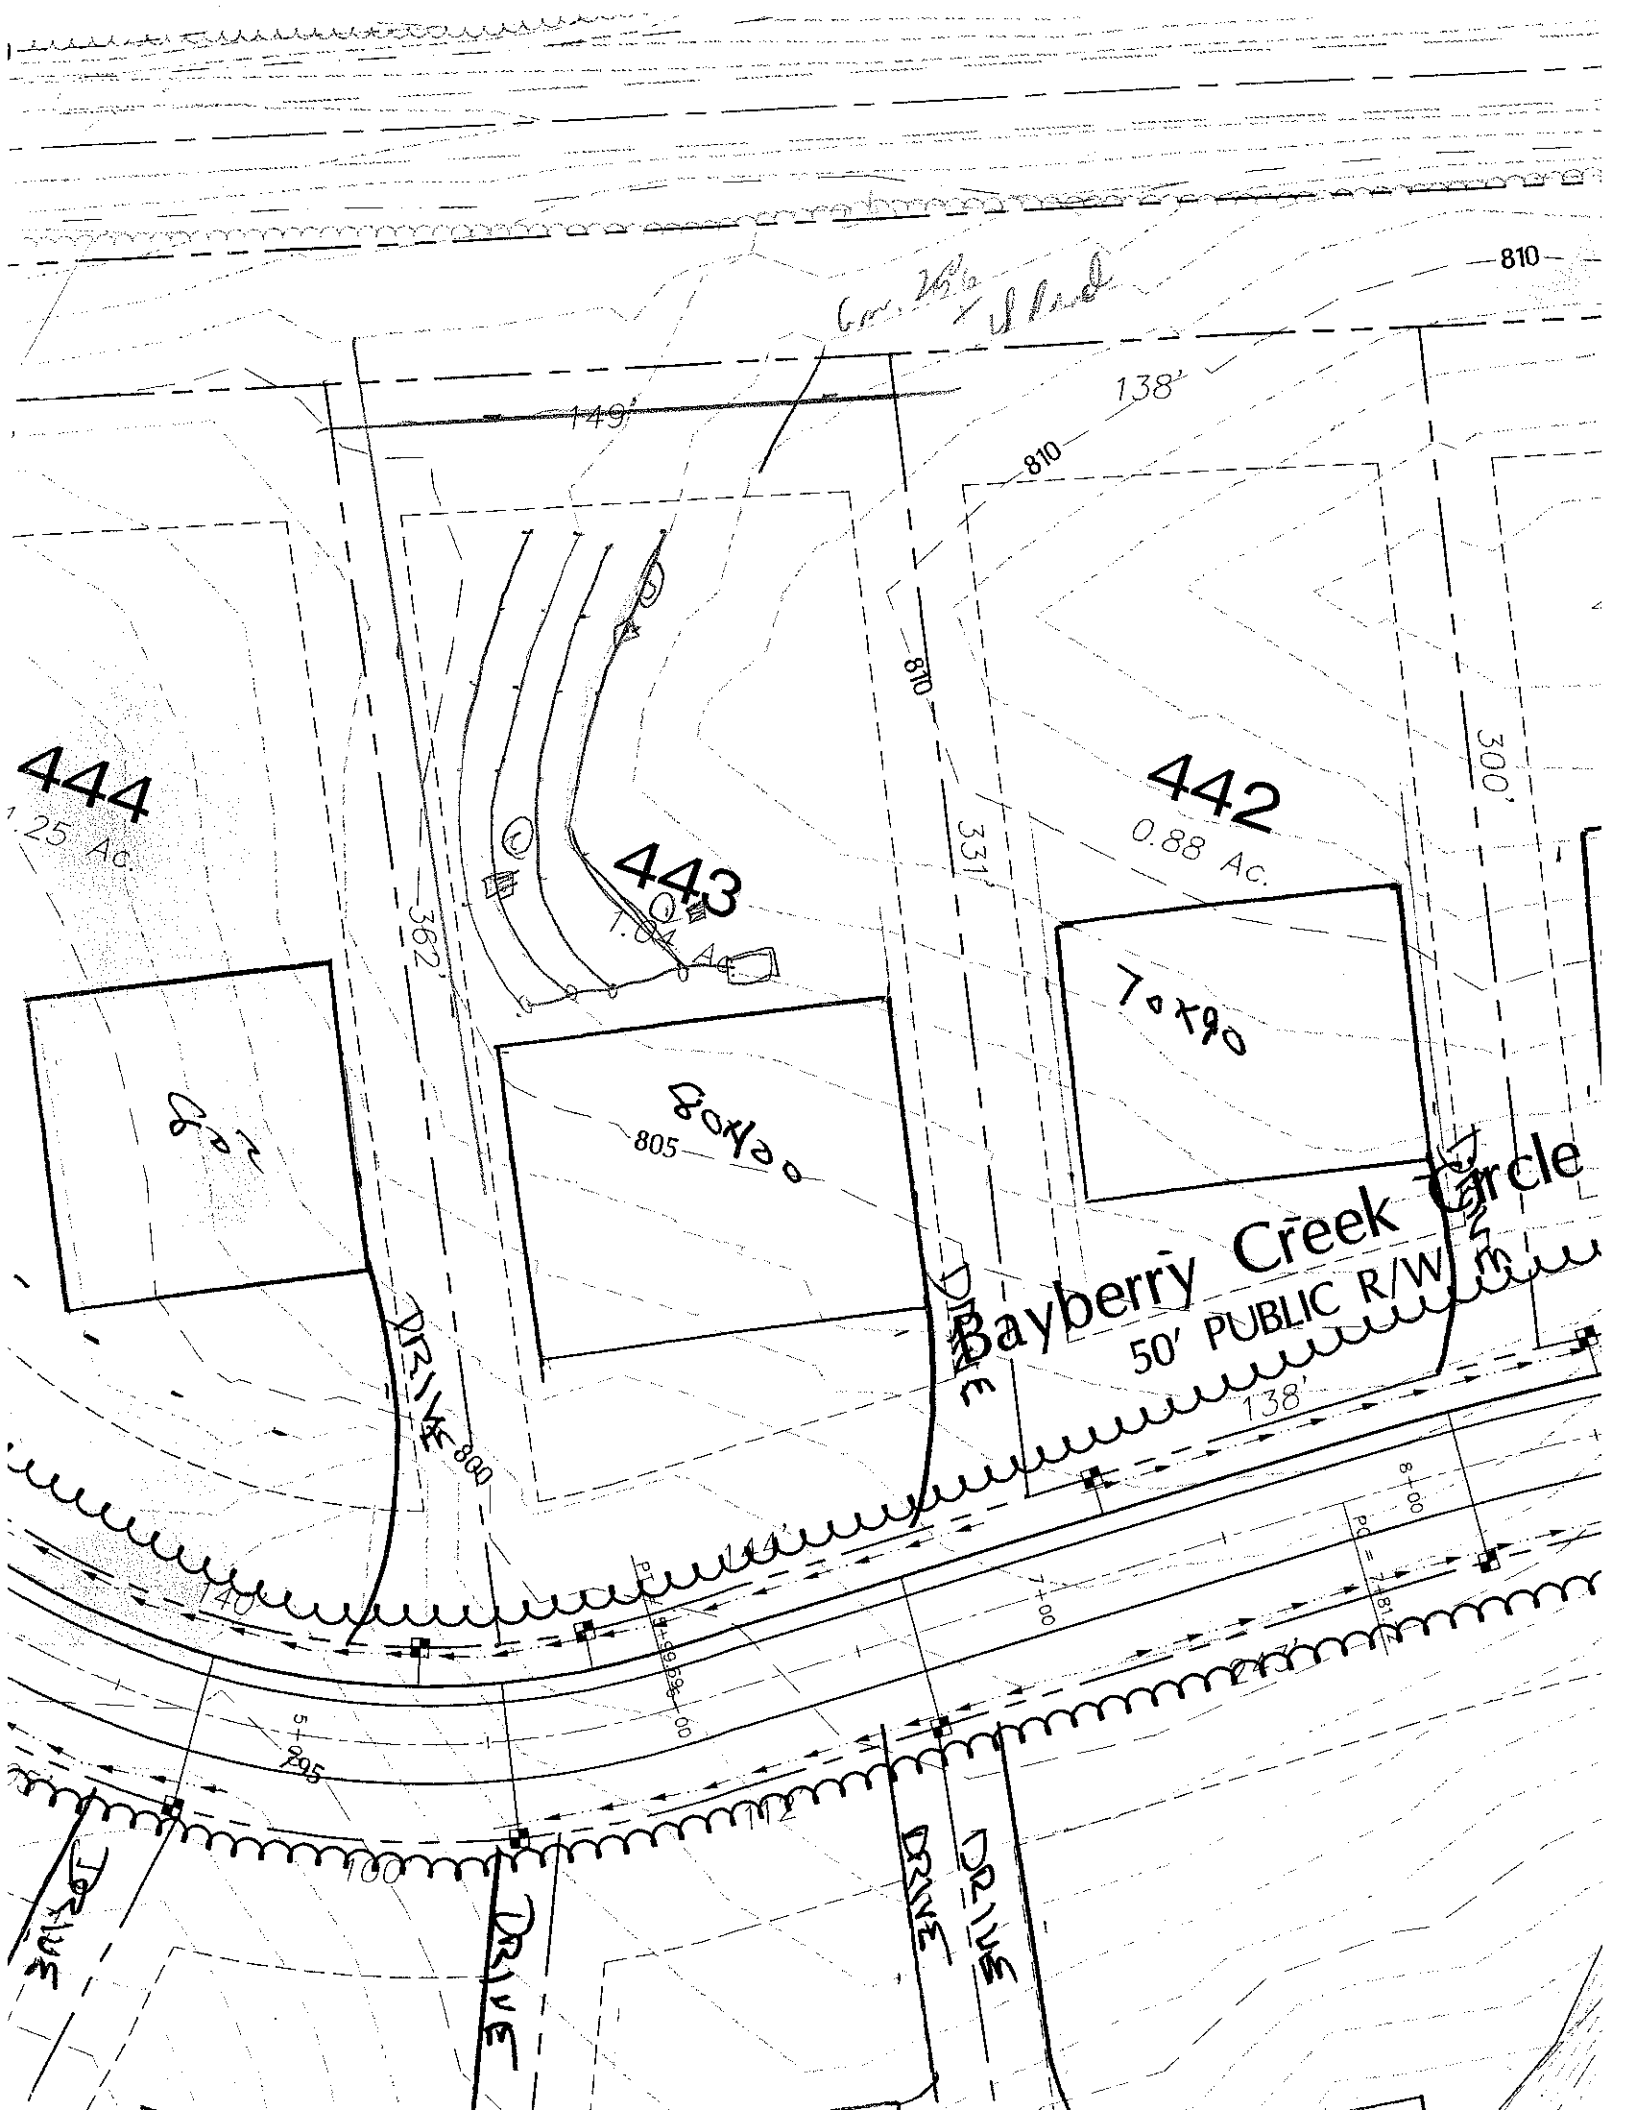
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: 443 Farm S II PROPERTY RECORDED: _____
WATER SUPPLY: ❑ Private ❑ Public ❑ Well ❑ Spring ❑ Other _____
EVALUATION METHOD: ❑ Auger Boring ❑ Pit ❑ Cut
TYPE OF WASTEWATER: ❑ Sewage ❑ Industrial Process ❑ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-5	L	G-gr VF					PS .3
		5-16	RC	MSBK fri SSSP					
		16-36	RCL	MWSBK fi SSSP	common SAP				
2		0-24	RCL	MSBK fri SSSP many	SAP				PS .35
		24-48	RCLSAP	MSBK fri SSSP					
3		0-8	MSCL	GR fri SSSP					PS .3
		8-41	RC	SBK fri SSSP					
		41-95	RCL	VSBK fri SSSP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


810
149'
138'
810
810
444
1.25 Ac.
443
1.02 Ac.
442
0.88 Ac.
362'
331'
300'
Bayberry Creek Circle
50' PUBLIC R/W
138'
DRIVE
DRIVE
DRIVE
DRIVE
140
100
5+295
8+00
7+00