DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

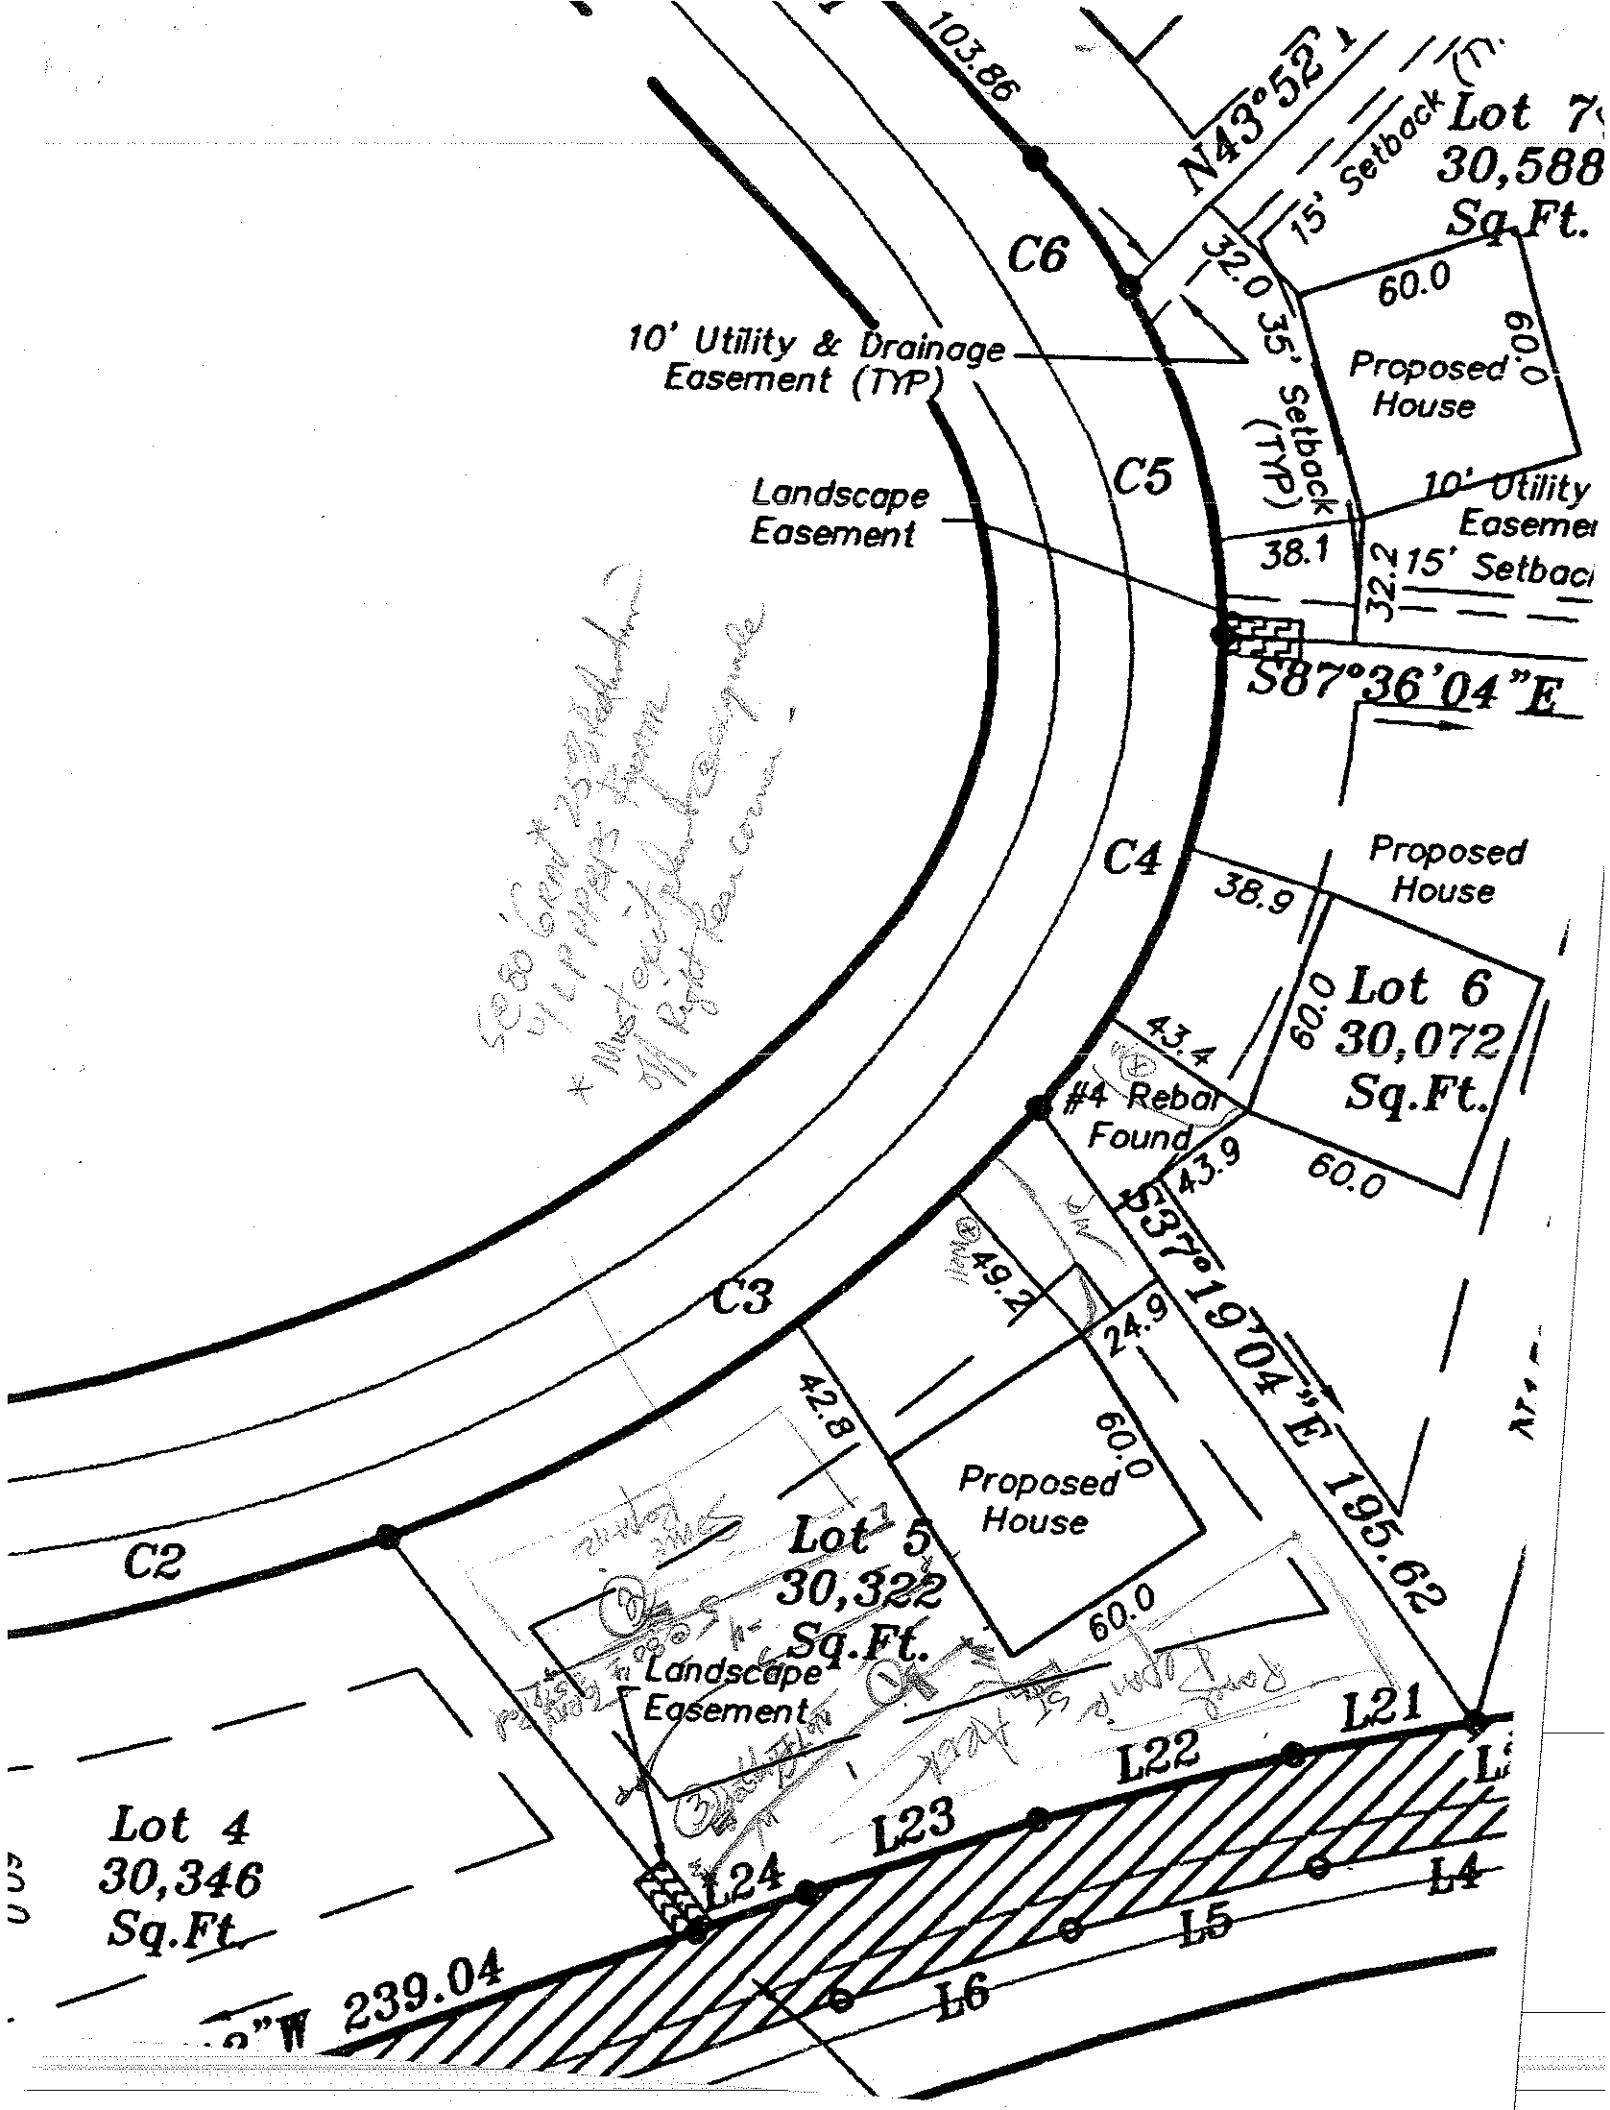
Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION *for* ON-SITE WASTEWATER SYSTEM

OWNER: Mid Atlantic Custom Homes
ADDRESS: _____ APPLICANT: _____
PROPOSED FACILITY: _____ APPLICATION DATE: _____
LOCATION OF SITE: Lot 5 Waterlee Landing PROPOSED DESIGN FLOW (.1949): 4Bdrm DATE EVALUATED: 4-29-04
WATER SUPPLY: ☑ Private ☐ Public ☐ Well ☐ Spring ☐ Other PROPERTY SIZE: _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut PROPERTY RECORDED: _____
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	S 3%	0-8	gr brn SL/scl	fri SSSP	few gray/brn mottles few/min/soft				.25-.3
		8-16	mk scbk rc	fri SSSP					
		16-48	wk blk mxcl	fi SSSP					
2		0-7	gr brn SL/scl	fri SSSP					.3
		7-43	sbk rdcl	fri SP-SSSP SSSP					
3	S 2%	0-6	gr brn SL	fri SSSP					.3
		6-23	mk sbk rc	fri SSSP SSSP					
		23-50	wk-m sbk rdcl	fi SSSP SSP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM	OTHER
	-PS	PS	
System Type(s)	Conv. SSS bed	PRESSURE	EVALUATED BY: DWH -PS
e LTAR	.3	.3	OTHER(S) PRESENT:


103.86
N43°52'
15' Setback
Lot 7
30,588
Sq.Ft.
C6
32.0
35' Setback (TYP)
60.0
60.0
Proposed House
10' Utility & Drainage Easement (TYP)
C5
Landscape Easement
38.1
32.2
15' Setback
10' Utility Easeme
S87°36'04"E
C4
Proposed House
38.9
43.4
Lot 6
30,072
Sq.Ft.
60.0
#4 Rebar Found
43.9
60.0
S37°19'04"E 195.62
C3
49.2
24.9
42.8
60.0
Proposed House
C2
Lot 5
30,322
Sq.Ft.
60.0
Landscape Easement
L21
L22
L23
L24
L4
L5
L6
Lot 4
30,346
Sq.Ft
239.04