SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

APPLICATION DATE: _____

SS: _____ DATE EVALUATED: _____

SED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____

ION OF SITE: lot 352 farms II PROPERTY RECORDED: _____

SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____

ATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

F WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

65
35

.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
	0-5	YBSCL	WSSN fri SSSP	SMP				PS
	5-36	RC	MSBK/ABK fri SS,P	SMP				.275-.3
	36-48	RCL	FWSBK fri SSSP					
	0-25	RYCL	WSBK fri SSSP	SMP - many SEP				PS
	25-36	L	SAP/SL SBP WSBK fri NSNP	MEP				.35-.4
	0-10	SCL	WFSBK fri SSSP	SMP				PS
	10-48	RC	SBK f SP	SMP				.3
	0-38	RC	SBK/MSBK fri SSSP	SMP				PS
	38-53	RCL	MFSBK fri SSSP	SMP				.3

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
ite Space (.1945)		
Types)		

OTHER FACTORS (.1946): _____

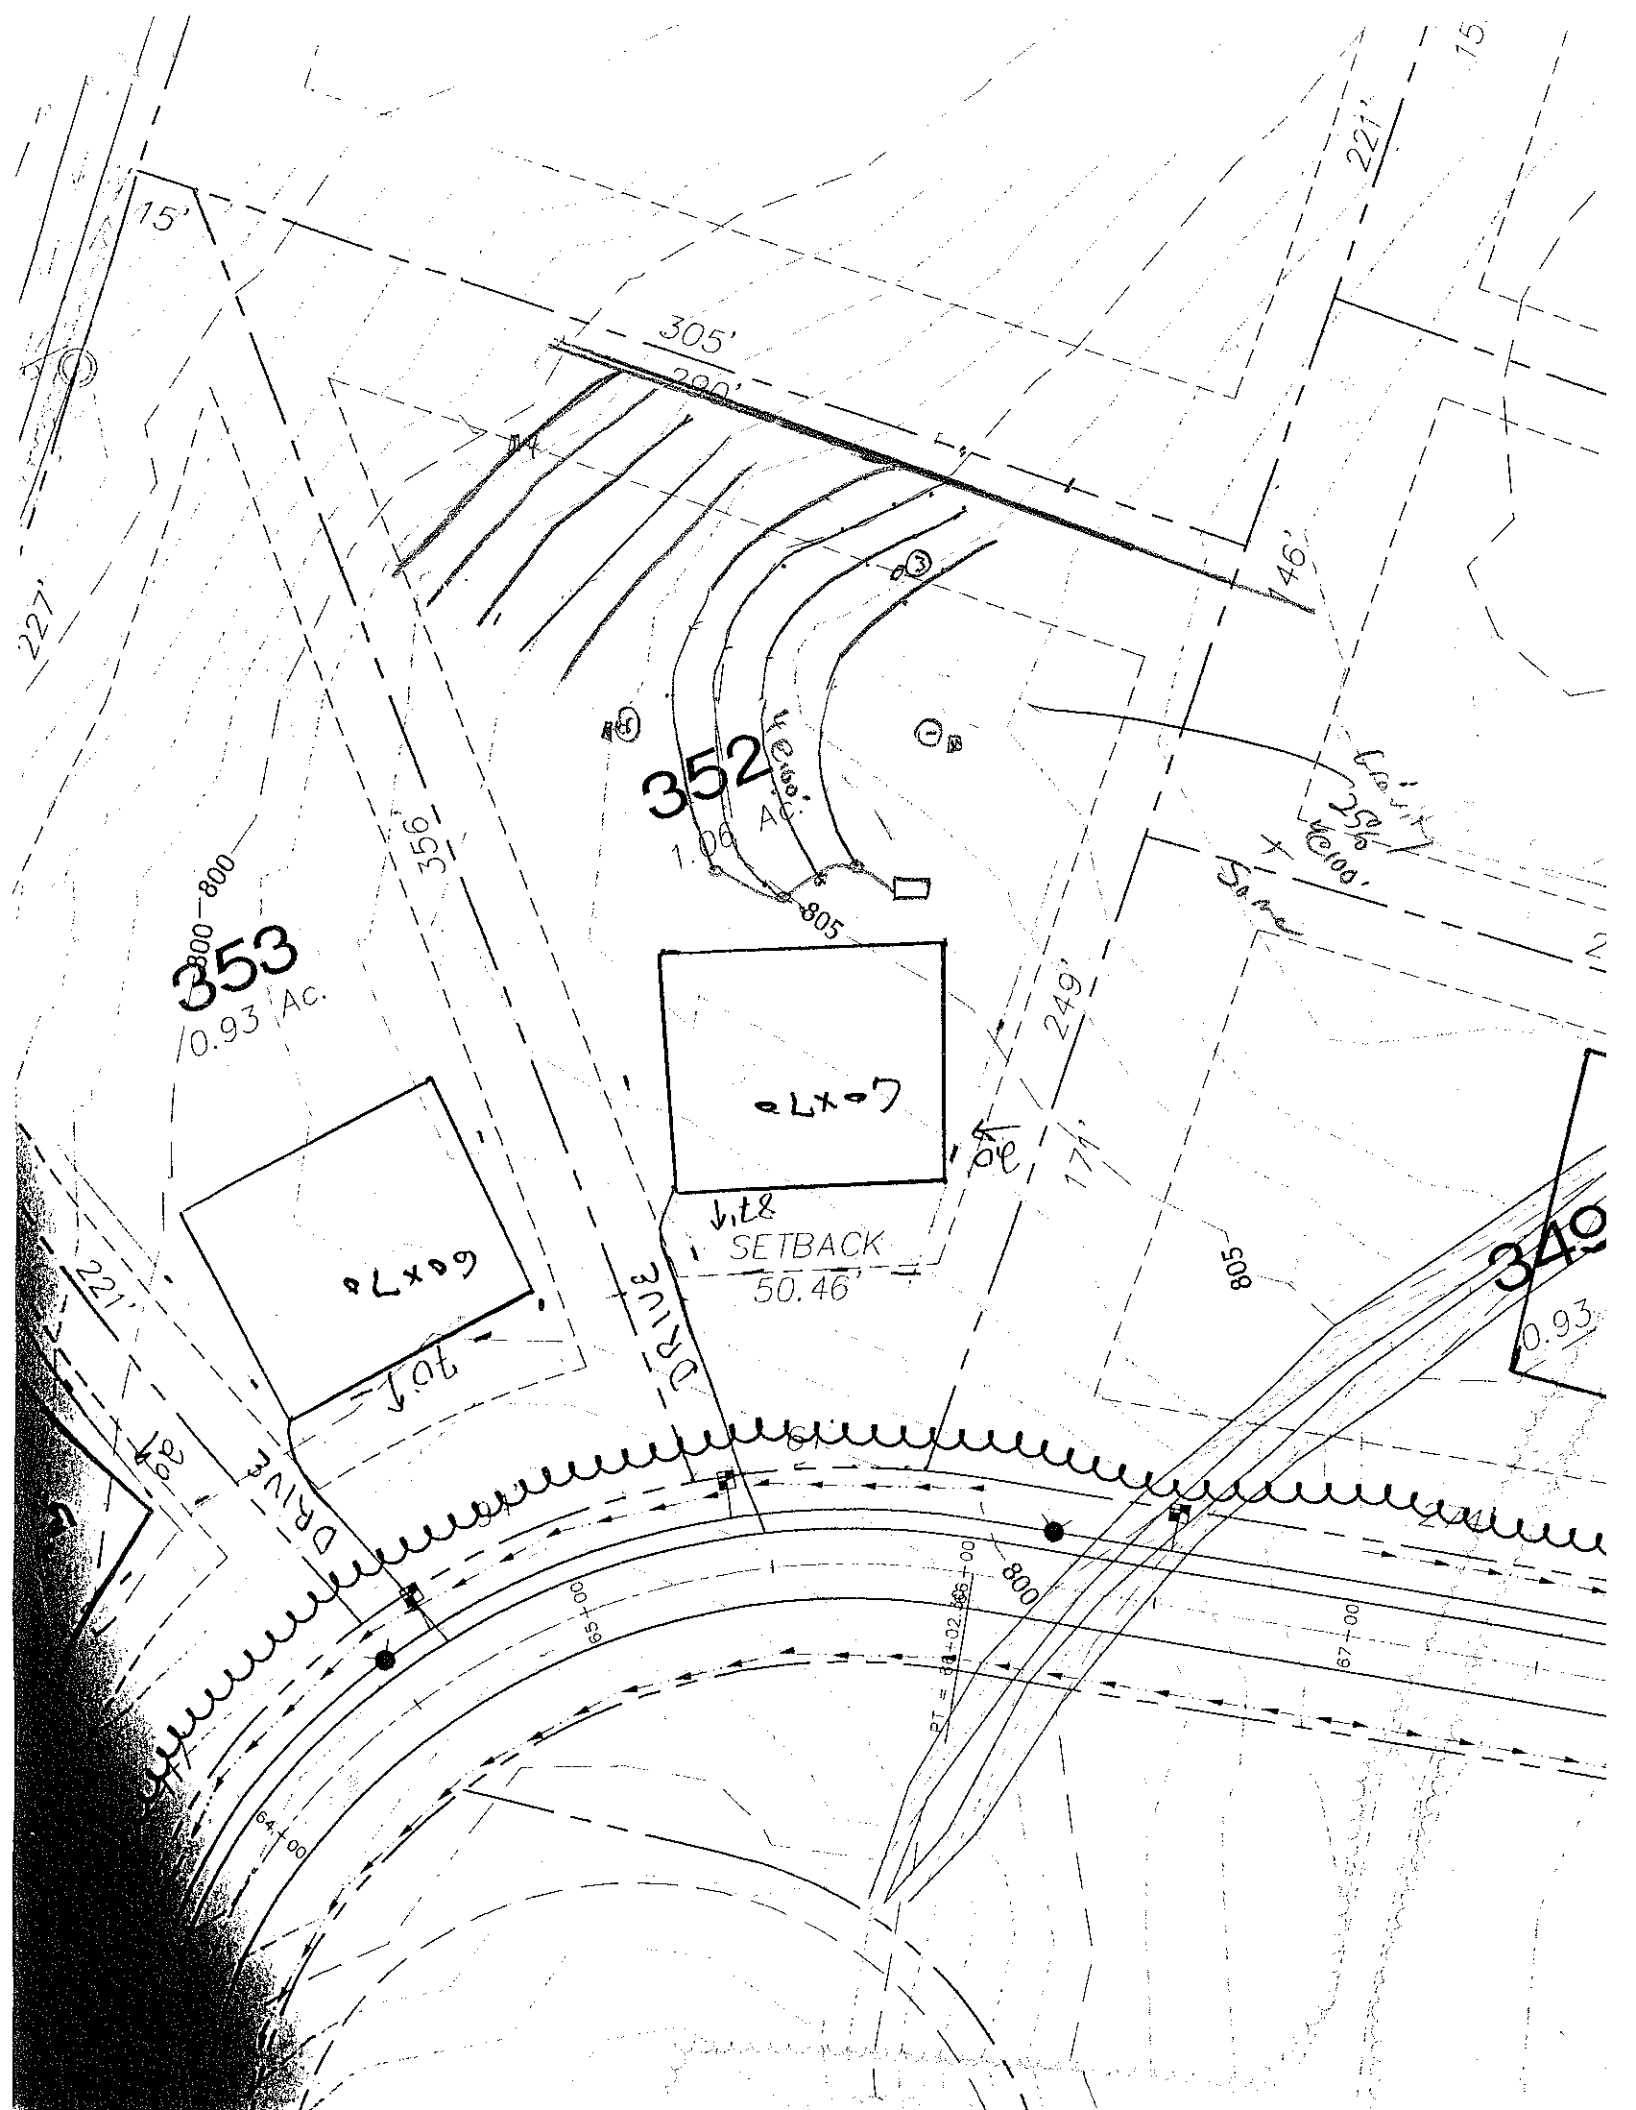
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____

OTHER(S) PRESENT: _____

_____

ENTS: _____


15'
305'
290'
221'
227'
46'
352
1.00 AC.
353
0.93 AC.
356'
800
805
249'
171'
SETBACK
50.46'
DRIVE
221'
349
0.93
65+00
64+00
67+00
800