DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ *of* ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

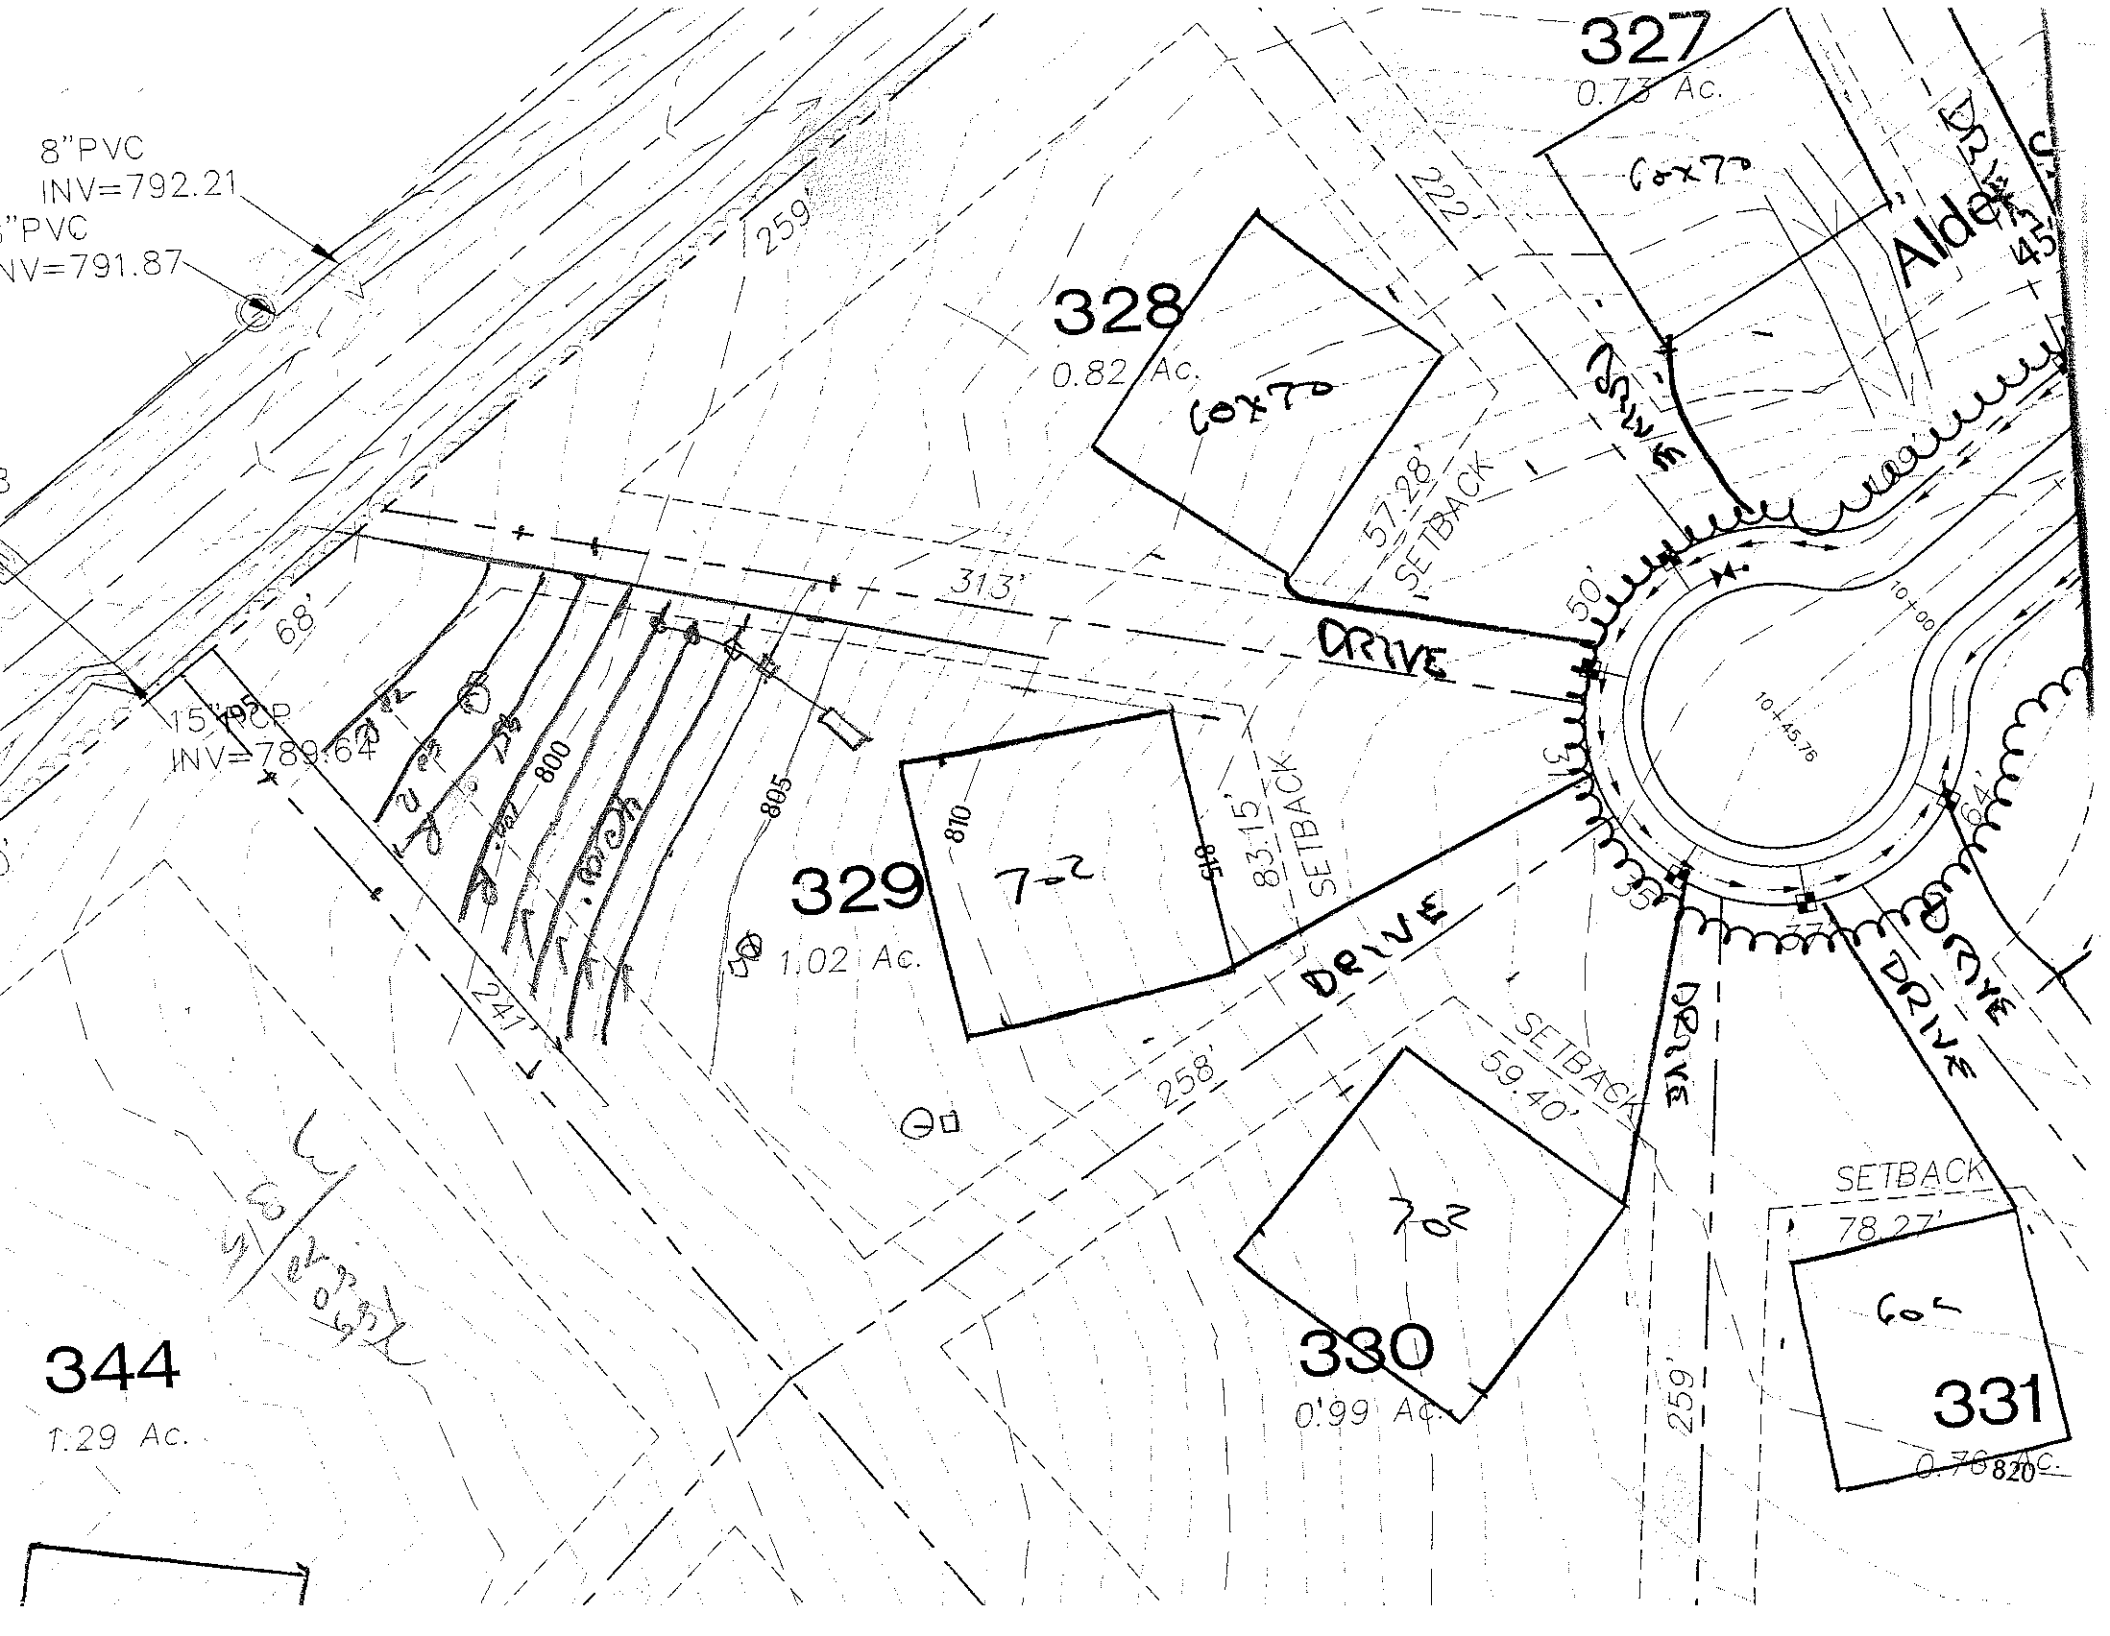
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 329 Farms III PROPERTY RECORDED: _____
WATER SUPPLY: ❑ Private ❑ Public ❑ Well ❑ Spring ❑ Other _____
EVALUATION METHOD: ❑ Auger Boring ❑ Pit ❑ Cut
TYPE OF WASTEWATER: ❑ Sewage ❑ Industrial Process ❑ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-19	RC SCL	fr: SSSP					PS .3
		19-46	RC MSCL	fr: SSSP					
		46-56	LSAP VSCL	fr: SSSP					
2		0-6	MB SL WSBK	fr: SSSP					PS .3
		6-36	RC SBK/ABK	fr: SS,P					
		36-50	RCL WSBK	fr: SSSP					
		50-60	LSAP WSBK	fr: NS,SP					
3		0-8	BSL GR	fr: SSSP					PS .25 .3
		8-36	RC ABK	fr: SSSP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


8"PVC
INV=792.21
"PVC
NV=791.87
15"RCP
INV=789.64
259'
68'
313'
DRIVE
327
0.73 Ac.
60x70
328
0.82 Ac.
60x70
57.28'
SETBACK
22'
45'
50'
10+00
10+45.76
329
1.02 Ac.
7-2
810
845
83.15'
SETBACK
805
800
241'
258'
SETBACK
59.40'
330
0.99 Ac.
7-2
SETBACK
78.27'
60'
331
0.78 Ac.
820
344
1.29 Ac.