DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

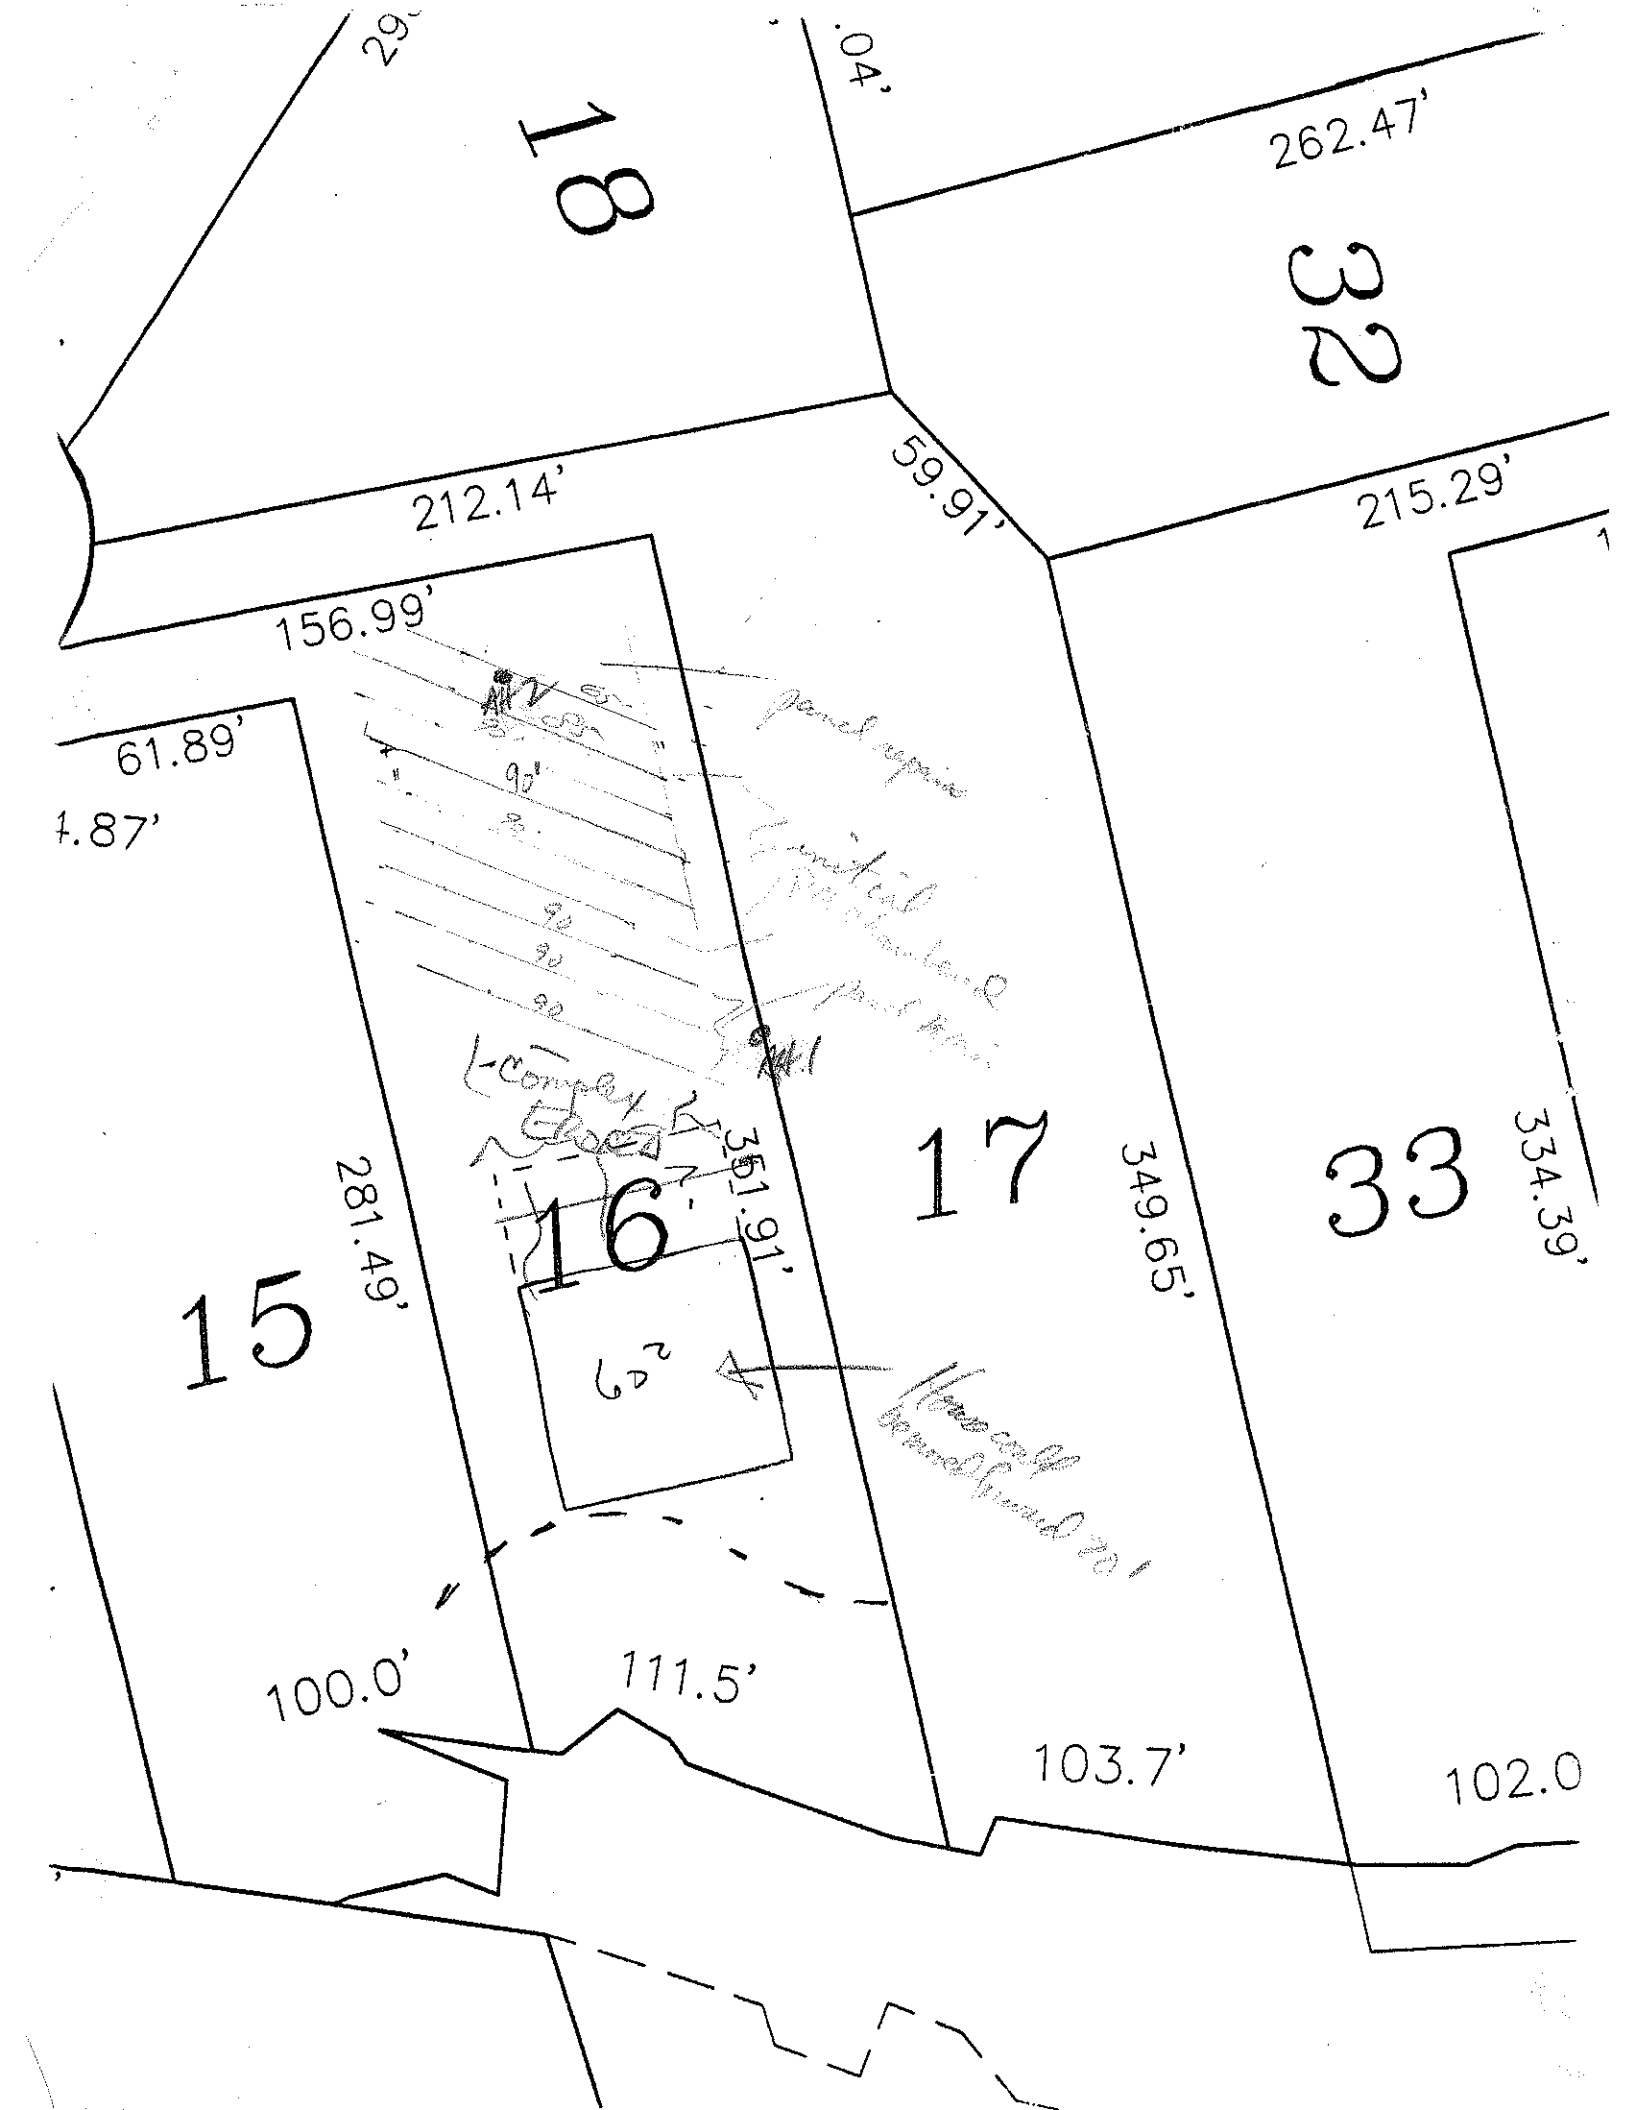
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: CRC APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 4-30-26
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 16 Harbour place 3 PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	L ~12%	0-10	gr brn sl/sd	fr 1:1					03
		10-23	SAB RC	fi sp 1:1					
		23-42	SAB R heavy C/B	fi-FR S,P-SS,SP					
		42-48	m-wksab pcl	fr SS,SP					
			brt sgwn few reliwetlike						
2	L ~10%	0-14	gr brn scl	fr					03
		14-33	SAB RC	fi sp 1:1					
		33-45	SAB RCL	fi-FR sp-ss sp 1:1					
		45-48	m-wksab brwn	mst cl fr ss sp 1:1					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


18
262.47'
32
212.14'
59.91'
215.29'
156.99'
61.89'
7.87'
90'
15
281.49'
16
351.91'
17
349.65'
33
334.39'
100.0'
111.5'
103.7'
102.0