IREDELL COUNTY HEALTH DEPARTMENT 4626 35 7012

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Mike Brewer DATE 1-8-81 PERMIT NO. 8

PHONE: Business _____ Home _____

LOCATION 1100 TR 1115 TL 1445 .7 mi. on left
265 Kemp S. R. No. _____

SUBDIVISION NAME Lake Norman LOT NO. 90 SECTION OR BLOCK NO. 8


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	clay loam	
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	Compiled	
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	Lvl	
Site Suitable	Yes (✓)	No ( )	Depth to Water Table	none.	
			Rock or other impervious formations	none obs.	

Lot Area ~ 3/4 AC.

✓ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

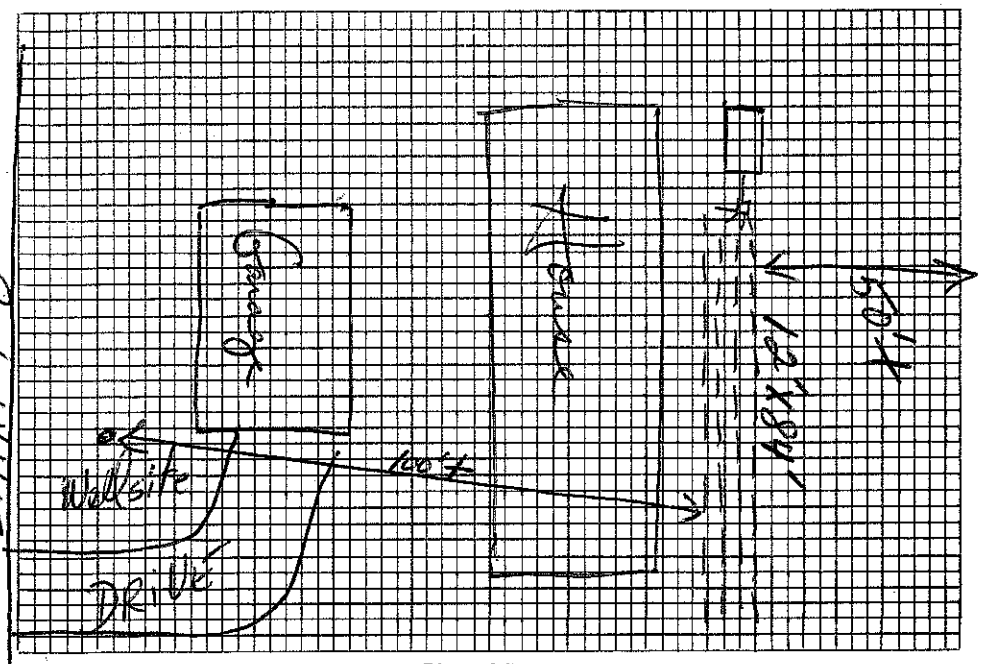

Plot of System

Size of Tank 1500 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 1000 Linear Ft. 333
Depth of Stone in Lines 16"

Water Supply: Individual (✓)
Public ( )

Installed by F. J. Erwin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY [signature]

COMMENTS: _____

CERTIFICATE OF COMPLETION BY David R. Hinson DATE 1-8-81

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.
Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

2:30

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Nick Brewer DATE 12/22/80 PERMIT NO. 318

PHONE: Business _____ Home _____

LOCATION 1100 TR 1115 TL 1445 .7 mi. on left

S. R. No. _____

SUBDIVISION NAME Lake Norman LOT NO. 90 SECTION OR BLOCK NO. 8

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area ± 3/4 Ac

Character & Porosity of Soil clay loam


Percolation Rate 60 mpi

Topography 4-6%

Depth to Water Table tank.

Rock or other impervious formations none obs.

✓ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

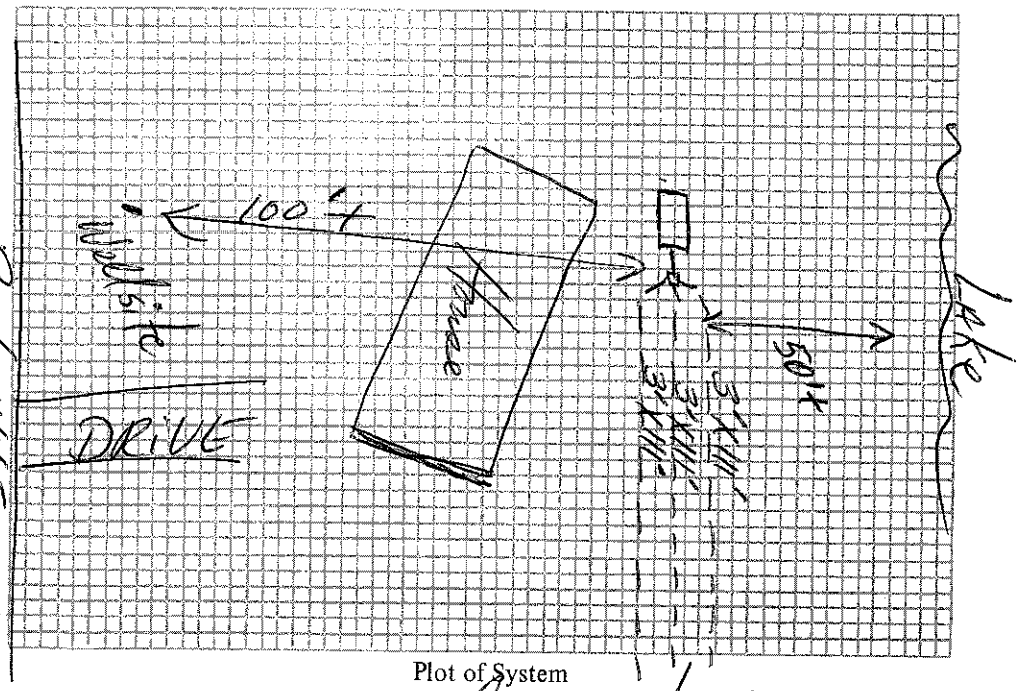

Size of Tank 1250 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 1000 Linear Ft. 333'

Depth of Stone in Lines 10"

Water Supply: Individual (✓)

Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: J D Hunsucker

Hunsucker Builders

IMPROVEMENTS PERMIT BY David R. Hanson

COMMENTS: _____

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold