OPENING CALCULATIONS PER TABLE R302.1	
LEFT SIDE WALL	RIGHT SIDE WALL
TOTAL WALL AREA: 786 sf	TOTAL WALL AREA: 565 sf
TOTAL GLAZING AREA: 63 sf	TOTAL GLAZING AREA: 15 sf
TOTAL DOOR AREA: 0 sf	TOTAL DOOR AREA: 0 sf
OPENING AREA AS PERCENTAGE OF WALL: 8.2%	OPENING AREA AS PERCENTAGE OF WALL: 2.7%

OPENING CALCULATIONS PER TABLE R302.1	
LEFT SIDE WALL WITH BATH 4	RIGHT SIDE WALL WITH 2 CAR SIDELOAD GARAGE
TOTAL WALL AREA: 788 sf	TOTAL WALL AREA: 565 sf
TOTAL GLAZING AREA: 67 sf	TOTAL GLAZING AREA: 23 sf
TOTAL DOOR AREA: 0 sf	TOTAL DOOR AREA: 0 sf
OPENING AREA AS PERCENTAGE OF WALL: 8.7%	OPENING AREA AS PERCENTAGE OF WALL: 4%

OPENING CALCULATIONS PER TABLE R302.1
RIGHT SIDE WALL WITH 3 CAR SIDELOAD GARAGE
TOTAL WALL AREA: 745 sf
TOTAL GLAZING AREA: 15 sf
TOTAL DOOR AREA: 193 sf
OPENING AREA AS PERCENTAGE OF WALL: 28%

OPENING CALCULATIONS PER TABLE R302.1
RIGHT SIDE WALL WITH 2 CAR SIDELOAD GARAGE
TOTAL WALL AREA: 565 sf
TOTAL GLAZING AREA: 15 sf
TOTAL DOOR AREA: 128 sf
OPENING AREA AS PERCENTAGE OF WALL: 25.3%

General Floor Plan Notes


General Floor Plan Notes shall apply unless noted otherwise on plan.

1. **Wall Heights:** Typically 9'-1 1/2" first and second floors. All walls are constructed using a double top plate. Special wall heights are noted on plans where they occur.
2. **Wall Thickness** is typically 4" at exterior walls, 3-1/2" at interior. 2x6 frame shall be used at walls that back up to plumbing fixtures. Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
3. **Headers:** Structural headers are to be sized in accordance with NCRC Tables R502.5(1) and R502.5(2) or as noted on the plans for unique situations. Only use Structural Headers where required. Non-Structural Headers shall be Double Top Plate W/ Conventional Frame.
4. **Header height** shall be 7'-6" AFF (Charlotte) or 7'-8" AFF (Raleigh), unless noted otherwise.
5. **Jacks:** Jack requirements to be in accordance with NCRC Tables R502.5(1) and R502.5(2) or as noted on the plans for unique situations.
6. **Point loads** shall be blocked solidly to top of foundation. Point load supports are noted on plan where they occur.
7. **Soffits, Coffered Ceilings, Tray Ceilings** and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically called out as included, kitchens do not include soffits over wall cabinetry.
8. **Door & Window Frames,** where occurring near corners, shall be a minimum of 4-1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on the closet entry wall.
9. **Windows:** Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
10. **Closets** for clothing or coat storage shall be equipped with 1 rod/shelf, open wire. Closets for linen shall have 5 open wire shelves. Closets for pantries shall have 5 shelves.
11. **Stairs** shall have a minimum width dimension of 3'-0" finishedtreads shall be 10" deep, and risers shall be a maximum of 7-3/4" unless noted otherwise. Each tread shall have nosing protruding between 3/4" and 1 1/4" from the riser.

Handrails and Guards at stairs shall be between 34" and 38" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced such that a 4" sphere cannot pass through them per R312.3.

12. **Attic Access** with finished dimensions of a minimum 20" x 30" shall be provided in accordance with NCRC section R807 or Chapter 3 NCRC-Mechancial Section 306.3 if mechanical equipment is located in the attic space. Pull down stairs and weather sealed access doors in knee walls meeting minimum criteria are also acceptable. Attic access located in attached garages must be installed in accordance with NCRC R302.5.
13. **Garage Door to Living Space** shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
14. **Garage Walls,** as a minimum, shall be separated from living space and living space attic by installing 1/2" gypsum board on the garage side of the living space walls and any structural supportive walls and 5/8" Type 'X' Gyp BD at the ceilings. See R302.5 and R302.6
15. **Corners,** 4-1/2" minimum in wall corners for doors and windows to allow for trim.

ALL WINDOWS WHOSE OPENING IS LESS THAN 24" ABOVE THE FINISHED FLOOR AND WHOSE OPENING IS GREATER THAN 72" ABOVE THE OUTSIDE WALKING SURFACE MUST HAVE WINDOW OPENING LIMITING DEVICES COMPLYING WITH THE 2012 NCRC SECTIONS R612.3 AND R612.4

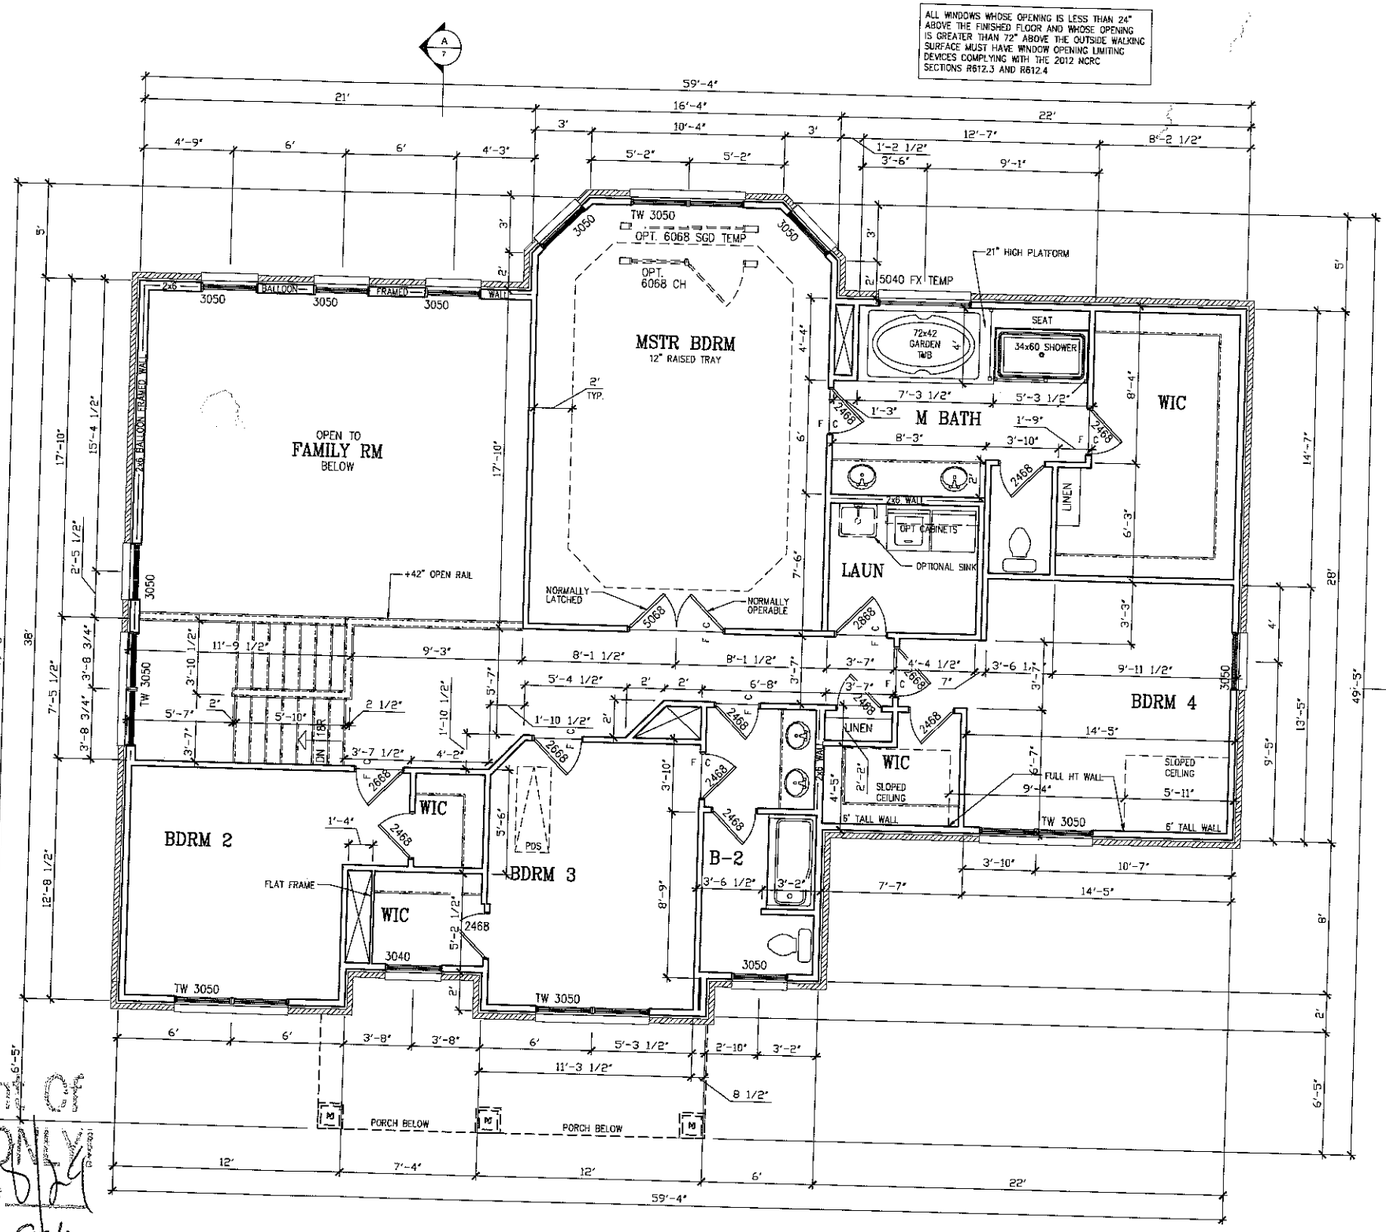

Acknowledgement Of Plans Submittal ONLY
Date 8/24
Date 8/24

2ND FLOOR PLAN "E"

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

© 2012 M/I HOMES INC.

MASTER ISSUE DATE: 11/21/11

DO NOT SCALE PRINTS! CONSTRUCTION SHALL BE PER INDICATED DIMENSIONS ONLY, ANY DISCREPENCIES TO BE REPORTED TO MI HOMES FOR CLARIFICATION!

LATEST REVISION DATE: 05/12/12

SUB NAME


LOT# -

__/__/__


M/I HOMES

BRUNSWICK
GARAGE - RIGHT
2ND FLOOR PLAN "E"


SHEET # 5.20

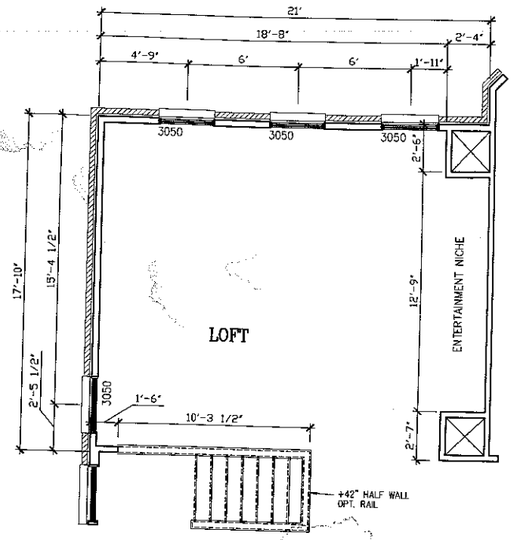


LOFT

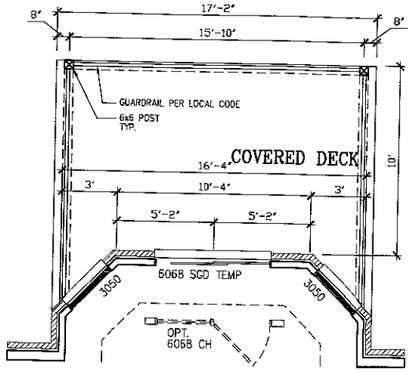

COVERED DECK AT 2ND FLOOR

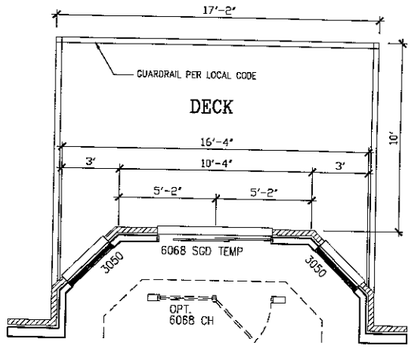


DECK AT 2ND FLOOR

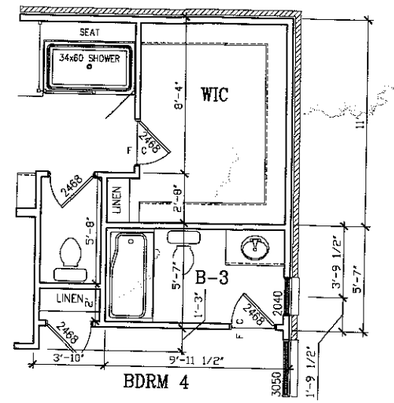


BDRM 4


BATH 3

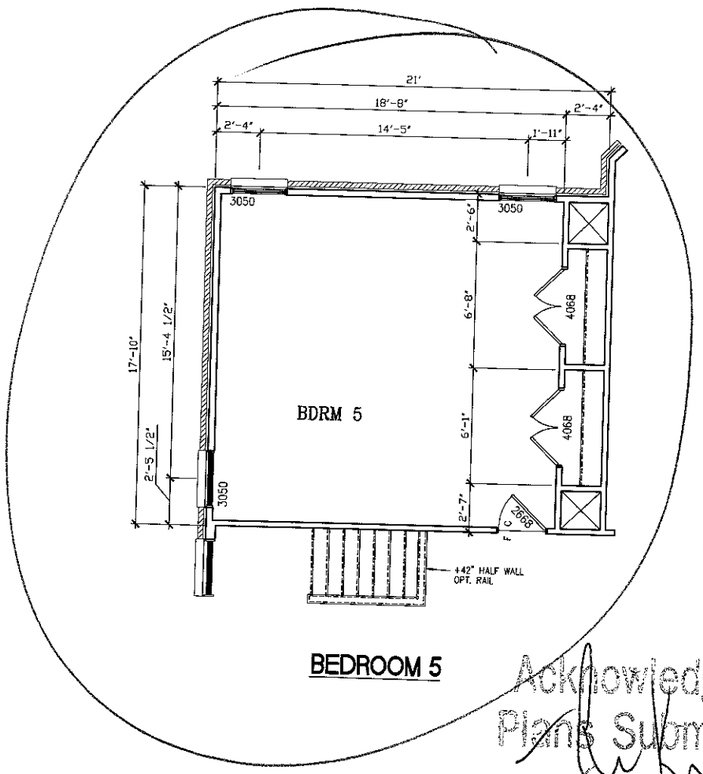

BEDROOM 5

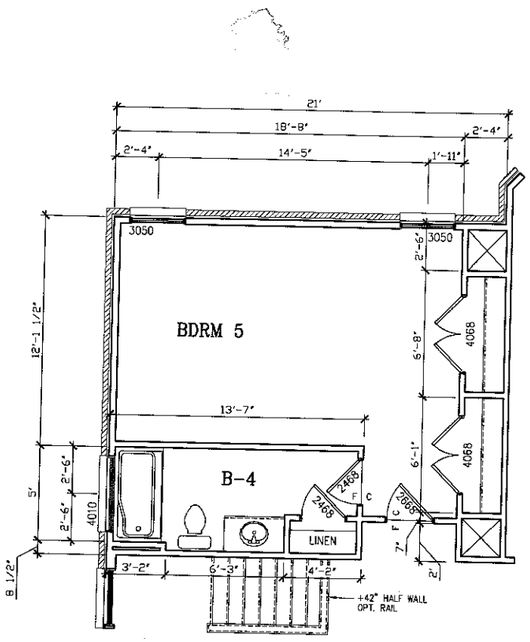

BEDROOM 5 W/ BATH 4

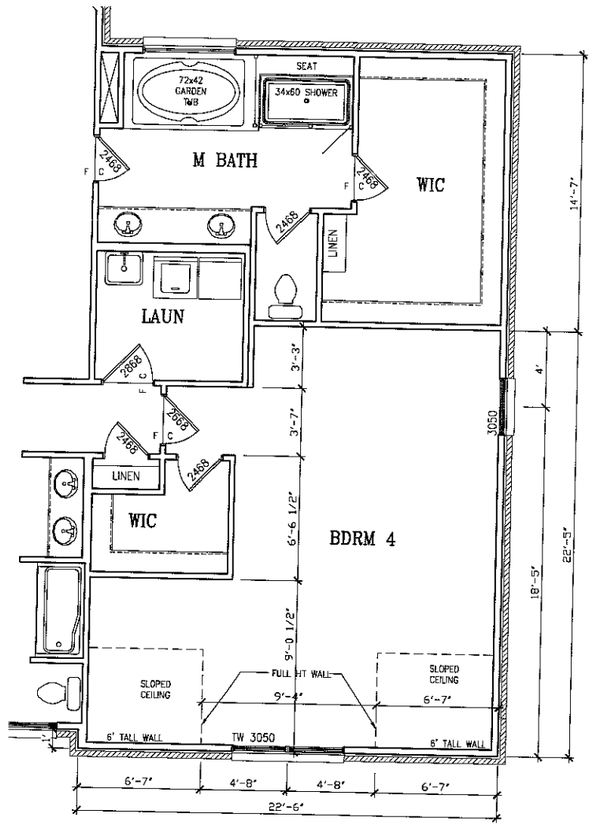

BEDROOM 4 W/ 3-CAR GARAGE

Acknowledgement
Plans Submittal ONLY!
Date 8/24
Date 8/24

OPTIONAL 2ND FLOOR PLANS

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17


© 2012 M/I HOMES INC.

MASTER ISSUE DATE:
11/21/11
DO NOT SCALE PRINTS! CONSTRUCTION SHALL BE PER INDICATED DIMENSIONS ONLY. ANY DISCREPENCIES TO BE REPORTED TO MI HOMES FOR CLARIFICATION
LATEST REVISION DATE:
05/12/12
SUB NAME
LOT# -
__/__/__


M/I HOMES

BRUNSWICK
GARAGE - RIGHT
OPTIONAL 2ND FLOOR PLANS


SHEET #
5.21

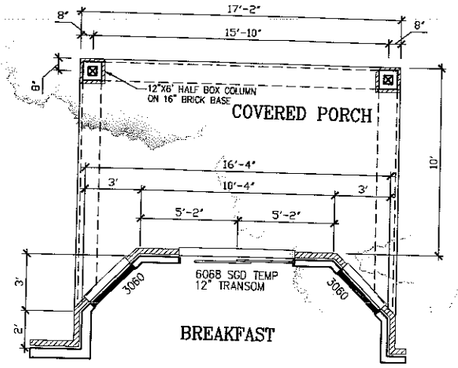


COVERED PORCH AT 1ST FLOOR

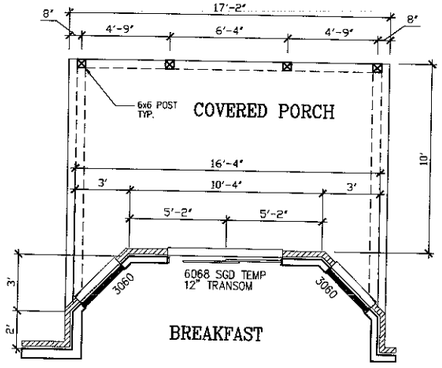


COVERED PORCH AT 1ST FLOOR
W/ DECK ABOVE

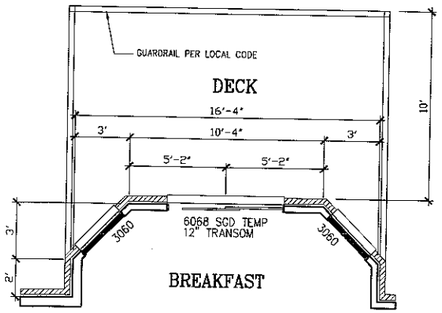


DECK AT 1ST FLOOR
W/ BASEMENT OPTION

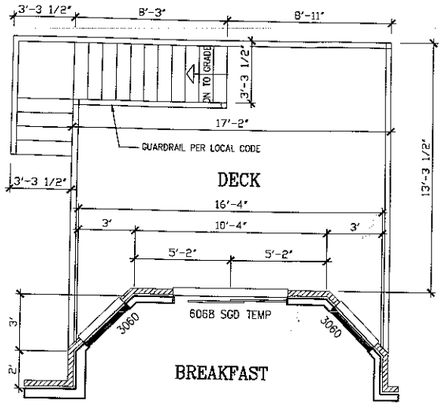


STAIRS AT DECK
AT 1ST FLOOR W/ BASEMENT OPTION

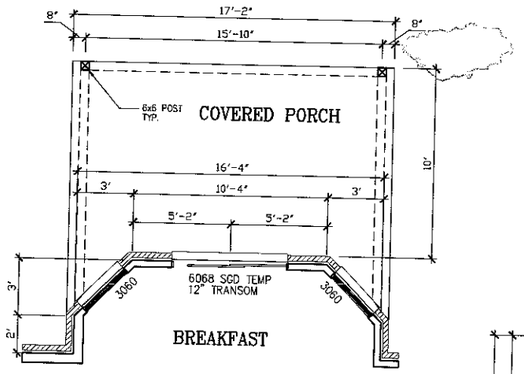


COVERED PORCH AT 1ST FLOOR
W/ CRAWL SPACE FOUNDATION




STUDY

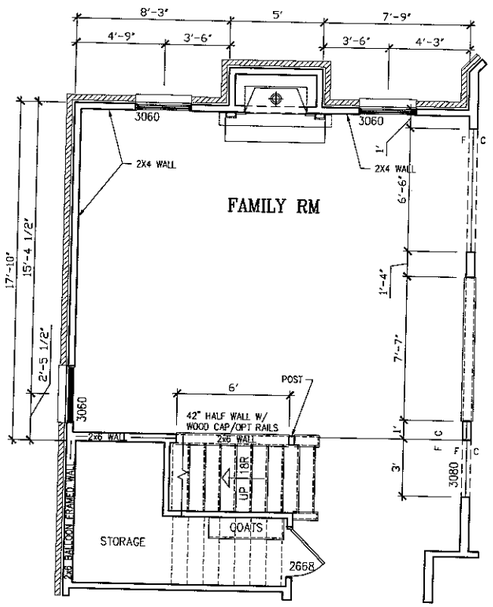

FAMILY ROOM W/ LOFT OR BDRM 5 ABOVE

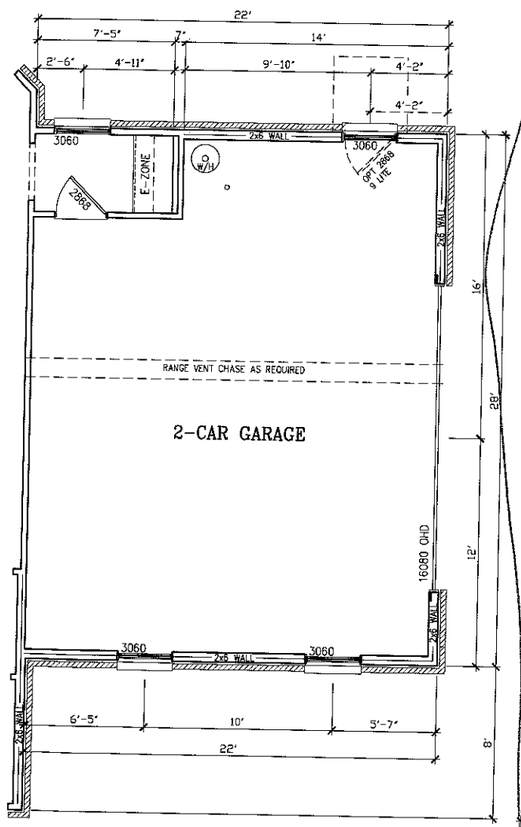

2-CAR SIDELOAD GARAGE

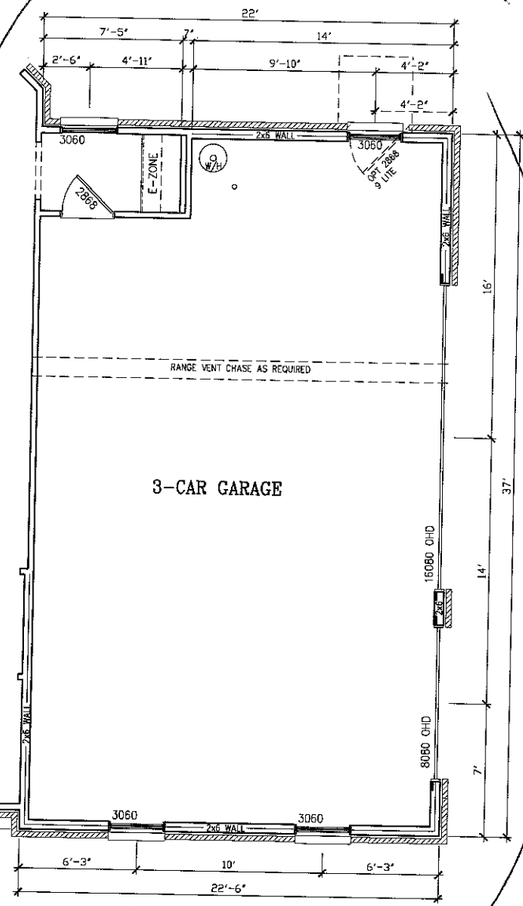

3-CAR GARAGE

Acknowledgement Of
Plans Submittal ONLY:
Date 8/24
Date 8/24

OPTIONAL 1ST FLOOR PLANS

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

© 2012 M/I HOMES INC.

MASTER ISSUE DATE:
11/21/11
DO NOT SCALE PRINTS! CONSTRUCTION SHALL BE PER INDICATED DIMENSIONS ONLY. ANY DISCREPENCIES TO BE REPORTED TO M/I HOMES FOR CLARIFICATION!
LATEST REVISION DATE:
05/12/12
SUB NAME
LOT# -
__/__/__

M/I HOMES

BRUNSWICK
GARAGE - RIGHT
OPTIONAL 1ST FLOOR PLANS

SHEET #
5.11

OPENING CALCULATIONS PER TABLE R302.1	
LEFT SIDE WALL	RIGHT SIDE WALL
TOTAL WALL AREA: 766 sf	TOTAL WALL AREA: 565 sf
TOTAL GLAZING AREA: 63 sf	TOTAL GLAZING AREA: 15 sf
TOTAL DOOR AREA: 0 sf	TOTAL DOOR AREA: 0 sf
OPENING AREA AS PERCENTAGE OF WALL: 8.2%	OPENING AREA AS PERCENTAGE OF WALL: 2.7%

OPENING CALCULATIONS PER TABLE R302.1	
LEFT SIDE WALL WITH BATH 4	RIGHT SIDE WALL WITH 2 CAR SIDELOAD GARAGE
TOTAL WALL AREA: 766 sf	TOTAL WALL AREA: 565 sf
TOTAL GLAZING AREA: 67 sf	TOTAL GLAZING AREA: 23 sf
TOTAL DOOR AREA: 0 sf	TOTAL DOOR AREA: 0 sf
OPENING AREA AS PERCENTAGE OF WALL: 8.7%	OPENING AREA AS PERCENTAGE OF WALL: 4%

OPENING CALCULATIONS PER TABLE R302.1	
RIGHT SIDE WALL WITH 3 CAR SIDELOAD GARAGE	
TOTAL WALL AREA: 743 sf	
TOTAL GLAZING AREA: 15 sf	
TOTAL DOOR AREA: 193 sf	
OPENING AREA AS PERCENTAGE OF WALL: 28%	

OPENING CALCULATIONS PER TABLE R302.1	
RIGHT SIDE WALL WITH 2 CAR SIDELOAD GARAGE	
TOTAL WALL AREA: 565 sf	
TOTAL GLAZING AREA: 15 sf	
TOTAL DOOR AREA: 126 sf	
OPENING AREA AS PERCENTAGE OF WALL: 25.3%	


General Floor Plan Notes

General Floor Plan Notes shall apply unless noted otherwise on plan.


1. **Wall Heights:** Typically 9'-1 1/2" first and second floors. All walls are constructed using a double top plate. Special wall heights are noted on plans where they occur.
2. **Wall Thickness** is typically 4" at exterior walls, 3-1/2" at interior. 2x6 frame shall be used at walls that back up to plumbing fixtures. Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
3. **Headers:** Structural headers are to be sized in accordance with NCRC Tables R502.5(1) and R502.5(2) or as noted on the plans for unique situations. Only use Structural Headers where required. Non-Structural Headers shall be Double Top Plate W/ Conventional Frame.
4. **Header height** shall be 7'-6" AFF (Charlotte) or 7'-8" AFF (Raleigh), unless noted otherwise.
5. **Jacks:** Jack requirements to be in accordance with NCRC Tables R502.5(1) and R502.5(2) or as noted on the plans for unique situations.
6. **Point loads** shall be blocked solidly to top of foundation. Point load supports are noted on plan where they occur.
7. **Soffits, Coffered Ceilings, Tray Ceilings** and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically called out as included, kitchens do not include soffits over wall cabinetry.
8. **Door & Window Frames,** where occurring near corners, shall be a minimum of 4-1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on the closet entry wall.
9. **Windows:** Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
10. **Closets** for clothing or coat storage shall be equipped with 1 rod/shelf, open wire. Closets for linen shall have 5 open wire shelves. Closets for pantries shall have 5 shelves.
11. **Stairs** shall have a minimum width dimension of 3'-0" finishedtreads shall be 10" deep, and risers shall be a maximum of 7-3/4" unless noted otherwise. Each tread shall have nosing protruding between 3/4" and 1 1/4" from the riser.

Handrails and Guards at stairs shall be between 34" and 38" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced such that a 4" sphere cannot pass through them per R312.3.

12. **Attic Access** with finished dimensions of a minimum 20" x 30" shall be provided in accordance with NCRC section R807 or Chapter 3 NCRC-Mechancial Section 306.3 if mechanical equipment is located in the attic space. Pull down stairs and weather sealed access doors in knee walls meeting minimum criteria are also acceptable. Attic access located in attached garages must be installed in accordance with NCRC R302.5.
13. **Garage Door to Living Space** shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
14. **Garage Walls,** as a minimum, shall be separated from living space and living space attic by installing 1/2" gypsum board on the garage side of the living space walls and any structural supportive walls and 5/8" Type 'X' Gyp BD at the ceilings. See R302.5 and R302.6
15. **Corners,** 4-1/2" minimum in wall corners for doors and windows to allow for trim.

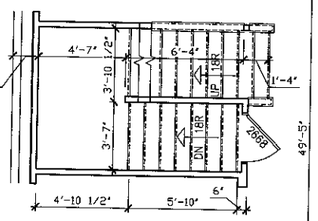

STAIR AT BASEMENT

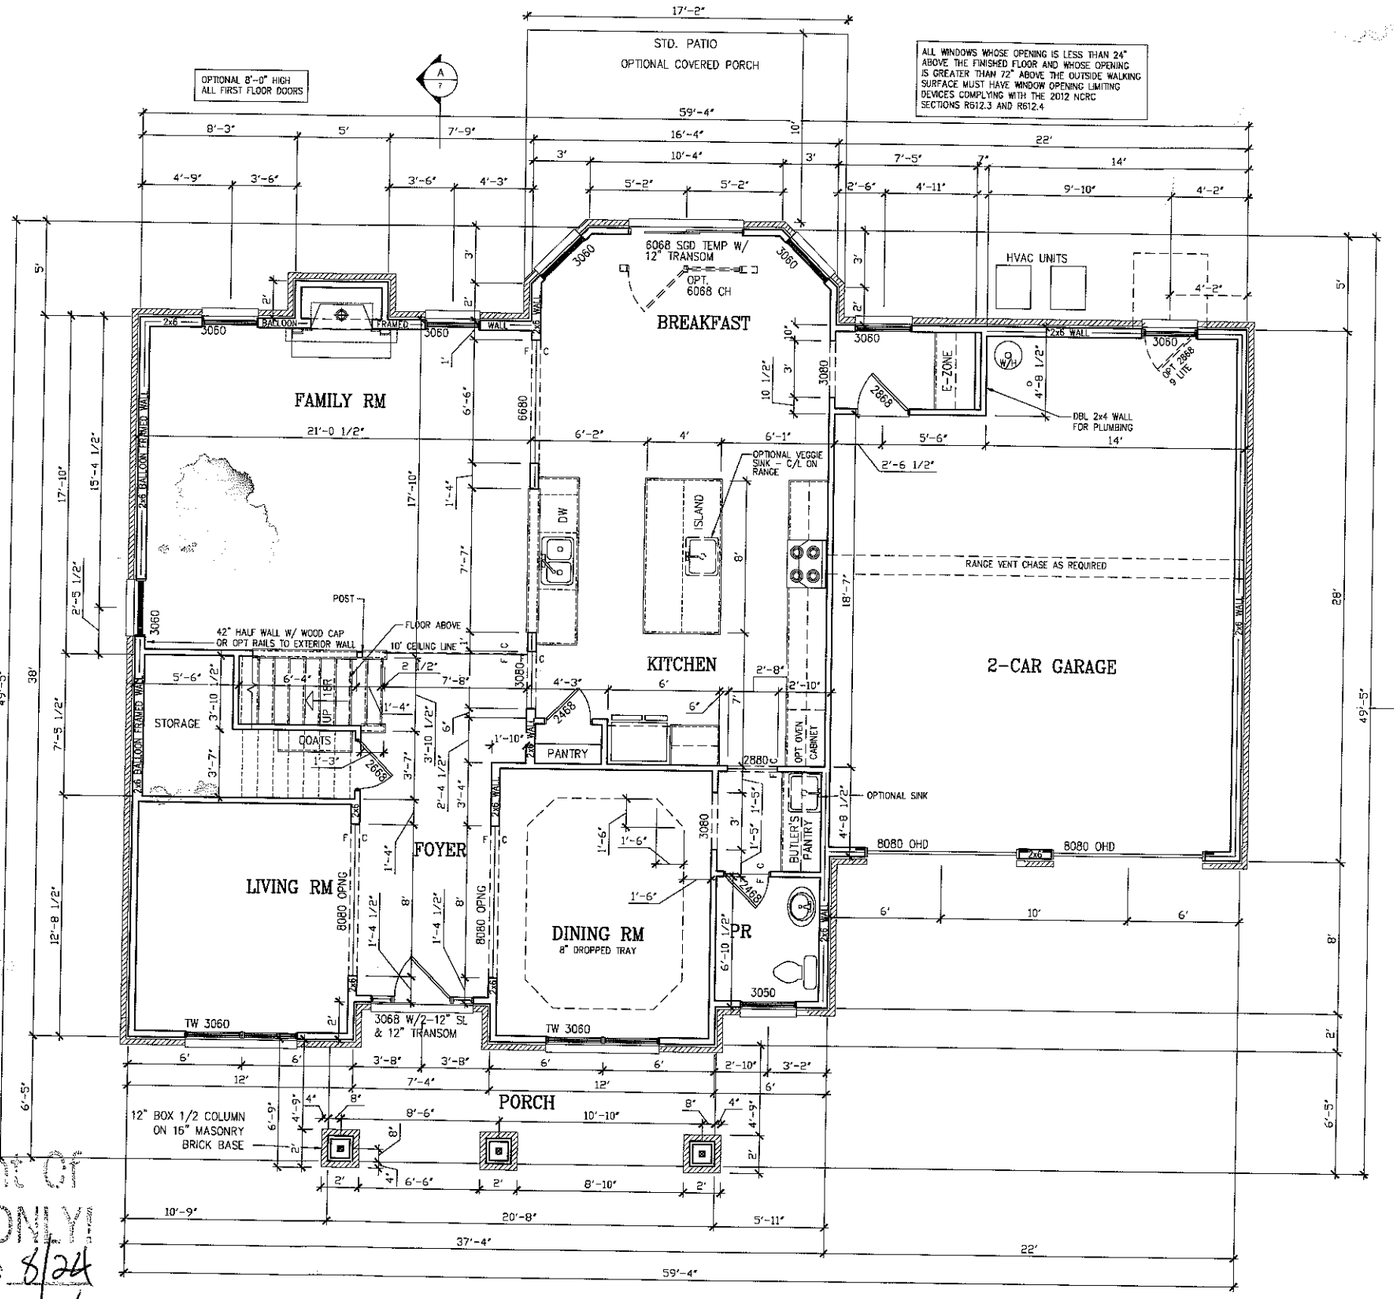

Acknowledgement Of Plans' Submittal ONLY!
Date 8/24
Date 8/24

1ST FLOOR PLAN "E"

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

©2012 MI HOMES INC.

MASTER ISSUE DATE:
11/21/11
DO NOT SCALE PRINTS! CONSTRUCTION SHALL BE PER INDICATED DIMENSIONS ONLY. ANY DISCREPENCIES TO BE REPORTED TO MI HOMES FOR CLARIFICATION!
LATEST REVISION DATE:
05/12/12
SUB NAME
LOT# -
__/__/__

M/I HOMES

BRUNSWICK
GARAGE - RIGHT
1ST FLOOR PLAN "E"

SHEET #
5.10