DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ *of* ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

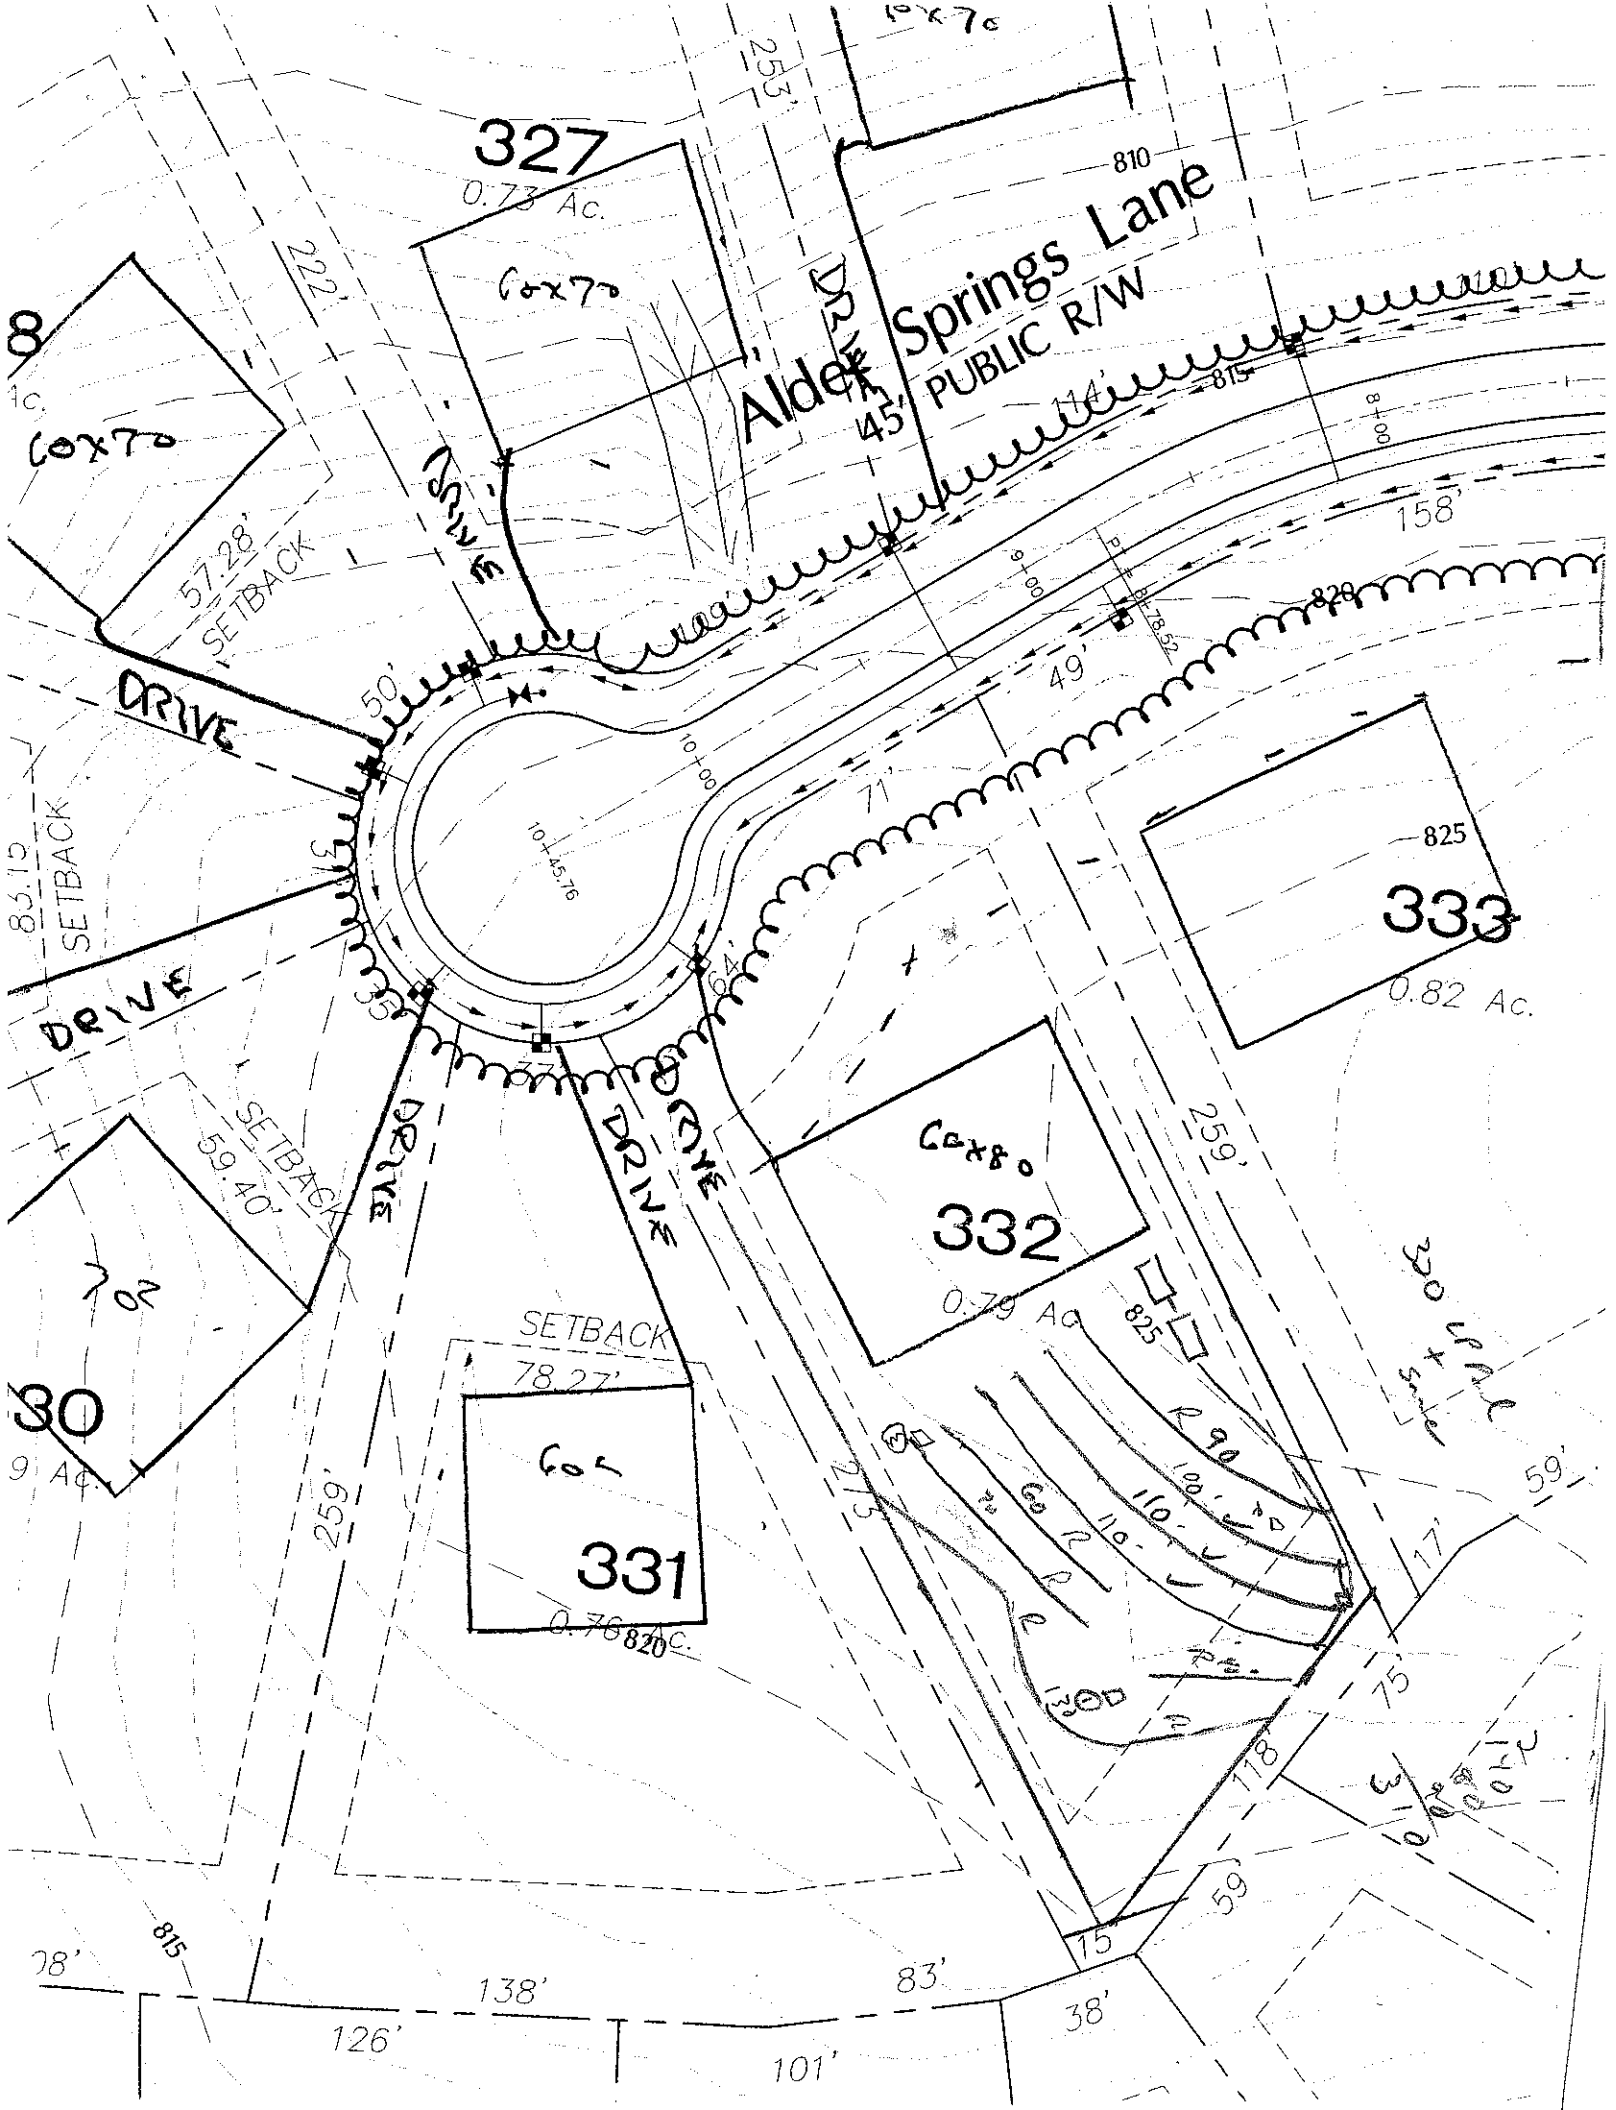
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 332 Farms III PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
2 1		0-11	BSCL CL	fri SSSP					P4 .3
		11-52	RC BRN/SBK	fri SP/SSSP					
3 2		0-36	BSCL WSBK	fri SSSP	common MN conc.				.25
		36-54	BLC SBK/ANH	fri SSSP					
1 B		0-4	RC ABK	fri SSSP					P3 .3
		H2O in old pit		below 42"					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


327
0.73 Ac.
60x70
Alder Springs Lane
45' PUBLIC R/W
810
815
820
825
158'
49'
71'
64'
259'
273'
DRIVE
DRIVE
DRIVE
50'
57.28'
SETBACK
85.15'
SETBACK
59.40'
SETBACK
78.27'
333
0.82 Ac.
332
0.79 Ac.
331
0.76 Ac.
60x80
60x
30
9 Ac.
138'
126'
101'
83'
38'
59'
75'
118'
17'
15'