DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ____ *of* ____
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

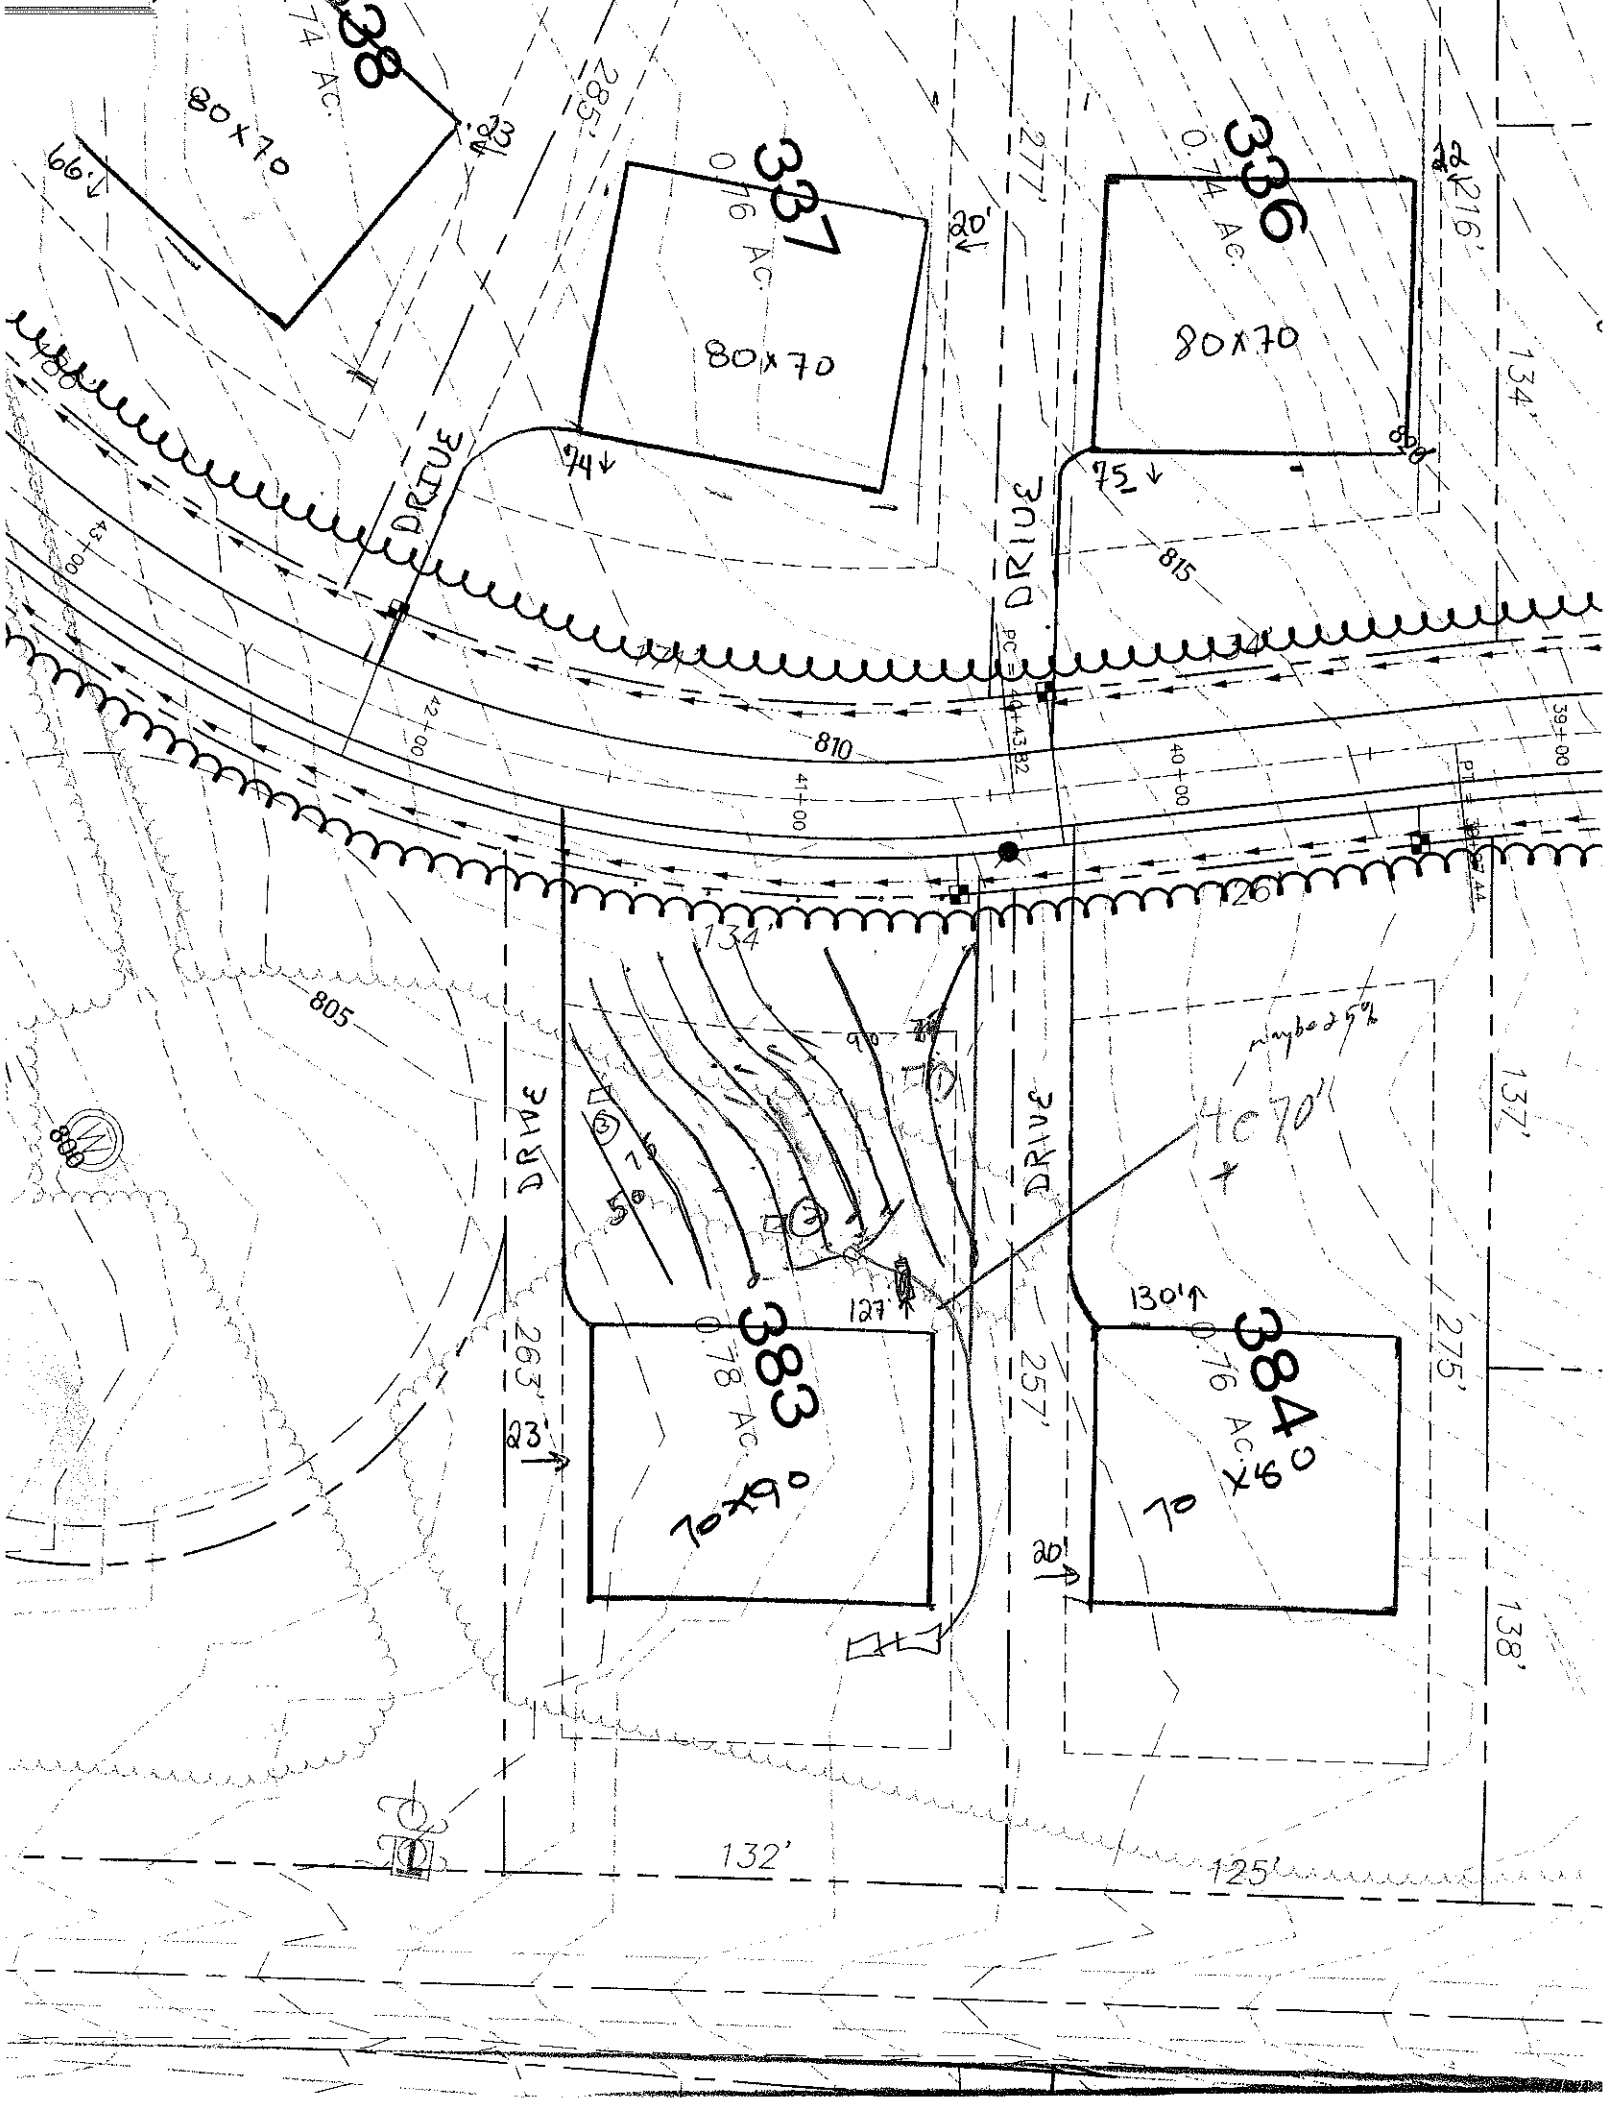
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: 383 farms III PROPERTY RECORDED: _____
WATER SUPPLY: ❑ Private ❑ Public ❑ Well ❑ Spring ❑ Other _____
EVALUATION METHOD: ❑ Auger Boring ❑ Pit ❑ Cut
TYPE OF WASTEWATER: ❑ Sewage ❑ Industrial Process ❑ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-8	Comp. R C	fr					P 3
		8-26	RC MFSBK	fr: SSSP					
		26-48	RCL MFSBK	fr SSSP	common				
2		0-12	Comp BSCL						P 3
		12-52	RC/CL MFSBK	fr: SSSP					
3		0-10	Comp CL	w 8" Debris					P 3
		10-48	RC/CL MFSBK	fr: SSSP	few FW Mott Many/common SAP				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


338
0.74 Ac.
80x70
337
0.76 Ac.
80x70
336
0.74 Ac.
80x70
DRIVE
DRIVE
DRIVE
277'
285'
216'
134'
99'
74'
75'
815
810
805
880
PC 40+43.82
42+00
41+00
40+00
39+00
134'
126'
137'
275'
138'
263'
257'
132'
125'
127'
130'
23'
20'
20'
maybe 2 5'h
70'
70
90
50
70
70
383
0.78 Ac.
70x90
384
0.76 Ac.
70x60