DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ____ of ____
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

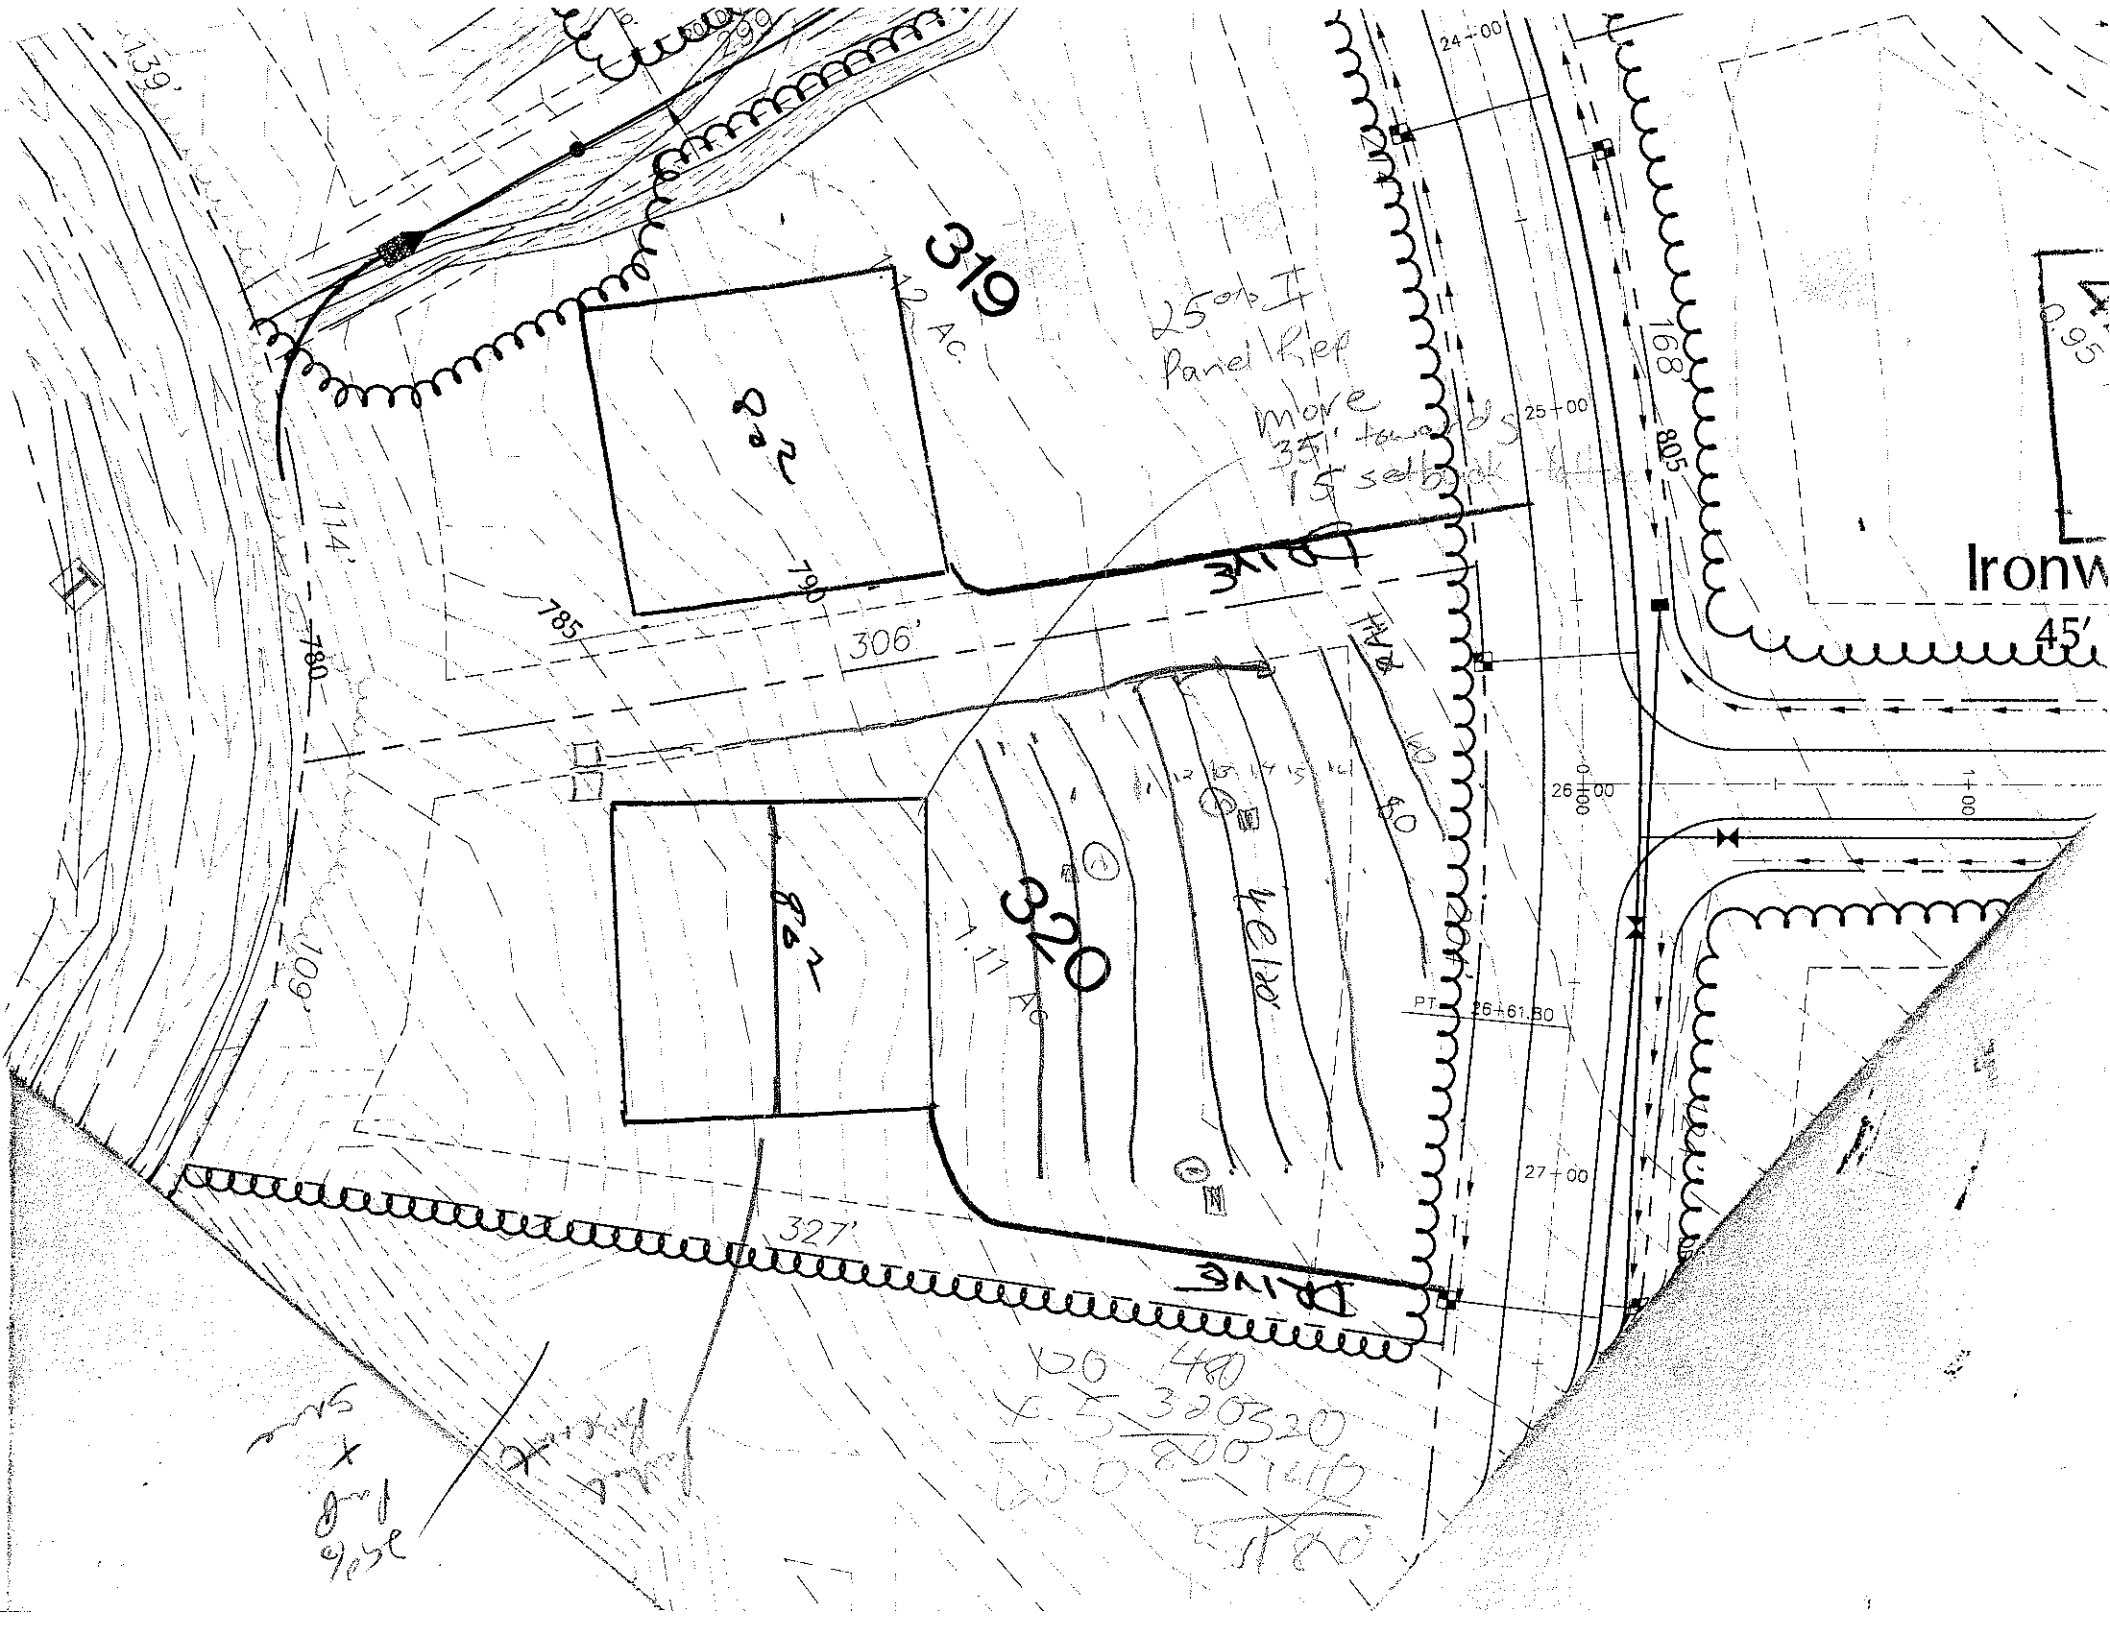
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 320 Farms PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-4	RBSCL WFSOM	fri SSSP	few/common SAP				PS .3
		4-20	RC MFSBK	fri SP					
		20-50	YRCL WFSBK	fri SSSP					
2		0-6	BSCL CR	fri SSSP					PS .25 to 36"
		6-50	RC ANK	fri SP - 2 chroma @ 36"					
3		0-6	BSCL WFSBK	fri SSSP					PS .25 to 38"
		6-39	RC MFSBK	fri SSSP					
		39-50	YRCL WFSBK	fri SSSP	common SAP few low chroma				
4	N/A	0-8	Rd/Brn SCL						PS .25 to .3
		8-36	Rd/Brn C/C						
		36-42+	Rd/Brn C	WF few to many SAP Inclus					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


319
1.2 AC.
320
1.11 AC.
25' ob. IT
Panel Rep
move
15' setback
306'
327'
114'
109'
139'
299
168
805
785
780
790
24+00
25+00
26+00
27+00
PT 26+61.80
45'
Ironw