DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____


SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: The Freems LLC APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 2-8-05
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 337 The Freems PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-5	wk sbk dk sdl	fr sss p					.3
		5-33	m fsbk RC	fr SO-sss p SO cl p					
		33-52	wk fsbk yr cl	fr sss p	dk mun-mod sap				
2	1½% L	0-3	gr dk sdl	fr					.3
		3-39	m fsbk RC	fr sss p SO cl p					
		39-51	wk fsbk yr cl	fr sss p - fab mod sap					
3		0-6	wk sbk sdl	fr sss p					.3
		6-40	m sbk RC	fr sss p					
		40-54	wk fsbk yr cl	fr sss p dk mod sap					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	95	95
System Type(s)	PM 25% Red	LPP PBDS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): RS
EVALUATED BY: DK Lemon
OTHER(S) PRESENT: Kathleen Ed TCJ

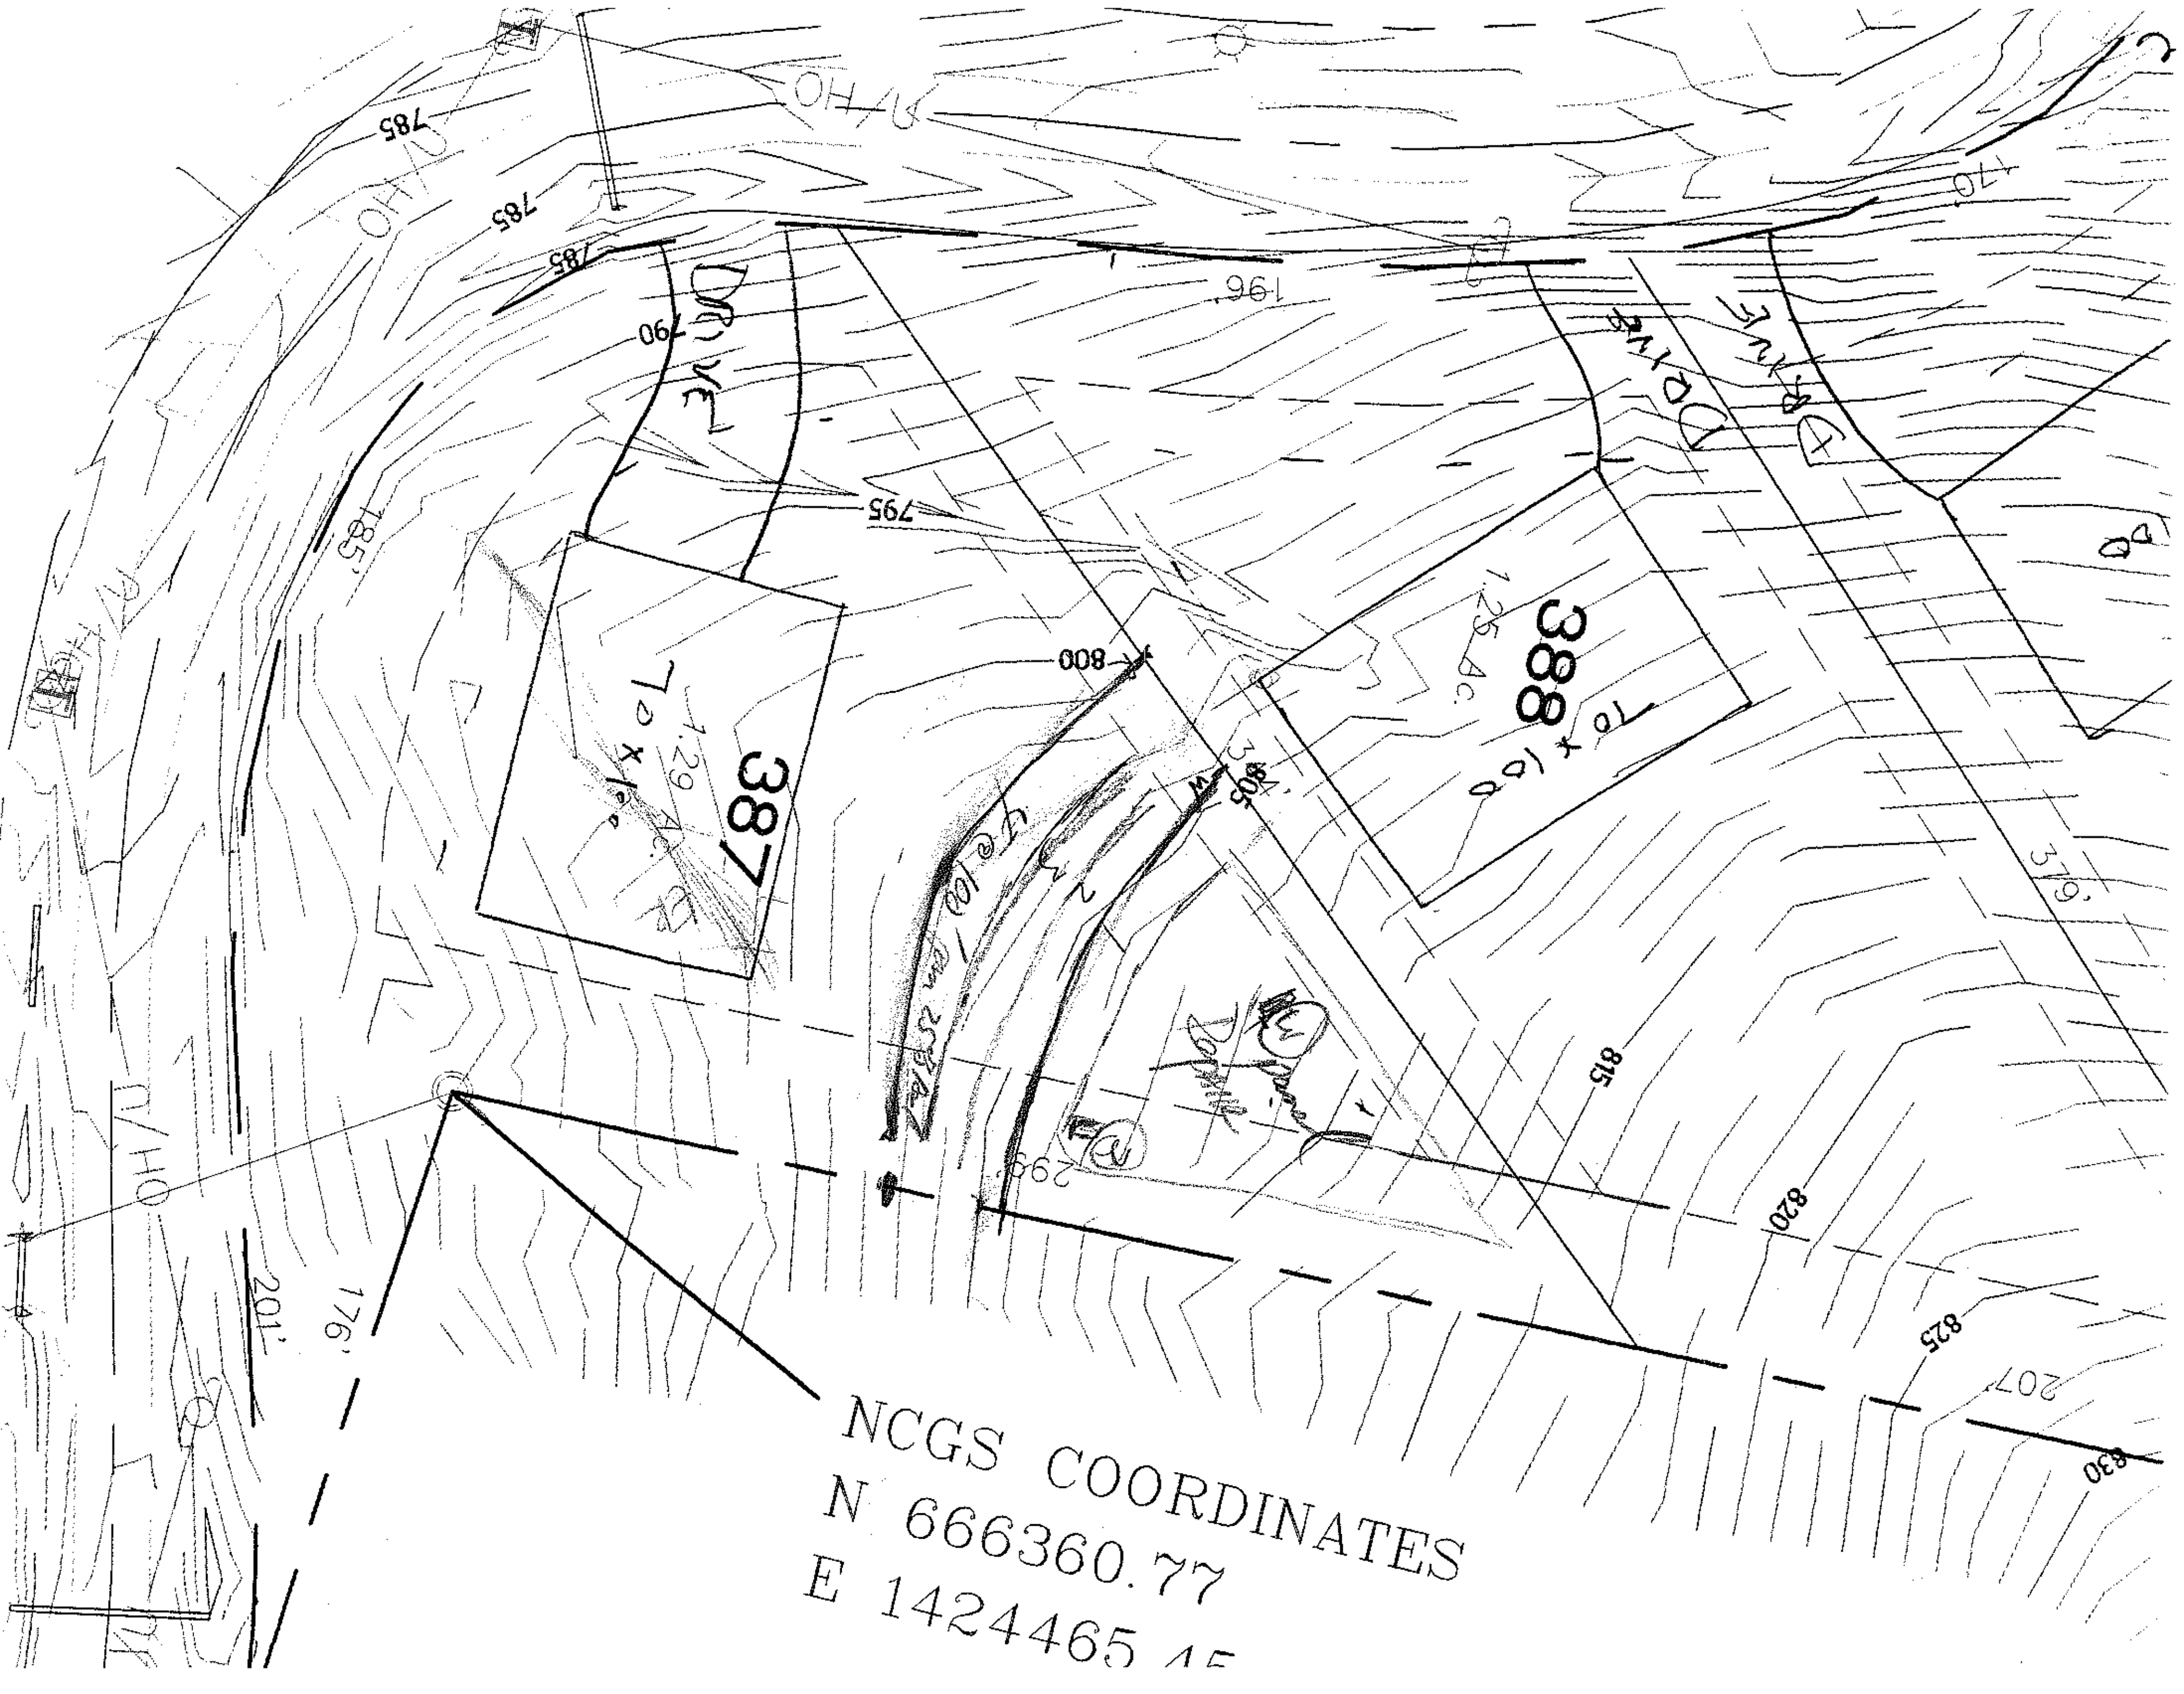

388
1.25 Ac.
70 x 100
387
1.29 Ac.
70 x 100
DRIVE
379'
196'
185'
176'
201'
207'
298'
785
790
795
800
805
815
820
825
830
NCGS COORDINATES
N 666360.77
E 1424465.45