IREDELL COUNTY HEALTH DEPARTMENT

13657

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR William F. Newell DATE Nov. 5, '91 PERMIT NO. 2F-6-A-15

PHONE: Business _____ Home _____

LOCATION 1100 TR 1177 (Chunkwood) TR 1279 (Seagrave) at end TL at end S. R. No. _____

SUBDIVISION NAME Holiday Harbor LOT NO. 15 SECTION OR BLOCK NO. _____

House (4) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 2 No. Bathrooms 2½

Garbage Disposal Unit Yes (4) No ( )
Auto. Dishwasher Yes (4) No ( )
Auto. Wash. Machine Yes (4) No ( )
Site ~~Suitable~~ PS Yes (4) No ( )

Lot Area 20,000 ft²

Character & Porosity of Soil area of Clearfield ls clay
Percolation Rate 4.4
Topography 4-8%
Depth to Water Table 44
Rock or other impervious formations (basement or equiv.) none obs.


4 Basement with Plumbing Basement without Plumbing No Basement

Size of Tank 1250 septic Gals. (1250 gal tank)
Nitrification Field:
No. of Lines 5
Sq. Ft. 600 Linear Ft. 200
Depth of Stone in Lines 12"
Water Supply: Individual (4)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

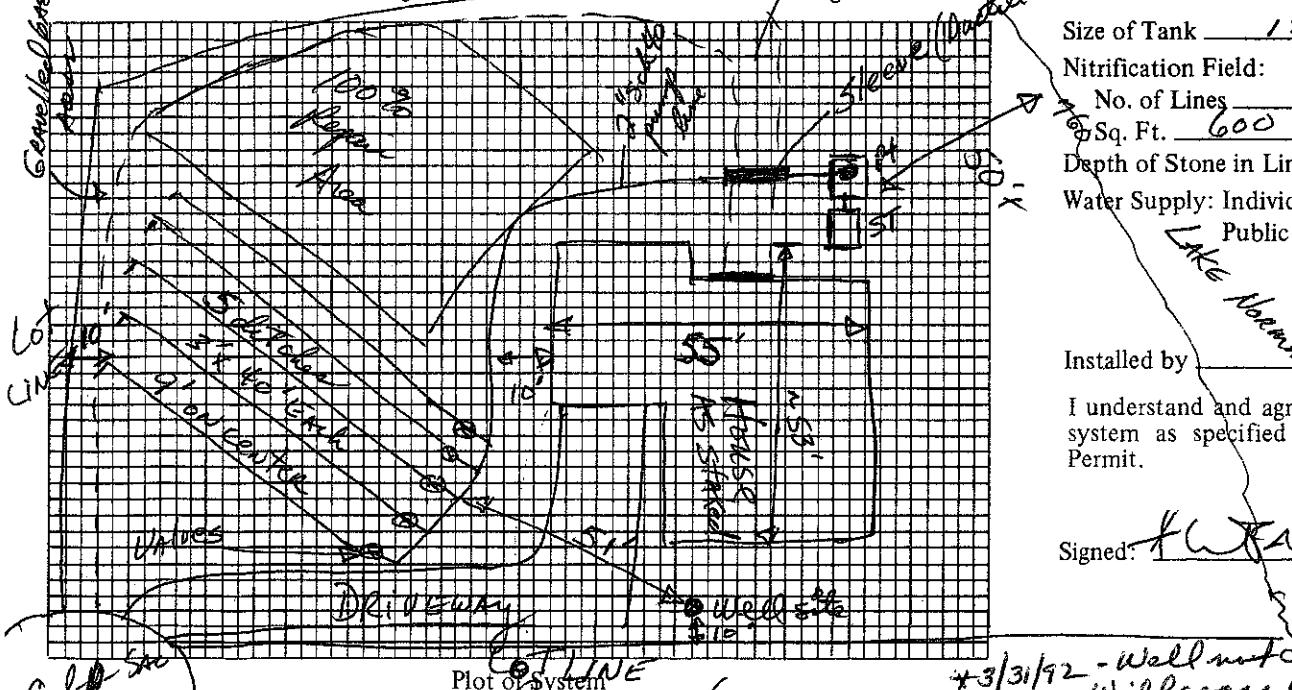

Plot of System

+3/31/92 - Well not drilled when planned. Will cause long more very short lines to be installed - HWS.

IMPROVEMENTS PERMIT BY Jack R. Hunsucker, R.S.

COMMENTS: Pressure dosed conventional trenches. 1½" sch 40 laterals with ONE 3/16" hole every 5 feet (40 holes total). Follow contour with trenches. 36" max trench bottom depth + 2' pressure head. Pump Specs: 24 gal/min. at approx. 35' total head.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

21, 31, 42, 43, 40, 28