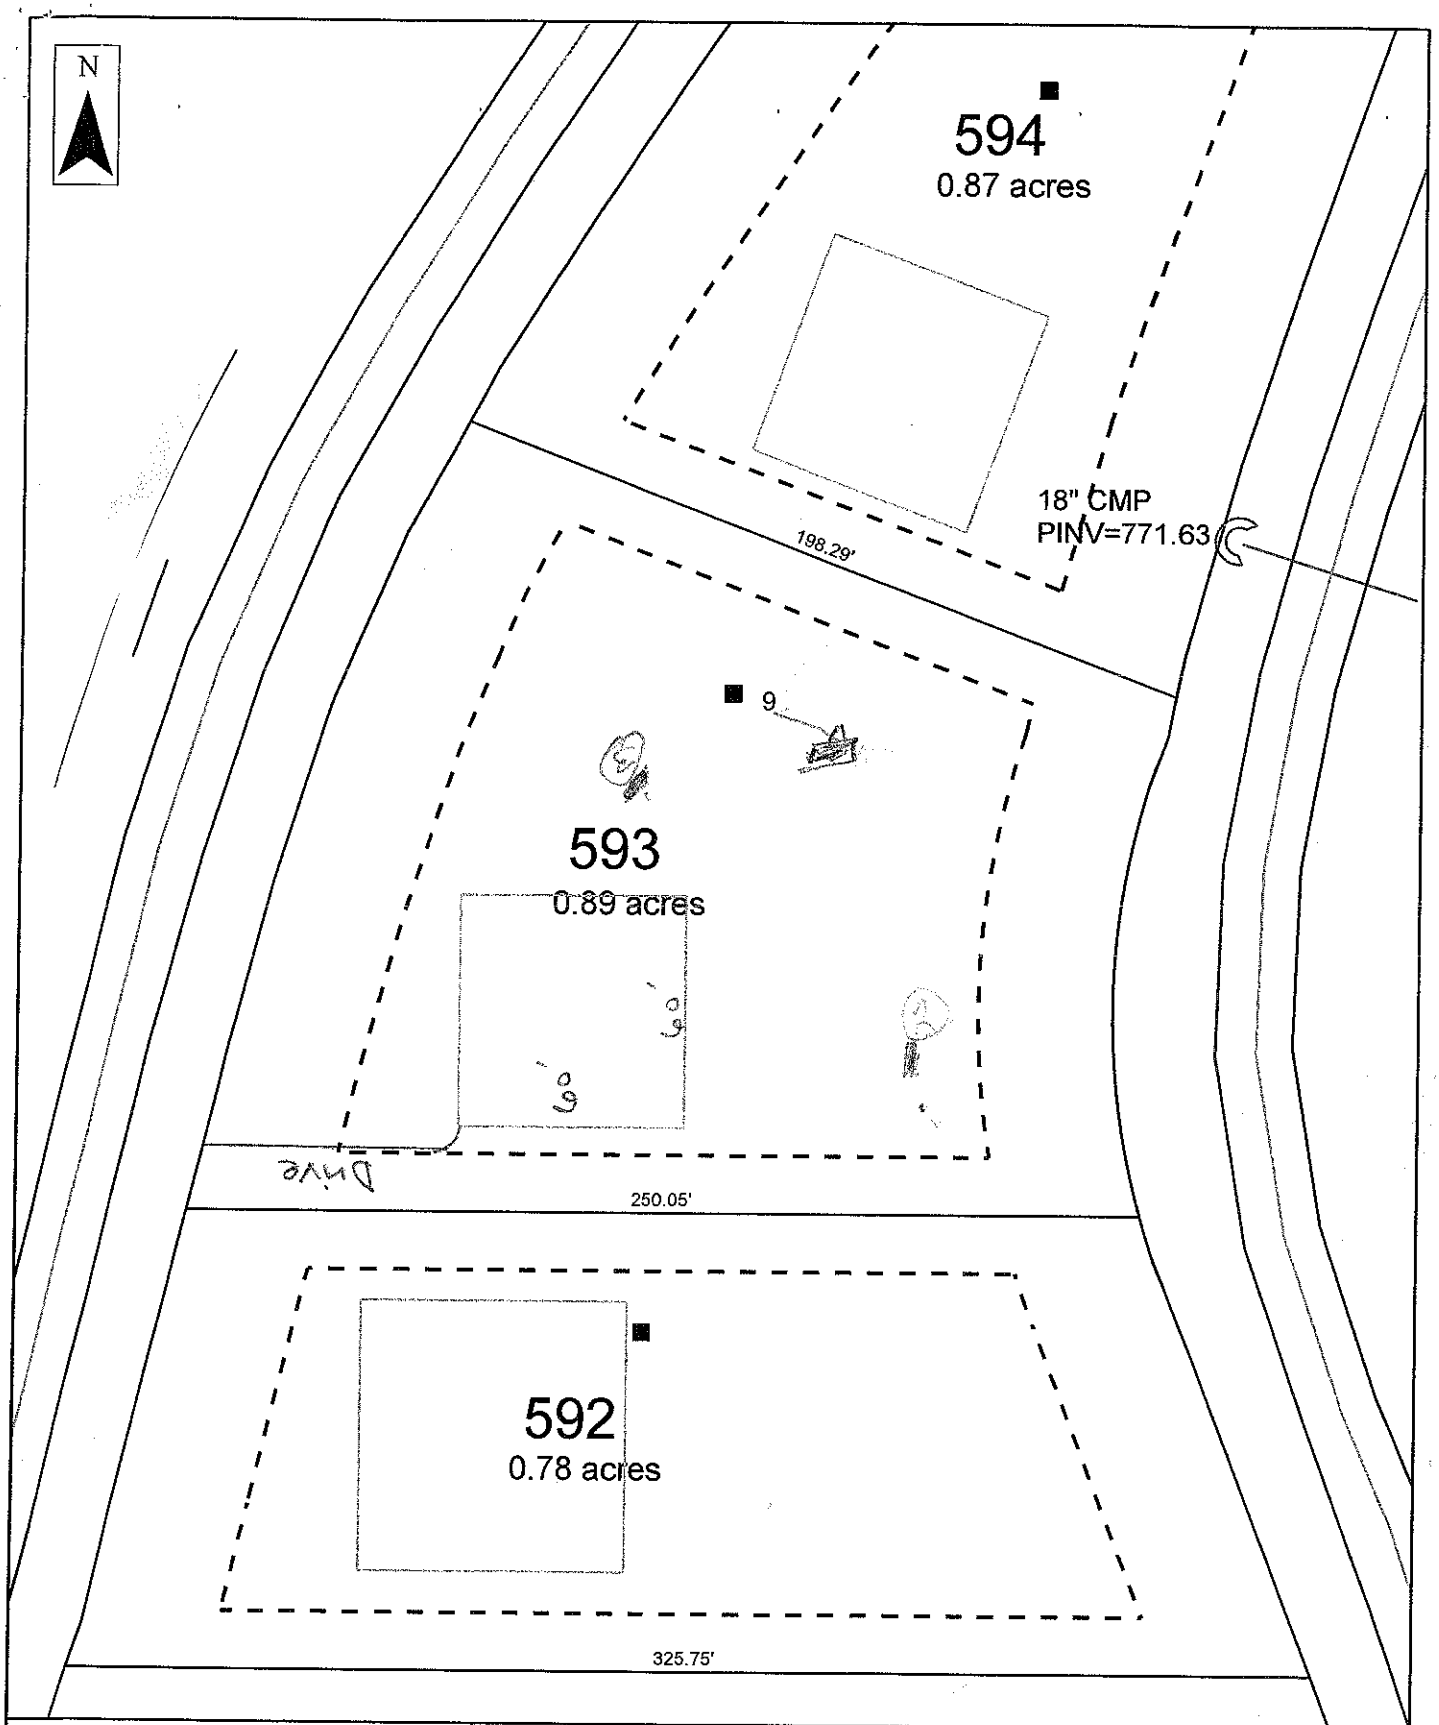


Scale: 1 inch equals 50 feet	S&ME	The Farms - Phase V	FIGURE
Drawn by: SDM		Lot 593	1
Reviewed by: JP		Iredell, North Carolina	
Date: November 2006	ENVIRONMENTAL SERVICES • ENGINEERING • TESTING	Job No. 1588-05-070	

DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Farms V
ADDRESS: _____ APPLICATION DATE _____
PROPOSED FACILITY: House PROPOSED DESIGN FLOW (.1949): 480 DATE EVALUATED: _____
LOCATION OF SITE: Lot 593 PROPERTY SIZE: _____
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other _____ PROPERTY RECORDED: _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941)		OTHER PROFILE FACTORS				PROFILE CLASS & LTAR
			.1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	.1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	
9		0-3	WK SBK SCL	FR SS/SP	Red Br				
1	L	3-27	Mh SBK C	FR SS/SP	Red		F sap	F WR	
		27-50	WK SBK SCL	FR SS/SP	Red		C sap		0.3
2		0-6	wk sbk lm sl	fr ss sp					
		6-30	weak mdc	fr ss sp					
		30-50	Wmdc cl	fr ss sp					.3
3		0-3	Mas lm sl	fr mv p					
		3-20	wk fmdc	fr ss sp					
		20-50	mwk sbk cl	fr ss p					.3
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____
COMMENTS: _____