DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

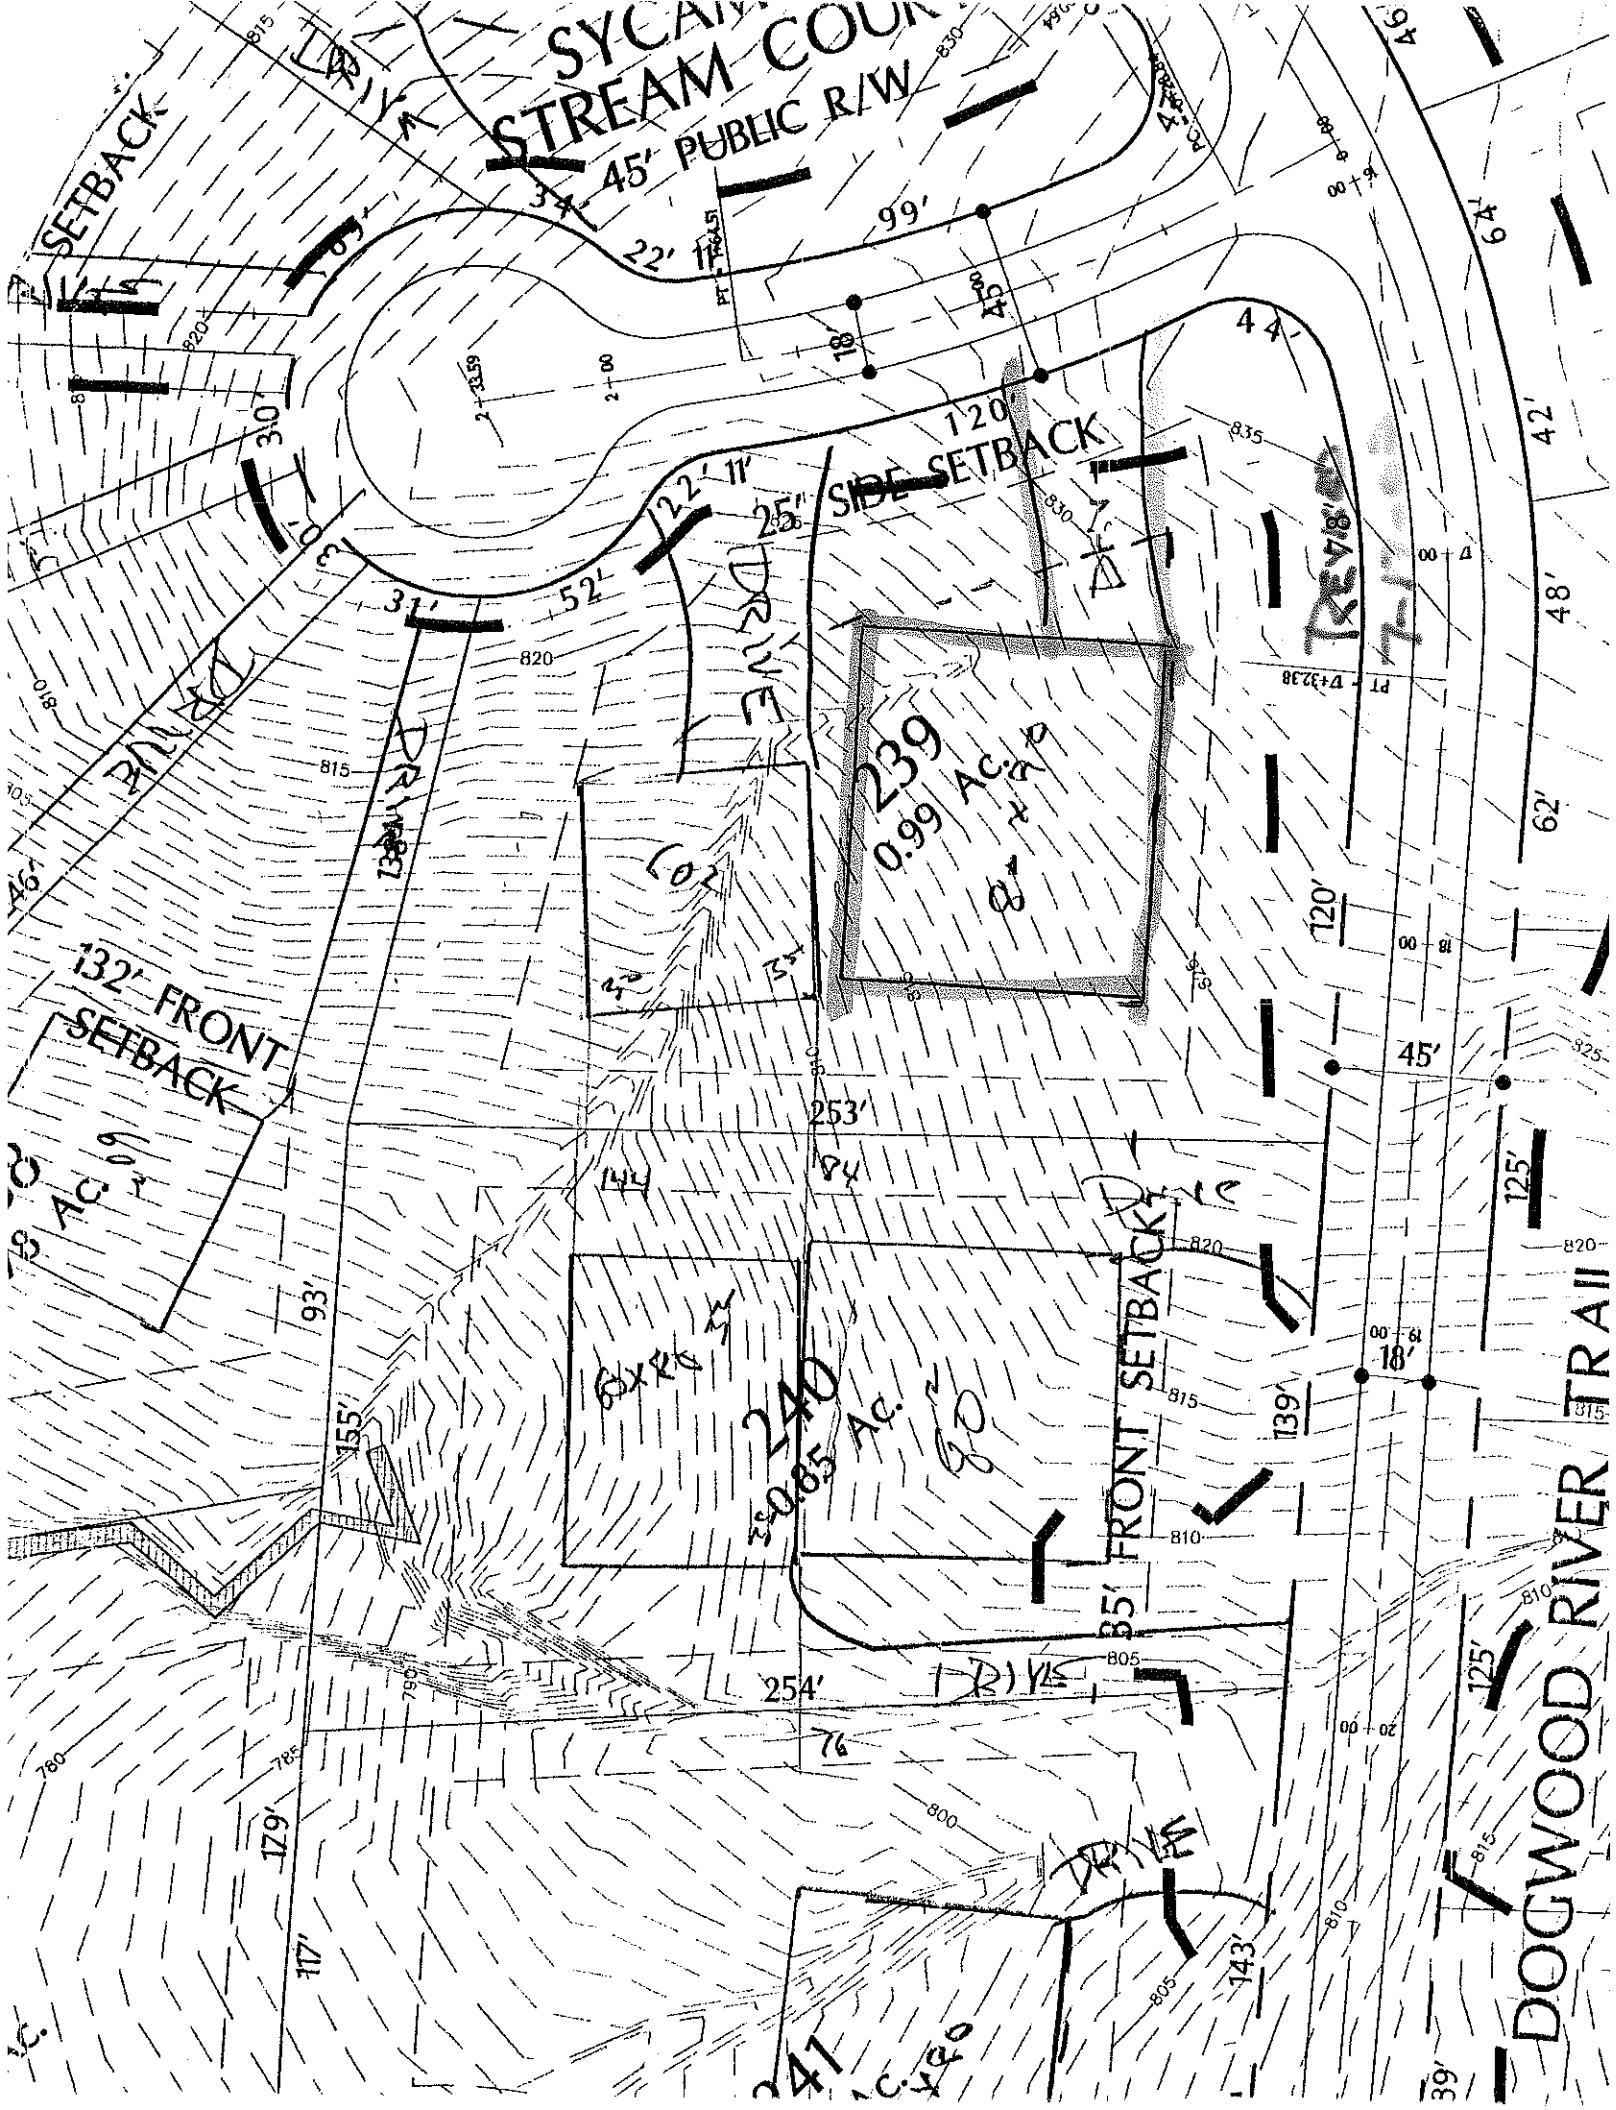
OWNER: _____ APPLICATION DATE _____
ADDRESS: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ DATE EVALUATED: _____
LOCATION OF SITE: The Farms SFE A PROPERTY SIZE: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____ PROPERTY RECORDED: _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	BSCL WSOM	fr: SSSP	32"+ Cm. y Rock				I S .3
		6-42	RC MFSBK	fi/fr: SP					
		42-49	RCL MFSBK	fr: SSSP					
2		0-6	BSCL WSBK	fr: SSSP					PS .3
		6-50	RC/CL MFSBK	fr: SSSP					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

COMMENTS: _____


STREAM COURT
45' PUBLIC R/W
SETBACK
99'
22' 11"
120'
SIDE SETBACK
25'
122' 11"
52'
31'
DRIVE
239
0.99 AC.±
60'
132' FRONT SETBACK
253'
144
84
93'
155'
240
0.85 AC.±
60'
60'x60'
FRONT SETBACK
139'
254'
179'
117'
DRIVE
143'
241
DOGWOOD RIVER TRAIL
125'
45'
18'
62'
48'
42'