DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

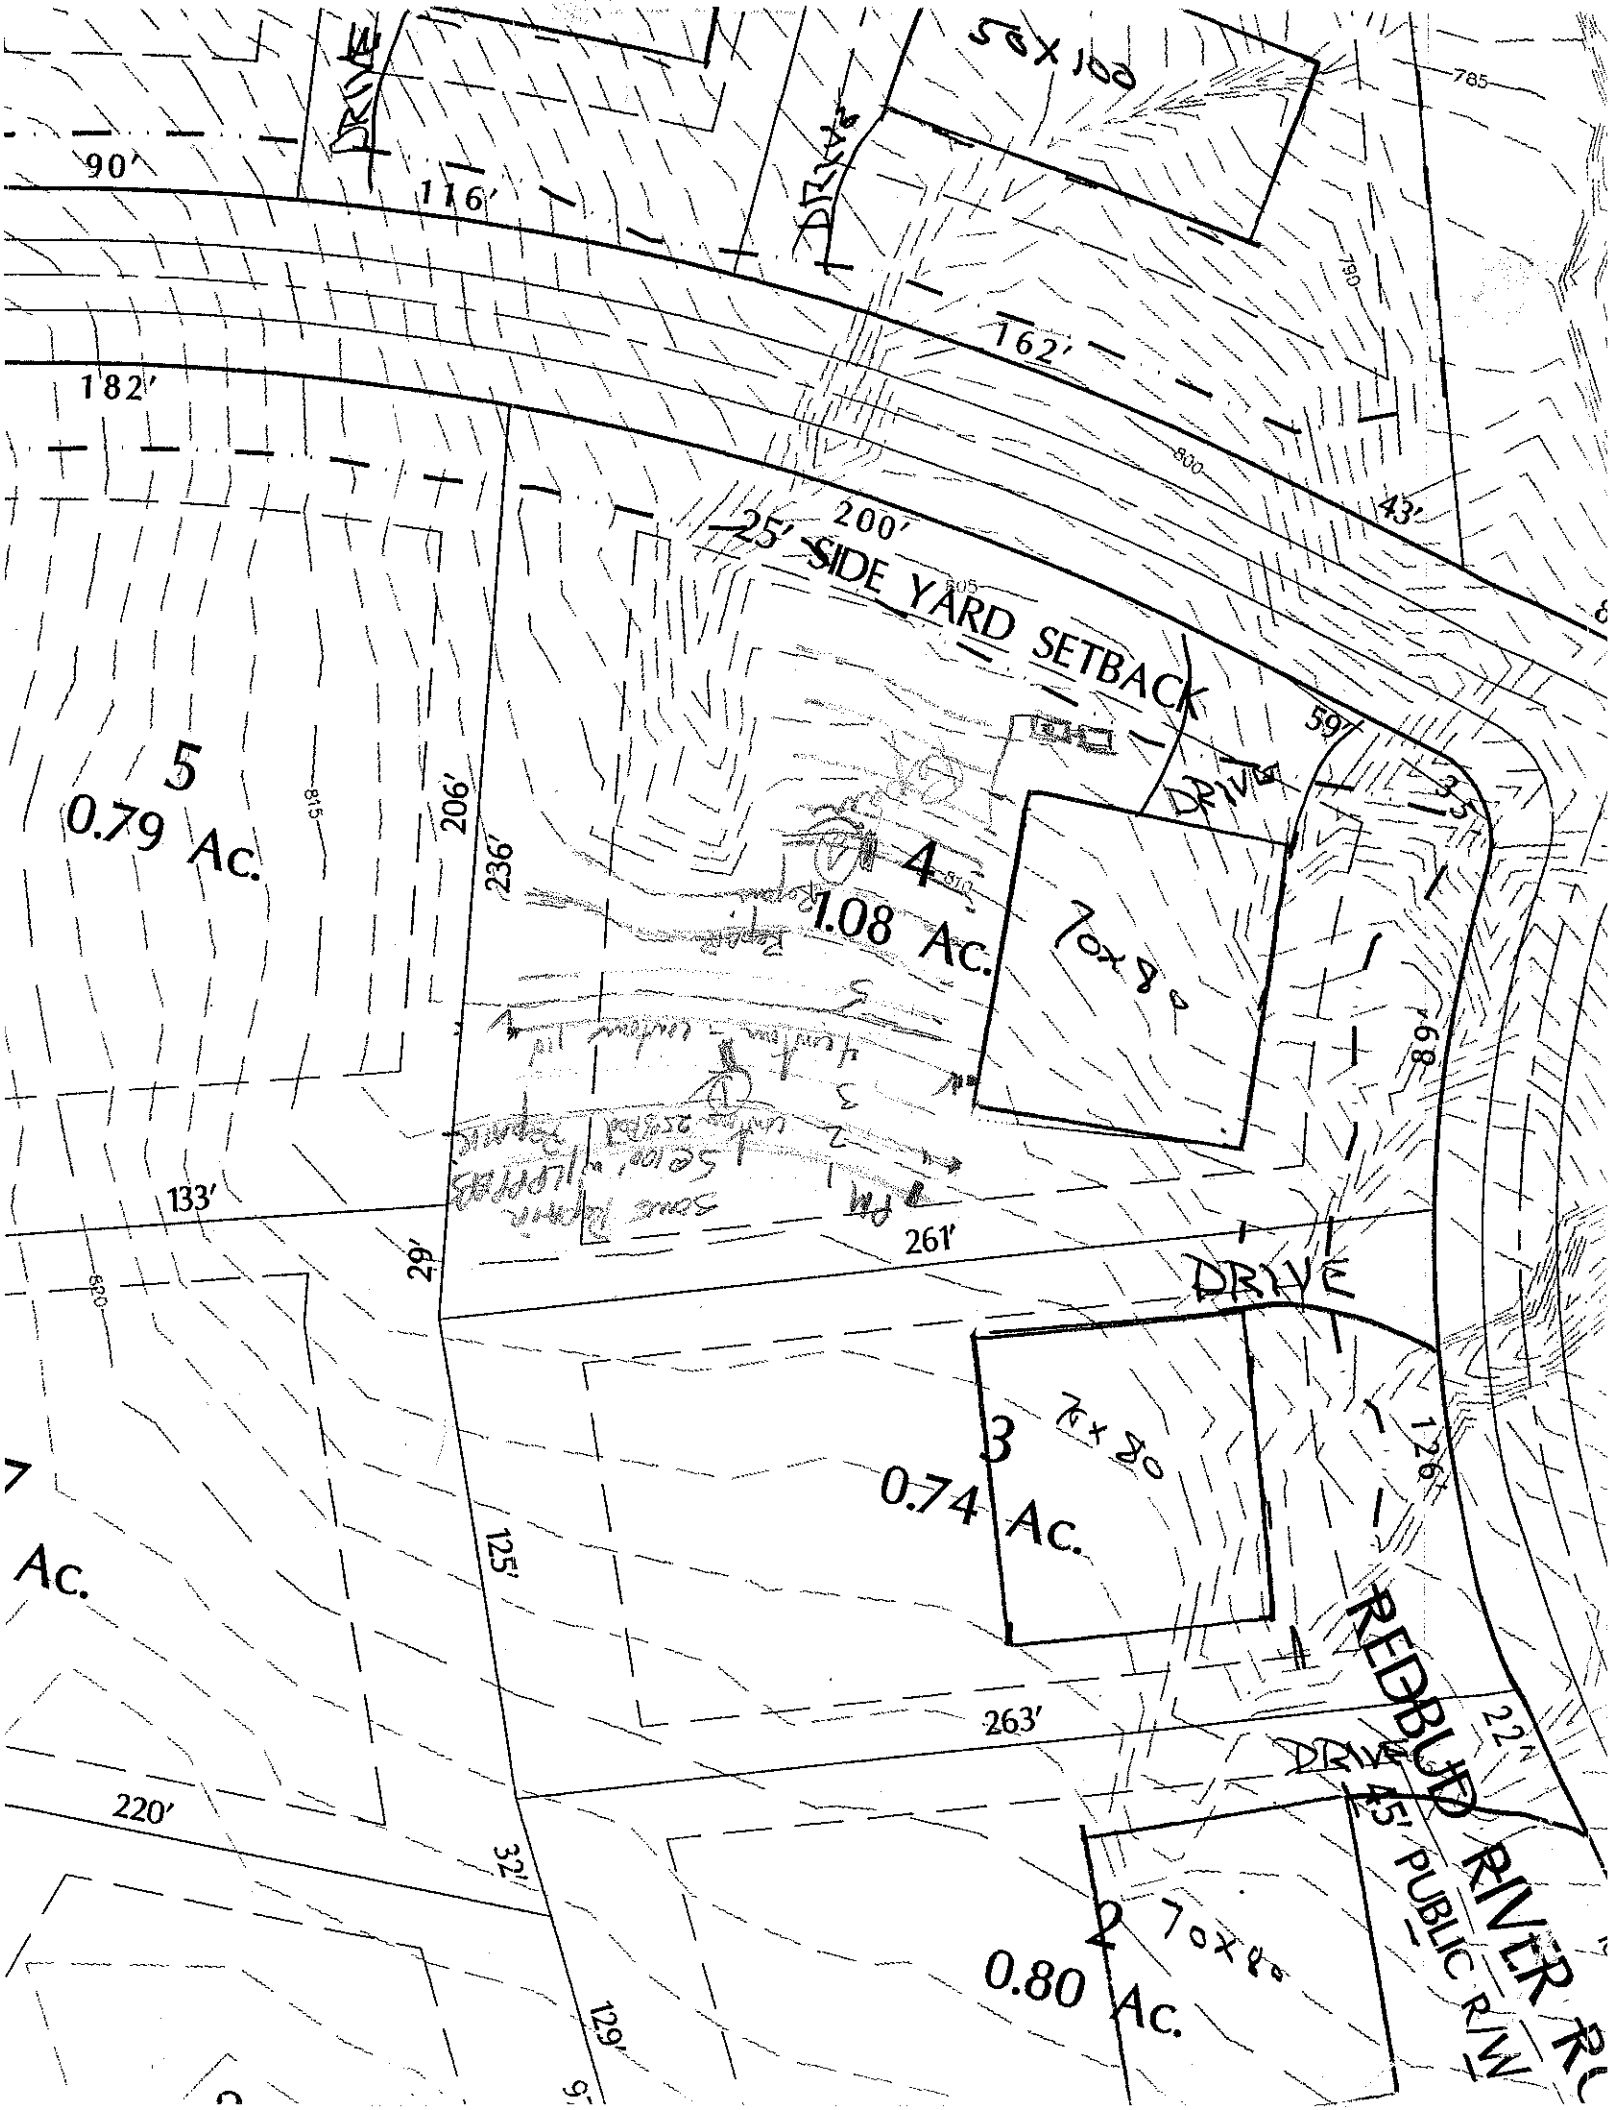
OWNER: CRI APPLICATION DATE: ___
ADDRESS: ___
PROPOSED FACILITY: ___ PROPOSED DESIGN FLOW (.1949): 480 gpd DATE EVALUATED: 3-11-03
LOCATION OF SITE: Lot 4 Lake Forest PROPERTY SIZE: ___
WATER SUPPLY: ☐ Private ☒ Public ☒ Well ☐ Spring ☐ Other ___ PROPERTY RECORDED: ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	~4%	0-15	wk fsbk sl mod fr ss sp						
		15-43	sk AB rc	fr sp					
		43-50	MSBK gy cl	fr ss sp	few common fnd sap				.3
2		0-6	wk sbk brn sil	fr ss sp					
		6-52	mfsbk/pb rc	fr sp	few manganese coatings				.25-.3
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS per 1952
System Type(s)	PM-25% Red	LPP PPS
Site LTAR	.25	.25

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DKH
OTHER(S) PRESENT: Paul Hemmings

COMMENTS: ___


DRIVE
50x100
90'
116'
162'
182'
200'
25' SIDE YARD SETBACK
43'
59'
5
0.79 Ac.
206'
236'
4
1.08 Ac.
70x80
68'
133'
29'
261'
DRIVE
3
0.74 Ac.
70x80
126'
125'
263'
22'
REDBUD RIVER RD
45' PUBLIC R/W
220'
32'
2
0.80 Ac.
70x80
129'
Ac.
785
790
800
805
810
815
820